


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.10V I:0.1083A P:11.870W PF:0.4980 Freq:50.00HZ UTHDi:0.00% ITHDi:0.00% Lamp Flux:666.717x1 lm


NAME: DDW31-LM13E-130BWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 56.11 lm/W
MODEL		Imax(cd)	5975	S/MH(C0/180)	0.32	
NOMINAL POWER(W)		LOR(%)	99.9	S/MH(C90/270)	0.28	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	666.01	η UP, DN(C0-180)	0.0, 55.2	
NOMINAL FLUX(lm)	666.717	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 44.7	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	220	η down(%)	99.9	CIBSE SHR MAX	1.00	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

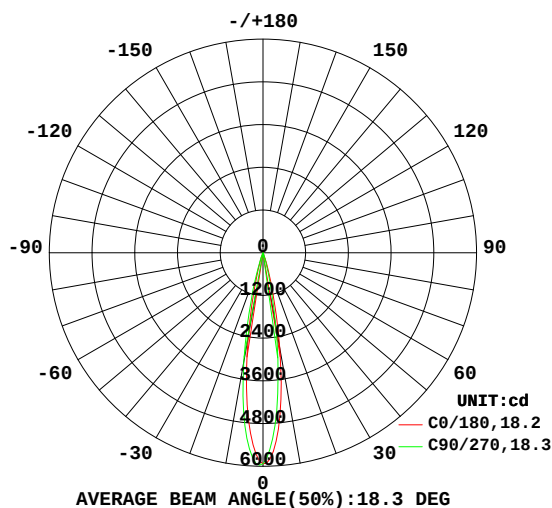

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

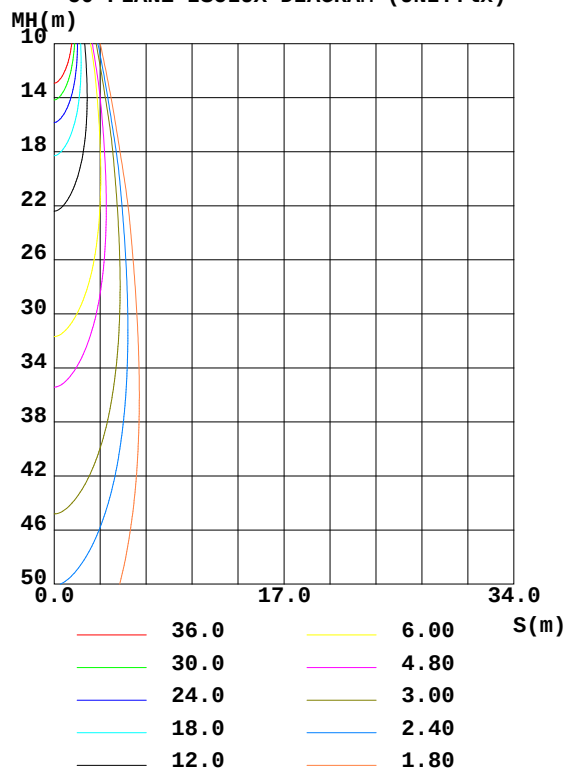

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.482m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	2366	2728	3107	3155	2734	2261	2057	2147	0- 10	386.9	386.9	58.1
20	146.9	180.9	242.9	247.7	183.6	139.9	126.1	130.9	10- 20	246.4	633.3	95.1
30	17.11	18.83	21.42	21.34	18.17	14.98	14.62	15.63	20- 30	27.35	660.7	99.2
40	1.933	1.951	1.842	1.666	1.417	1.486	1.638	1.826	30- 40	4.607	665.3	99.9
50	0.2132	0.2176	0.1820	0.1507	0.1507	0.1614	0.1766	0.1849	40- 50	0.4759	665.7	100
60	0.0080	0.0089	0.0081	0.0069	0.1674	0.1619	0.1602	0.1614	50- 60	0.0642	665.8	100
70	0.0063	0.0081	0.0068	0.0065	0.2025	0.1722	0.1646	0.1680	60- 70	0.0810	665.9	100
80	0.0034	0.0038	0.0034	0.0039	0.3635	0.2421	0.2304	0.2346	70- 80	0.1030	666.0	100
90	0	0	0	0	0	0	0	0	80- 90	0.0208	666.0	100
100	0	0	0	0	0	0	0	0	90-100	0	666.0	100
110	0	0	0	0	0	0	0	0	100-110	0	666.0	100
120	0	0	0	0	0	0	0	0	110-120	0	666.0	100
130	0	0	0	0	0	0	0	0	120-130	0	666.0	100
140	0	0	0	0	0	0	0	0	130-140	0	666.0	100
150	0	0	0	0	0	0	0	0	140-150	0	666.0	100
160	0	0	0	0	0	0	0	0	150-160	0	666.0	100
170	0	0	0	0	0	0	0	0	160-170	0	666.0	100
180	0	0	0	0	0	0	0	0	170-180	0	666.0	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 665.61 lm

%lum = 99.9%

%lamp = 99.8%

Conical surface Flux(120deg): 665.81 lm


%lum = 100.0%

%lamp = 99.9%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.482m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

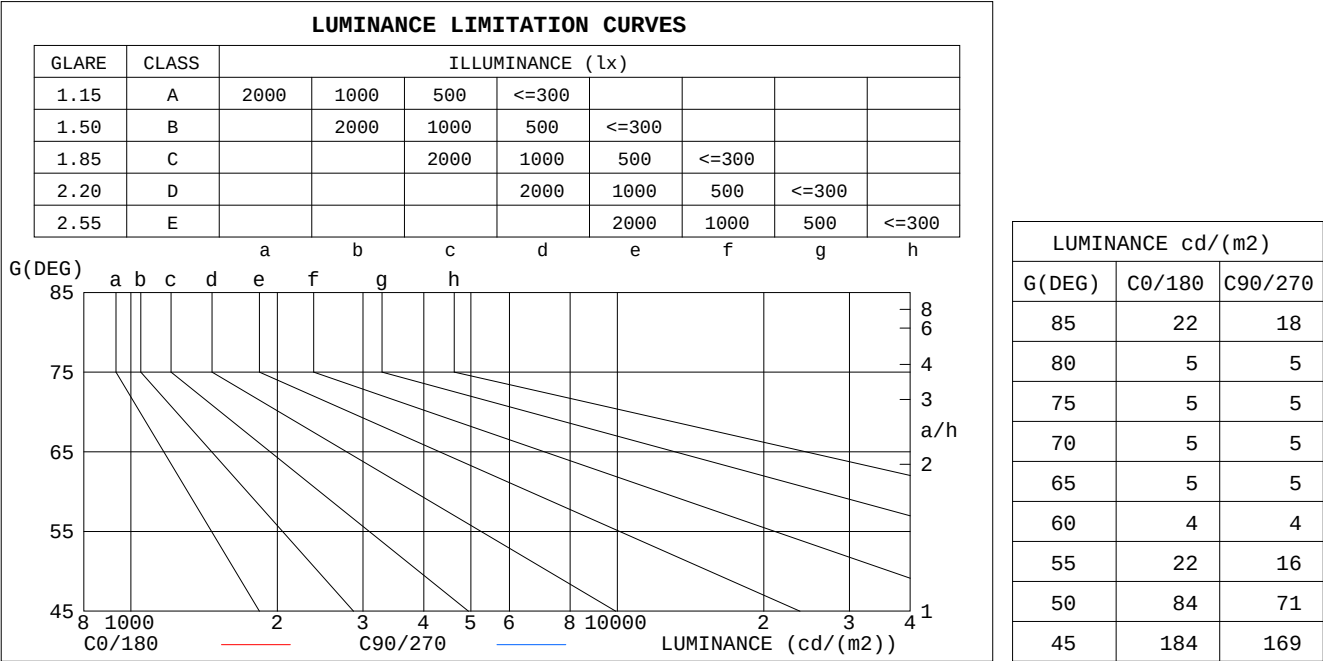


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-05-24

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.482m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.14	1.12	1.11	1.12	1.10	1.09	1.08	1.07	1.06	1.04	1.03	1.03	1.01	1.00	.00	.98
2.0	1.10	1.07	1.05	1.08	1.06	1.04	1.05	1.03	1.02	1.02	1.01	.00	.00	.99	.98	.96
3.0	1.06	1.03	1.01	1.05	1.02	1.00	1.03	1.00	.99	1.00	.99	.97	.98	.97	.96	.95
4.0	1.03	1.00	.98	1.02	.99	.97	1.00	.98	.96	.99	.97	.95	.97	.95	.94	.93
5.0	1.01	.98	.95	1.00	.97	.95	.98	.96	.94	.97	.95	.93	.96	.94	.92	.92
6.0	.99	.95	.93	.98	.95	.93	.97	.94	.92	.96	.93	.92	.94	.93	.91	.90
7.0	.97	.93	.91	.96	.93	.91	.95	.92	.90	.94	.92	.90	.93	.91	.90	.89
8.0	.95	.92	.89	.94	.91	.89	.93	.91	.89	.93	.90	.89	.92	.90	.88	.87
9.0	.93	.90	.88	.93	.90	.88	.92	.89	.87	.91	.89	.87	.91	.89	.87	.86
10.0	.91	.88	.86	.91	.88	.86	.91	.88	.86	.90	.88	.86	.89	.87	.86	.85

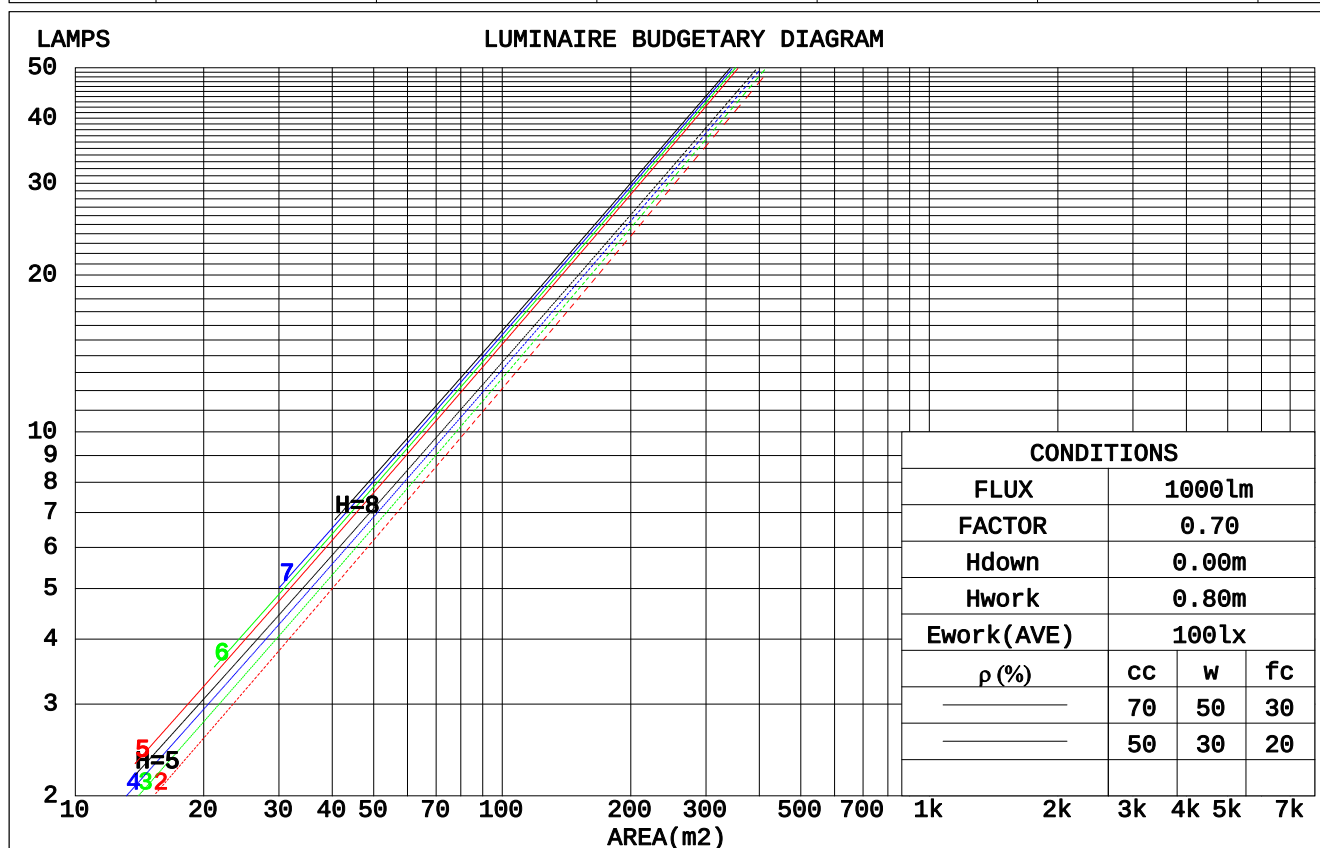

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.482m [K=1.0000]
Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0	
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.116	.066	.021	.110	.063	.020	.097	.056	.018	.086	.050	.016	.076	.044	.014		
2.0	.105	.058	.018	.100	.055	.017	.090	.050	.016	.081	.045	.014	.072	.041	.013		
3.0	.097	.051	.015	.092	.049	.015	.084	.046	.014	.076	.042	.013	.069	.038	.012		
4.0	.089	.046	.014	.086	.045	.013	.079	.042	.012	.072	.039	.012	.066	.036	.011		
5.0	.083	.042	.012	.080	.041	.012	.074	.039	.011	.069	.036	.011	.064	.034	.010		
6.0	.078	.039	.011	.075	.038	.011	.070	.036	.010	.066	.034	.010	.061	.032	.010		
7.0	.073	.036	.010	.071	.035	.010	.067	.034	.010	.063	.032	.009	.059	.031	.009		
8.0	.069	.034	.009	.067	.033	.009	.064	.032	.009	.060	.030	.009	.057	.029	.009		
9.0	.066	.032	.009	.064	.031	.009	.061	.030	.009	.058	.029	.008	.055	.028	.008		
10.0	.062	.030	.008	.061	.029	.008	.058	.029	.008	.056	.028	.008	.053	.027	.008		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.167	.158	.150	.143	.135	.129	.098	.093	.089	.056	.054	.052	.018	.017	.017	
2.0	.147	.133	.120	.126	.114	.104	.086	.079	.073	.050	.046	.043	.016	.015	.014	
3.0	.131	.113	.099	.112	.097	.086	.077	.068	.060	.045	.040	.035	.014	.013	.012	
4.0	.117	.097	.082	.101	.084	.071	.069	.059	.050	.040	.034	.030	.013	.011	.010	
5.0	.106	.085	.069	.091	.073	.060	.063	.051	.042	.036	.030	.025	.012	.010	.008	
6.0	.096	.074	.059	.083	.064	.051	.057	.045	.036	.033	.026	.021	.011	.009	.007	
7.0	.088	.066	.050	.076	.057	.044	.052	.040	.031	.030	.024	.018	.010	.008	.006	
8.0	.081	.059	.044	.070	.051	.038	.048	.036	.027	.028	.021	.016	.009	.007	.005	
9.0	.075	.053	.038	.064	.046	.033	.045	.032	.024	.026	.019	.014	.008	.006	.005	
10.0	.070	.048	.033	.060	.042	.029	.042	.029	.021	.024	.017	.012	.008	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.482m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	-5.4	-4.9	-5.2	-4.8	-4.6	-4.8	-4.3	-4.6	-4.1	-4.0
3H	-5.5	-5.1	-5.3	-4.9	-4.7	-4.9	-4.4	-4.7	-4.2	-4.1
4H	-5.6	-5.2	-5.4	-5.0	-4.8	-5.0	-4.5	-4.7	-4.3	-4.1
6H	-5.7	-5.3	-5.4	-5.0	-4.8	-5.1	-4.6	-4.8	-4.4	-4.2
8H	-5.7	-5.3	-5.5	-5.1	-4.8	-5.1	-4.7	-4.8	-4.4	-4.2
12H	-5.8	-5.4	-5.5	-5.1	-4.9	-5.1	-4.7	-4.8	-4.5	-4.2
4H 2H	-5.6	-5.2	-5.4	-5.0	-4.8	-5.0	-4.5	-4.7	-4.3	-4.1
3H	-5.8	-5.4	-5.5	-5.1	-4.9	-5.1	-4.7	-4.8	-4.5	-4.2
4H	-5.9	-5.5	-5.6	-5.2	-4.9	-5.2	-4.9	-4.9	-4.6	-4.3
6H	-6.0	-5.7	-5.6	-5.3	-5.0	-5.3	-5.0	-5.0	-4.7	-4.3
8H	-6.0	-5.7	-5.7	-5.4	-5.0	-5.4	-5.1	-5.0	-4.7	-4.4
12H	-6.1	-5.8	-5.7	-5.4	-5.1	-5.5	-5.2	-5.1	-4.8	-4.4
8H 4H	-6.0	-5.7	-5.7	-5.4	-5.0	-5.4	-5.1	-5.0	-4.7	-4.4
6H	-6.2	-5.9	-5.7	-5.5	-5.1	-5.5	-5.3	-5.1	-4.9	-4.5
8H	-6.2	-6.0	-5.8	-5.6	-5.1	-5.6	-5.4	-5.1	-4.9	-4.5
12H	-6.3	-6.1	-5.8	-5.7	-5.2	-5.7	-5.4	-5.2	-5.0	-4.5
12H 4H	-6.1	-5.8	-5.7	-5.4	-5.1	-5.5	-5.2	-5.1	-4.8	-4.4
6H	-6.2	-6.0	-5.8	-5.6	-5.1	-5.6	-5.4	-5.1	-4.9	-4.5
8H	-6.3	-6.1	-5.8	-5.7	-5.2	-5.7	-5.4	-5.2	-5.0	-4.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.6 / -20.4					+ 4.7 / -20.3				
1.5H	+ 7.2 / -17.1					+ 7.3 / -17.4				
2.0H	+ 6.7 / -11.3					+ 6.6 / -10.2				

CIE Pub.117, 666.7 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -1.4$)
Area: 0.004 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.482m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	89	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	108	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	102	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	112	110	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.482m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

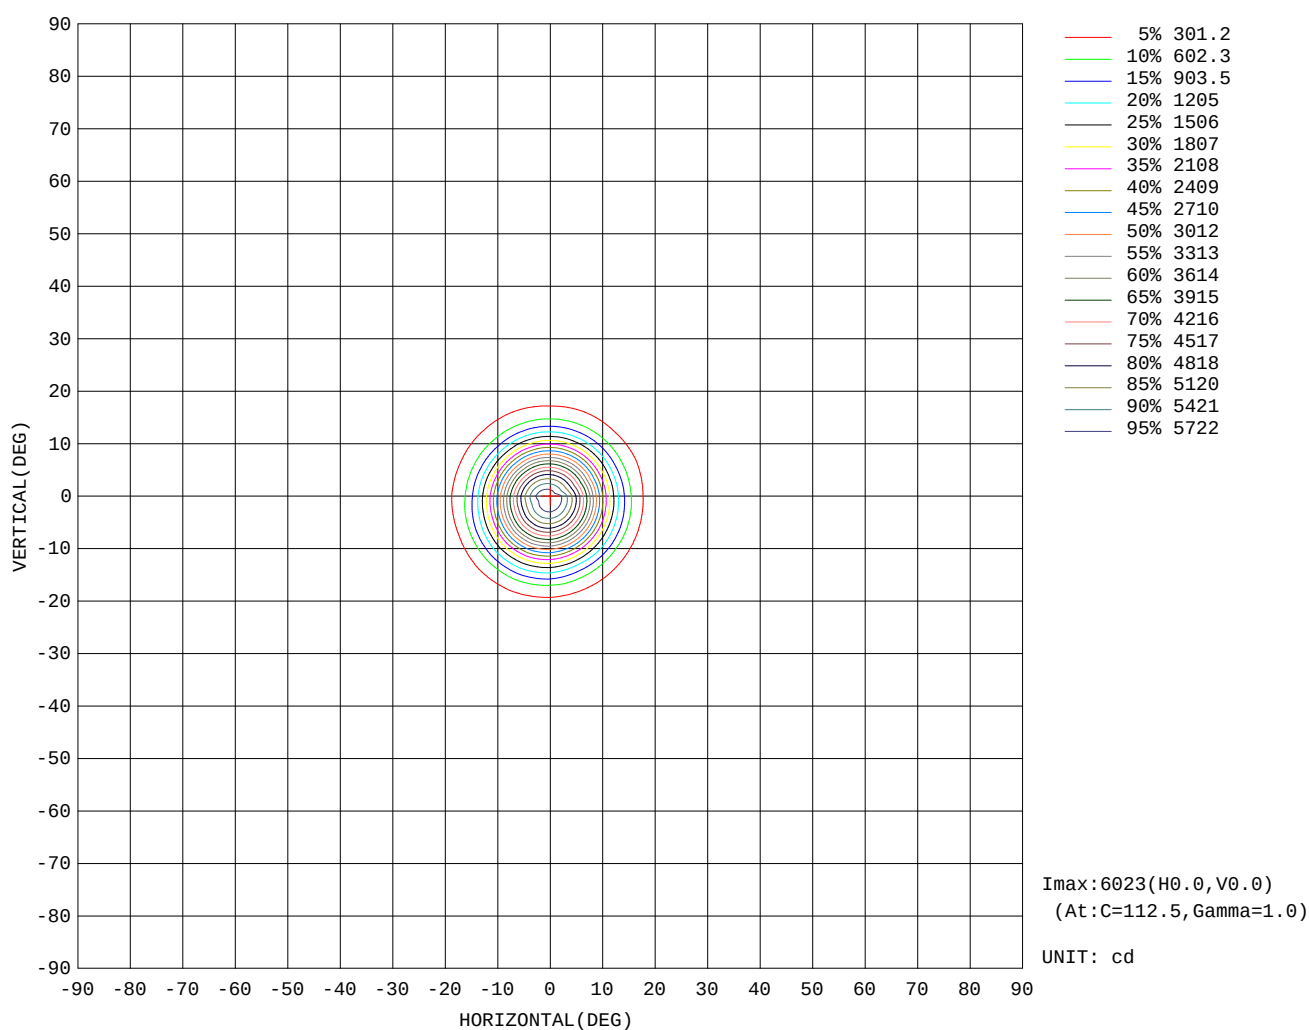

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-05-24

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.482m [K=1.0000]
Remarks:


AAI Figure

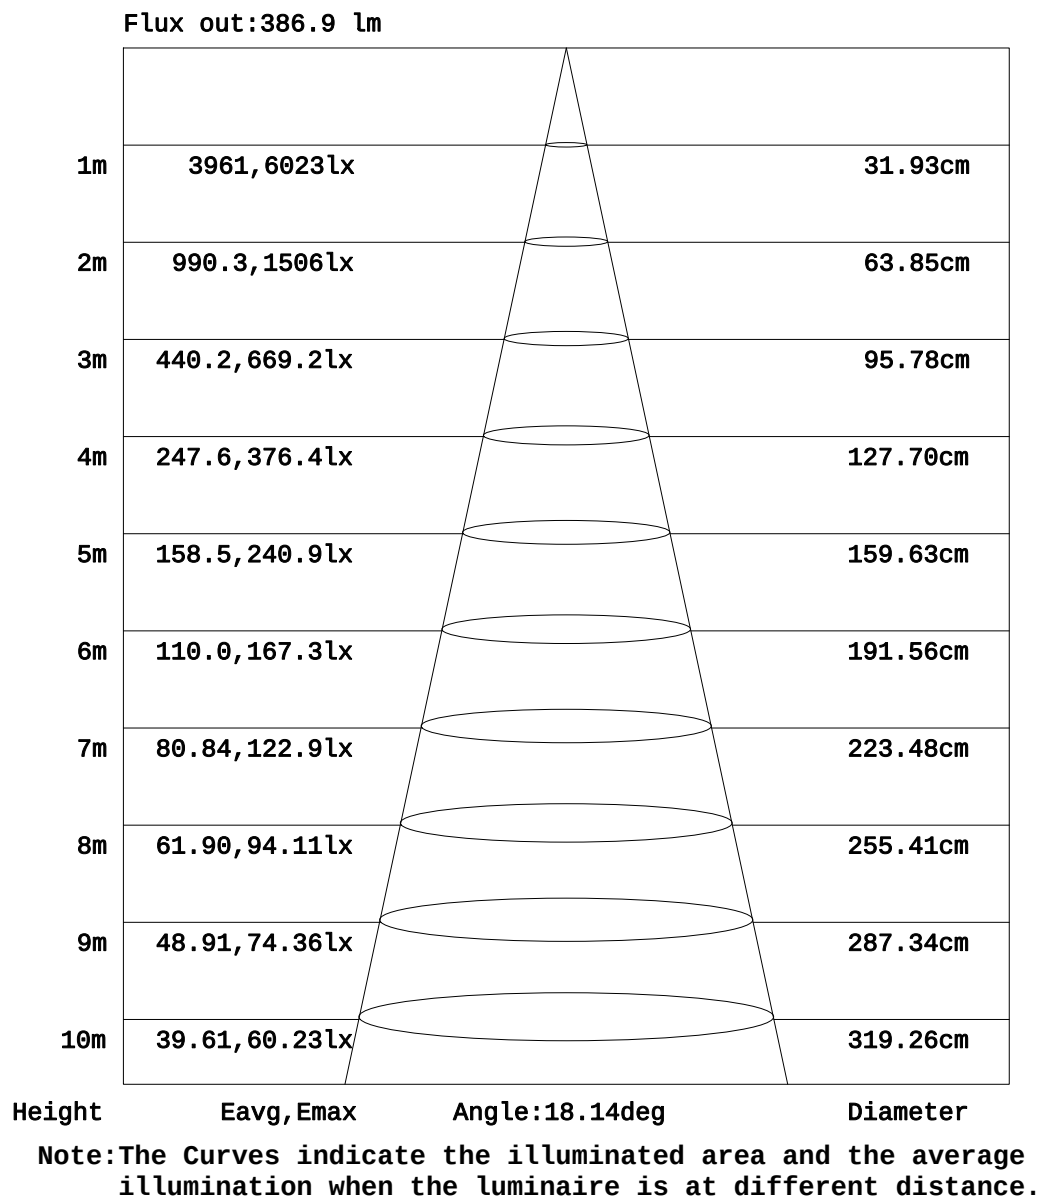

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.482m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

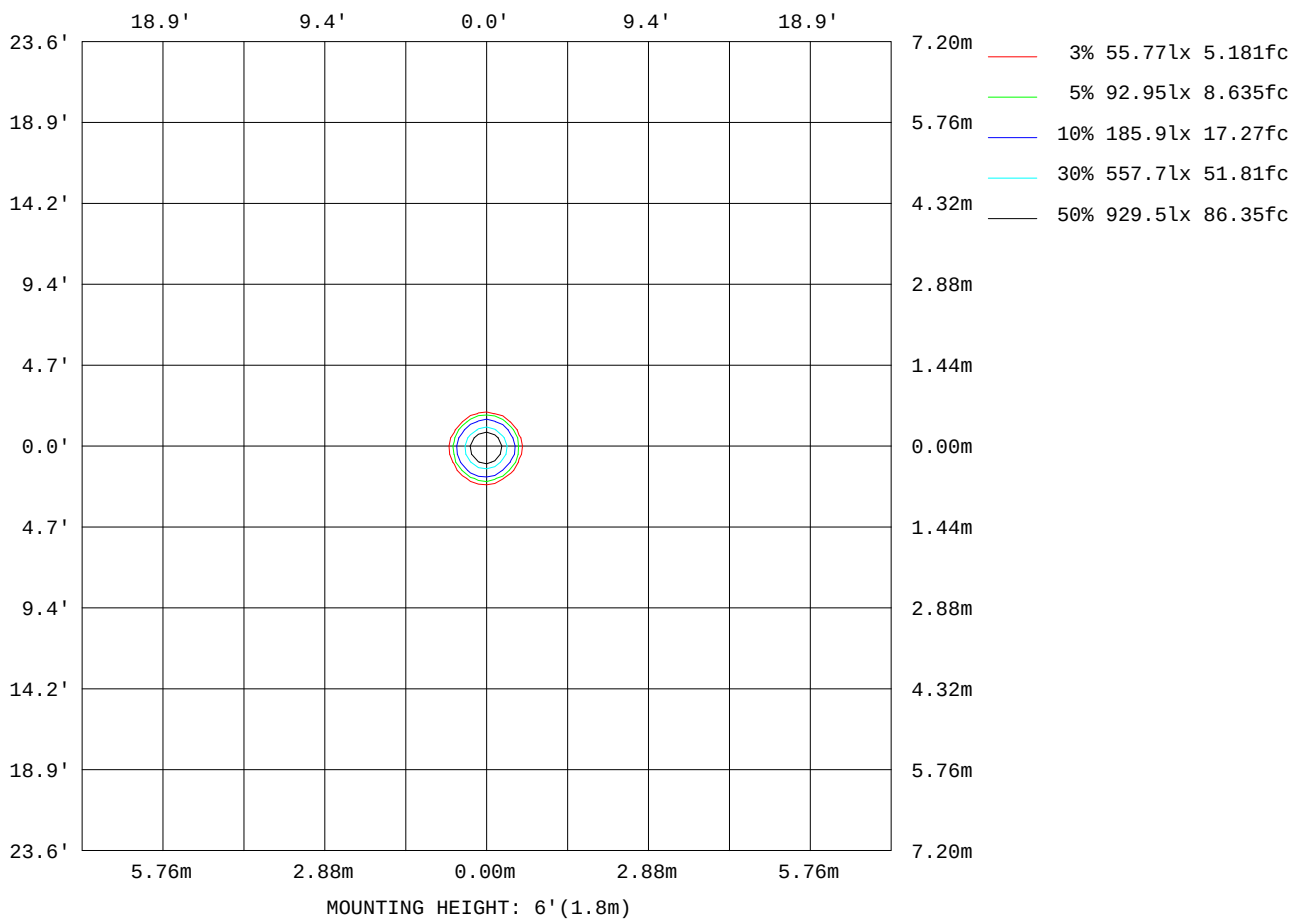

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-05-24

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.482m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.10V I:0.1083A P:11.870W PF:0.4980 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:666.717x1 Lm		
NAME: DDW31-LM13E-130BWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	58
L_0~180(75)av	129
L_0~180(85)av	12
L_90~270(65)av	53
L_90~270(75)av	94
L_90~270(85)av	12
L_45(65)av	55
L_45(75)av	98
L_45(85)av	13

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.482m [K=1.0000]
 Remarks:

Planar Illuminance Curve

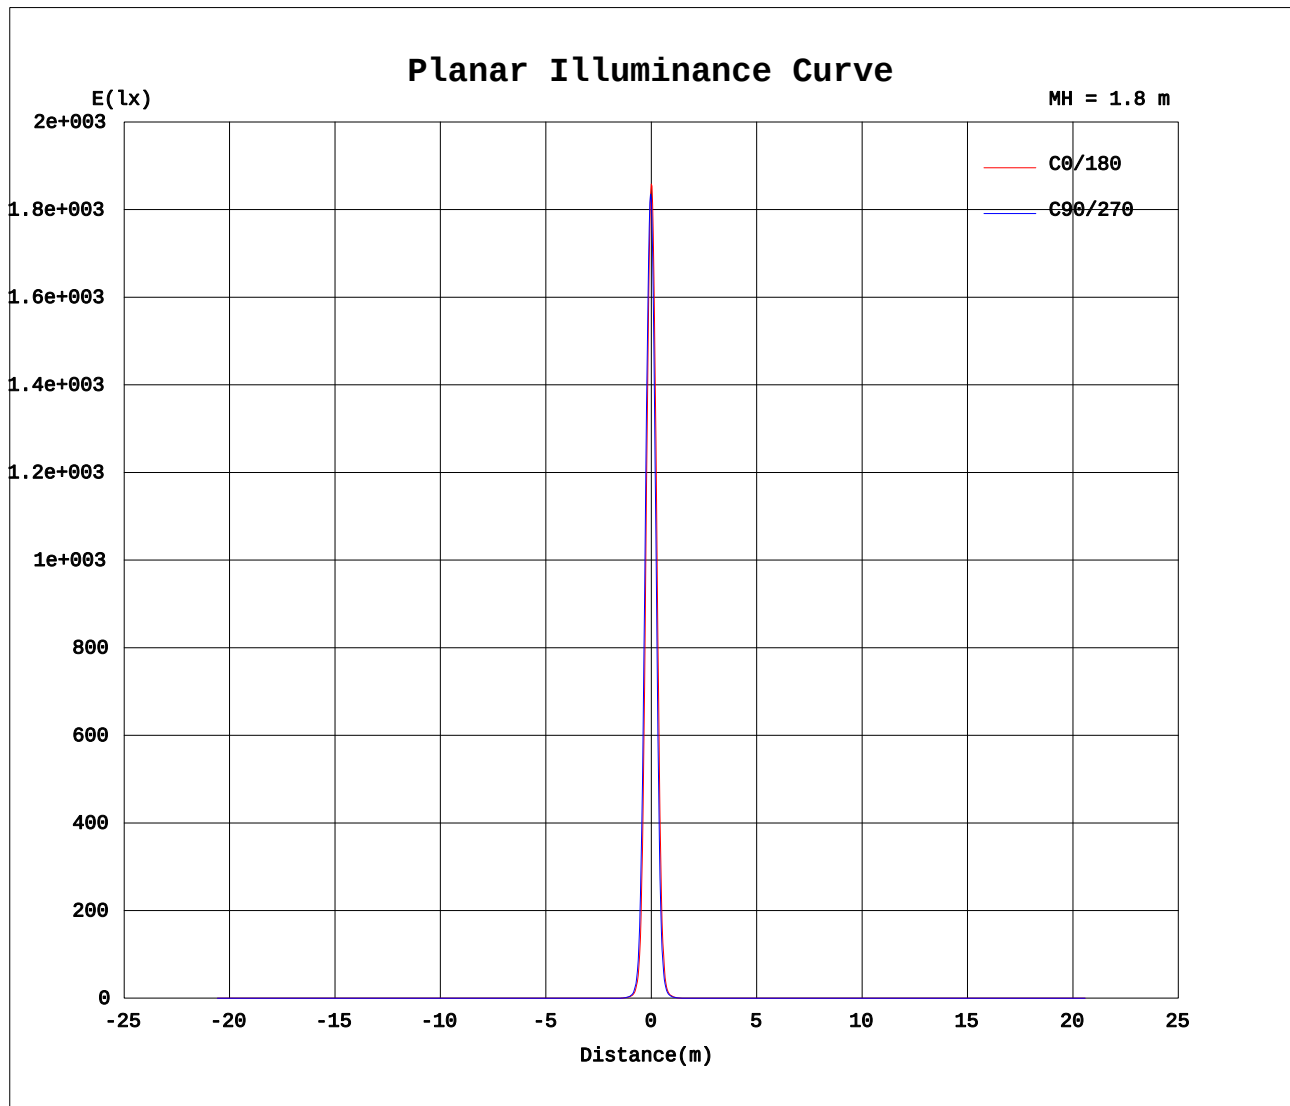

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.482m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927	5927			
5	4708	4848	4995	5127	5229	5276	5246	5148	4978	4796	4634	4510	4448	4445	4494	4582			
10	2366	2533	2728	2928	3107	3192	3155	2982	2734	2484	2261	2109	2057	2069	2147	2259			
15	666	791	880	963	1116	1178	1153	1036	839	716	613	567	548	550	578	621			
20	147	161	181	210	243	259	248	217	184	158	140	131	126	125	131	139			
25	43.1	45.6	49.2	54.6	60.6	63.4	61.1	55.0	49.3	44.0	39.6	38.1	37.5	37.8	39.5	41.2			
30	17.1	17.9	18.8	20.2	21.4	21.9	21.3	19.8	18.2	16.4	15.0	14.6	14.6	14.9	15.6	16.3			
35	6.98	7.18	7.38	7.63	7.69	7.50	7.15	6.51	5.92	5.71	5.59	5.65	5.87	6.11	6.42	6.71			
40	1.93	1.95	1.95	1.89	1.84	1.77	1.67	1.51	1.42	1.44	1.49	1.56	1.64	1.70	1.83	1.91			
45	0.51	0.53	0.53	0.51	0.48	0.44	0.42	0.41	0.42	0.43	0.45	0.46	0.47	0.46	0.47	0.48			
50	0.21	0.22	0.22	0.20	0.18	0.16	0.15	0.14	0.15	0.16	0.16	0.17	0.18	0.18	0.18	0.19			
55	0.05	0.05	0.05	0.05	0.04	0.04	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.16	0.16	0.16	0.16	0.16	0.16	0.16			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.19	0.19	0.18	0.17	0.17	0.17	0.17	0.18			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.20	0.19	0.17	0.16	0.16	0.17	0.17	0.16			
75	0.00	0.01	0.01	0.01	0.00	0.01	0.01	0.01	0.26	0.23	0.20	0.19	0.19	0.19	0.19	0.19			
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.36	0.30	0.24	0.23	0.23	0.23	0.23	0.23			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-05-24

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.482m [K=1.0000]
 Remarks: