


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.16V I:0.0750A P:7.9626W PF:0.4821 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:549.047x1 lm


NAME: DDW31-LM07E-230SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 68.95 lm/W
MODEL		Imax(cd)	2888	S/MH(C0/180)	0.41	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.41	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	549.05	η UP, DN(C0-180)	0.0, 48.3	
NOMINAL FLUX(lm)	549.047	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 51.7	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	1.00	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

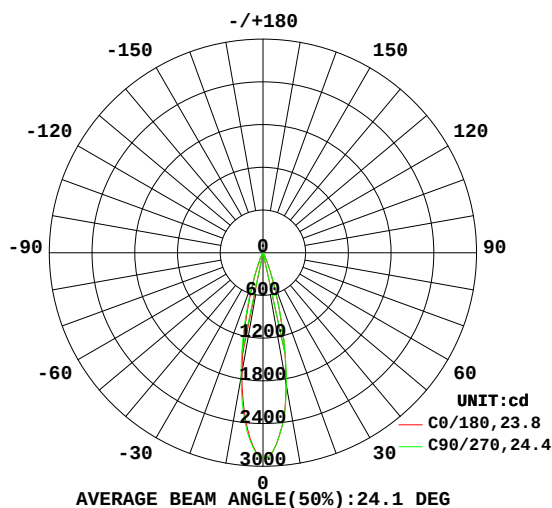

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

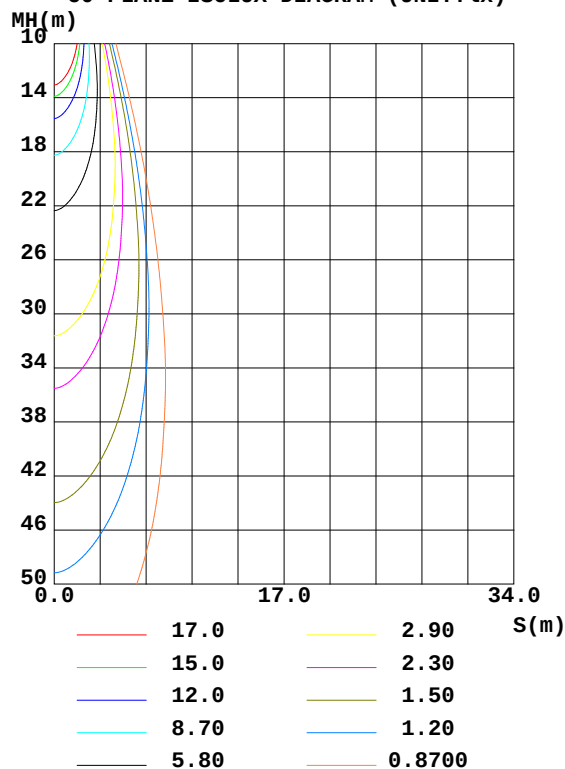

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	1707	1731	1779	1781	1875	1882	1892	1859	0- 10	220.3	220.3	40.1
20	309.8	326.0	347.8	332.6	372.5	375.9	376.5	366.6	10- 20	259.6	479.9	87.4
30	38.41	38.50	38.14	35.64	37.90	38.61	41.23	42.96	20- 30	59.50	539.4	98.2
40	2.251	1.985	1.697	1.485	1.860	1.880	2.091	2.641	30- 40	8.886	548.2	99.9
50	0.2184	0.1929	0.1642	0.1455	0.1685	0.1913	0.2128	0.2413	40- 50	0.5646	548.8	100
60	0.0084	0.0097	0.0080	0.0059	0.1321	0.1363	0.1305	0.1492	50- 60	0.0573	548.9	100
70	0.0071	0.0092	0.0080	0.0063	0.1353	0.1223	0.1420	0.1227	60- 70	0.0758	548.9	100
80	0.0055	0.0071	0.0047	0.0038	0.1597	0.1641	0.1632	0.1519	70- 80	0.0841	549.0	100
90	0	0	0	0	0	0	0	0	80- 90	0.0236	549.0	100
100	0	0	0	0	0	0	0	0	90-100	0	549.0	100
110	0	0	0	0	0	0	0	0	100-110	0	549.0	100
120	0	0	0	0	0	0	0	0	110-120	0	549.0	100
130	0	0	0	0	0	0	0	0	120-130	0	549.0	100
140	0	0	0	0	0	0	0	0	130-140	0	549.0	100
150	0	0	0	0	0	0	0	0	140-150	0	549.0	100
160	0	0	0	0	0	0	0	0	150-160	0	549.0	100
170	0	0	0	0	0	0	0	0	160-170	0	549.0	100
180	0	0	0	0	0	0	0	0	170-180	0	549.0	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 548.65 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 548.86 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

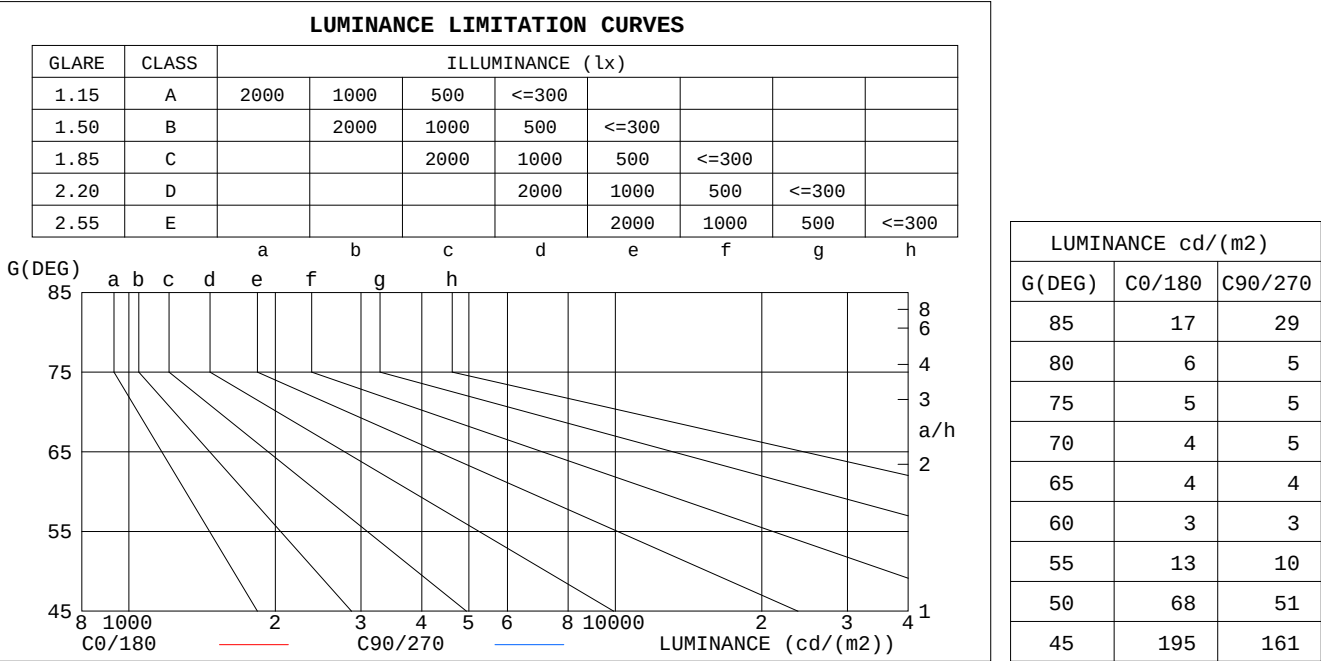


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.13	1.12	1.10	1.11	1.10	1.08	1.07	1.06	1.05	1.04	1.03	1.02	1.00	.00	.99	.97
2.0	1.08	1.06	1.03	1.07	1.04	1.02	1.04	1.02	.00	1.01	.99	.98	.98	.97	.96	.94
3.0	1.04	1.01	.98	1.03	.00	.98	1.01	.98	.96	.98	.96	.95	.96	.95	.93	.92
4.0	1.01	.97	.94	.00	.96	.94	.98	.95	.93	.96	.94	.92	.94	.92	.91	.90
5.0	.97	.94	.91	.97	.93	.90	.95	.92	.90	.94	.91	.89	.92	.90	.88	.87
6.0	.95	.91	.88	.94	.90	.88	.93	.89	.87	.91	.89	.87	.90	.88	.86	.85
7.0	.92	.88	.85	.91	.88	.85	.90	.87	.85	.89	.86	.84	.88	.86	.84	.83
8.0	.89	.86	.83	.89	.85	.83	.88	.85	.83	.87	.84	.82	.86	.84	.82	.81
9.0	.87	.83	.81	.87	.83	.81	.86	.83	.81	.85	.82	.80	.85	.82	.80	.79
10.0	.85	.81	.79	.85	.81	.79	.84	.81	.79	.83	.81	.78	.83	.80	.78	.77

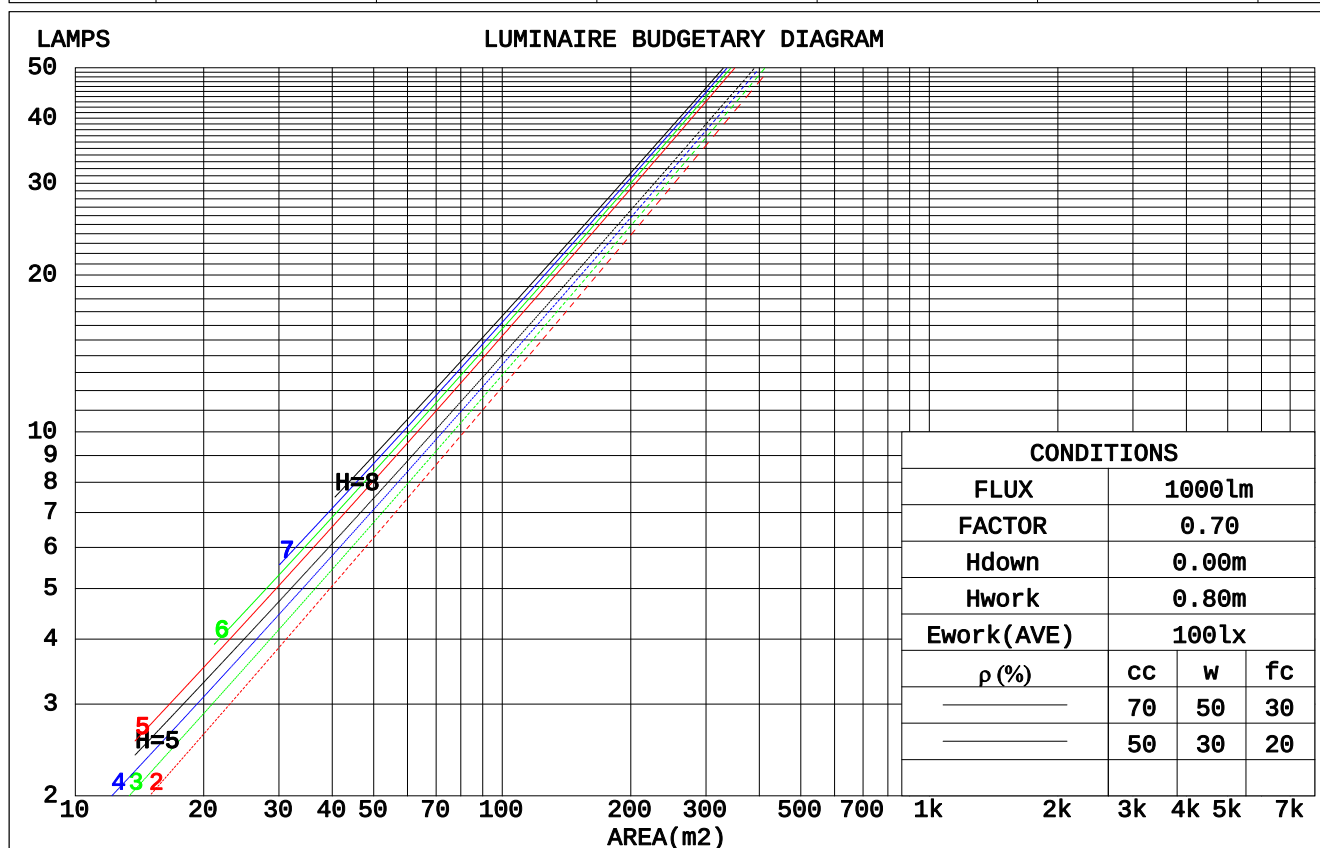

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0	
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.129	.073	.023	.123	.070	.022	.110	.063	.020	.099	.057	.018	.088	.051	.017		
2.0	.119	.065	.020	.113	.062	.019	.103	.057	.018	.094	.053	.016	.085	.048	.015		
3.0	.110	.059	.018	.106	.057	.017	.097	.053	.016	.089	.049	.015	.082	.045	.014		
4.0	.103	.053	.016	.099	.052	.015	.092	.049	.015	.085	.046	.014	.079	.043	.013		
5.0	.097	.049	.014	.093	.048	.014	.087	.045	.013	.082	.043	.013	.077	.041	.012		
6.0	.091	.046	.013	.088	.045	.013	.083	.043	.012	.078	.041	.012	.074	.039	.012		
7.0	.086	.043	.012	.084	.042	.012	.080	.040	.012	.075	.039	.011	.072	.037	.011		
8.0	.082	.040	.011	.080	.040	.011	.076	.038	.011	.073	.037	.011	.069	.036	.010		
9.0	.079	.038	.011	.077	.037	.011	.073	.036	.010	.070	.035	.010	.067	.034	.010		
10.0	.075	.036	.010	.074	.036	.010	.071	.035	.010	.068	.034	.010	.065	.033	.009		

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.168	.158	.149	.144	.135	.128	.098	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.149	.133	.119	.128	.114	.103	.088	.079	.072	.050	.046	.042	.016	.015	.014	
3.0	.134	.113	.097	.115	.098	.084	.079	.068	.059	.045	.040	.035	.015	.013	.011	
4.0	.121	.098	.080	.104	.084	.070	.071	.059	.049	.041	.034	.029	.013	.011	.010	
5.0	.110	.085	.067	.094	.074	.058	.065	.052	.041	.038	.030	.024	.012	.010	.008	
6.0	.101	.075	.057	.087	.065	.049	.060	.046	.035	.035	.027	.021	.011	.009	.007	
7.0	.093	.067	.049	.080	.058	.042	.055	.041	.030	.032	.024	.018	.010	.008	.006	
8.0	.086	.060	.042	.074	.052	.037	.051	.037	.026	.030	.022	.015	.010	.007	.005	
9.0	.081	.054	.036	.069	.047	.032	.048	.033	.023	.028	.020	.013	.009	.006	.004	
10.0	.076	.049	.032	.065	.043	.028	.045	.030	.020	.026	.018	.012	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	-1.1	-0.5	-0.9	-0.3	-0.2	-1.6	-1.0	-1.4	-0.8	-0.7
3H	-1.2	-0.7	-1.0	-0.5	-0.3	-1.7	-1.1	-1.5	-1.0	-0.8
4H	-1.3	-0.8	-1.0	-0.6	-0.4	-1.8	-1.2	-1.5	-1.0	-0.8
6H	-1.4	-0.9	-1.1	-0.6	-0.4	-1.9	-1.4	-1.6	-1.1	-0.9
8H	-1.4	-0.9	-1.1	-0.7	-0.4	-1.9	-1.4	-1.6	-1.2	-0.9
12H	-1.5	-1.0	-1.2	-0.7	-0.5	-2.0	-1.5	-1.6	-1.2	-1.0
4H 2H	-1.3	-0.8	-1.0	-0.6	-0.4	-1.8	-1.2	-1.5	-1.0	-0.8
3H	-1.5	-1.0	-1.2	-0.7	-0.5	-2.0	-1.5	-1.7	-1.2	-1.0
4H	-1.6	-1.1	-1.2	-0.8	-0.5	-2.0	-1.6	-1.7	-1.3	-1.0
6H	-1.7	-1.3	-1.3	-1.0	-0.6	-2.2	-1.8	-1.8	-1.4	-1.1
8H	-1.7	-1.4	-1.3	-1.0	-0.7	-2.2	-1.8	-1.8	-1.5	-1.1
12H	-1.8	-1.5	-1.4	-1.1	-0.7	-2.3	-1.9	-1.9	-1.6	-1.2
8H 4H	-1.7	-1.4	-1.3	-1.0	-0.7	-2.2	-1.8	-1.8	-1.5	-1.1
6H	-1.8	-1.5	-1.4	-1.2	-0.7	-2.3	-2.0	-1.9	-1.6	-1.2
8H	-1.9	-1.6	-1.5	-1.2	-0.8	-2.4	-2.1	-1.9	-1.7	-1.3
12H	-2.0	-1.7	-1.5	-1.3	-0.8	-2.5	-2.2	-2.0	-1.8	-1.3
12H 4H	-1.8	-1.5	-1.4	-1.1	-0.7	-2.3	-1.9	-1.9	-1.6	-1.2
6H	-1.9	-1.6	-1.5	-1.2	-0.8	-2.4	-2.1	-1.9	-1.7	-1.3
8H	-2.0	-1.7	-1.5	-1.3	-0.8	-2.5	-2.2	-2.0	-1.8	-1.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.3 / -22.0					+ 4.9 / -20.3				
1.5H	+ 8.0 / -20.5					+ 7.5 / -18.9				
2.0H	+ 7.6 / -11.0					+ 7.3 / -10.3				

CIE Pub.117, 549.0 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.1$)
Area: 0.005 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	92	86	83	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	90	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	105	100	98	103	99	97	93
1.50	108	104	101	107	103	100	105	102	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

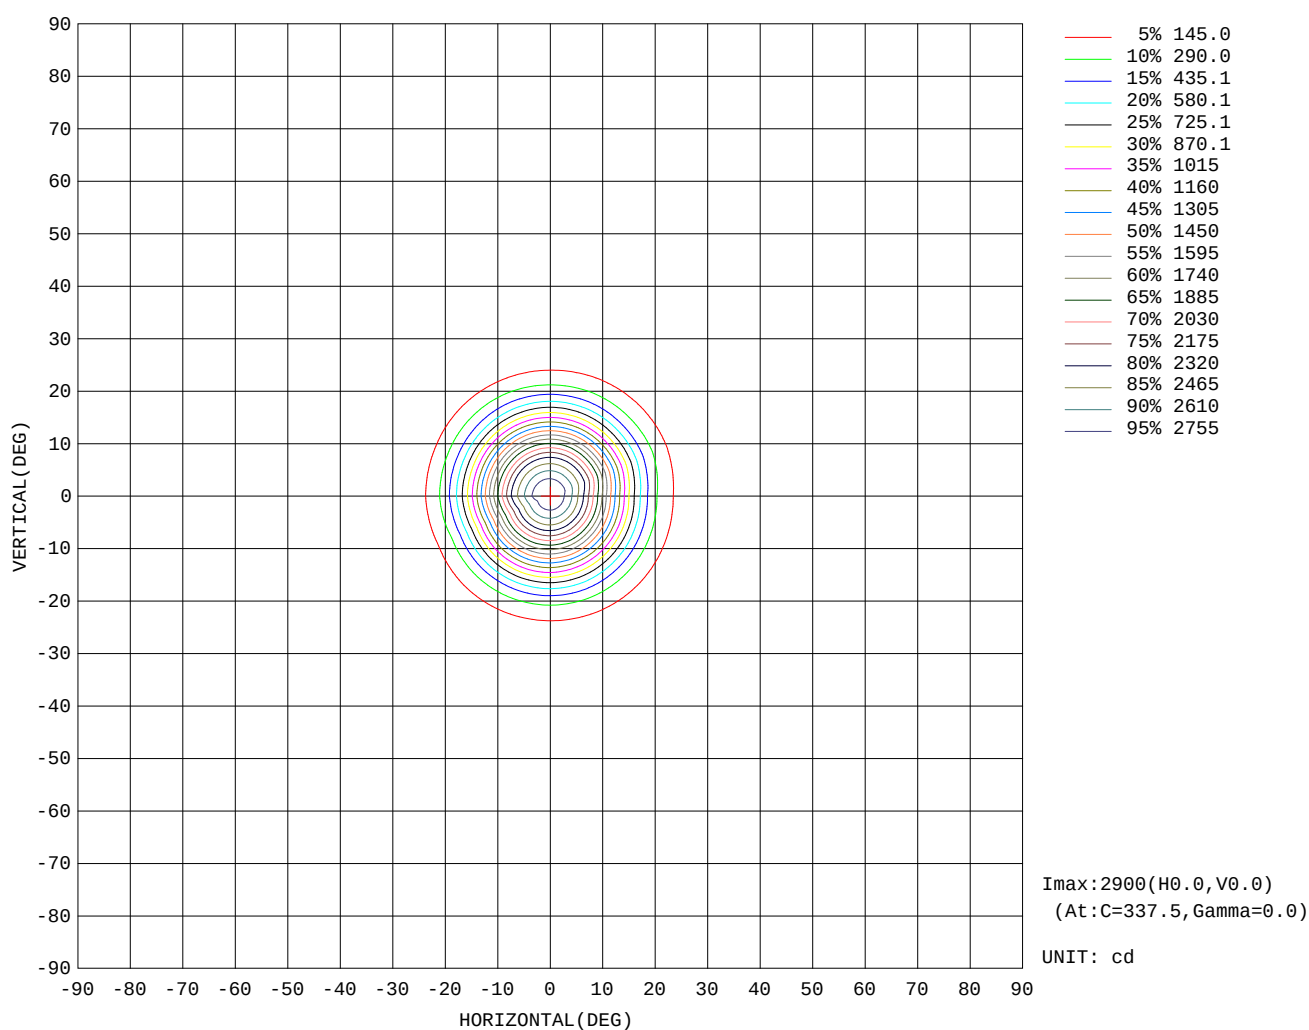

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

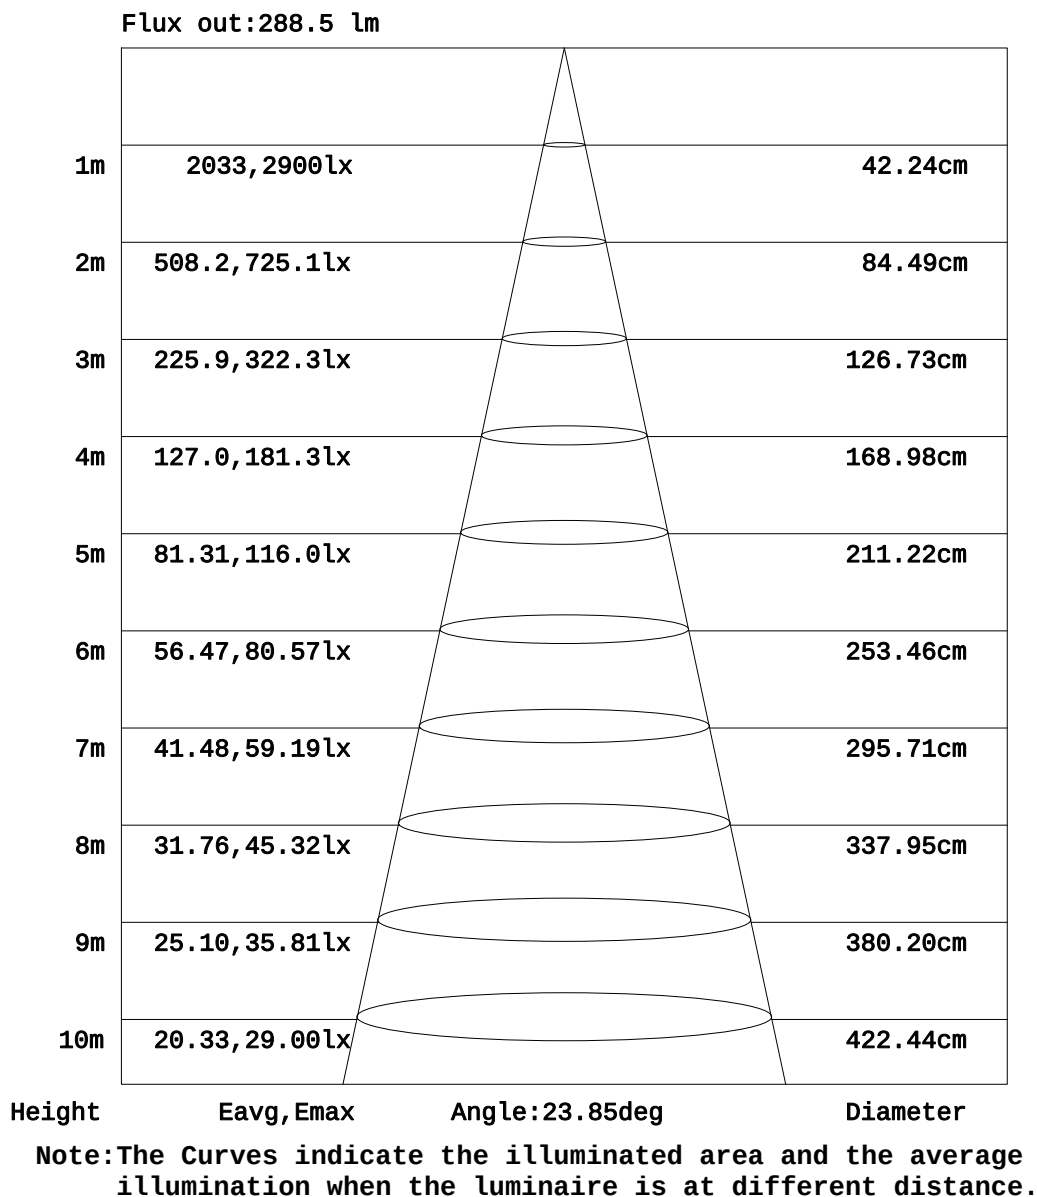

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

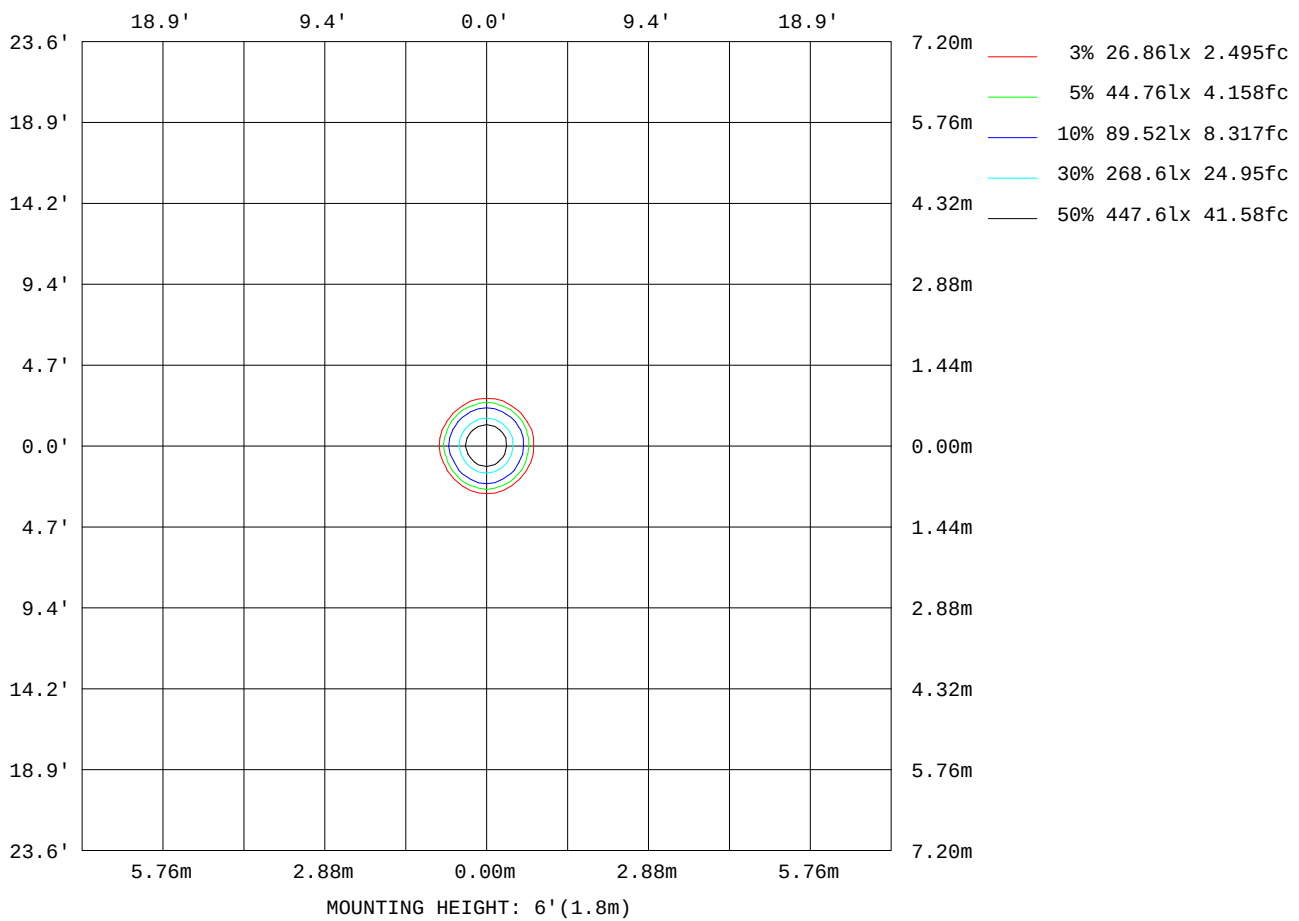

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.16V I:0.0750A P:7.9626W PF:0.4821 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:549.047x1 Lm		
NAME: DDW31-LM07E-230SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	46
L_0~180(75)av	62
L_0~180(85)av	12
L_90~270(65)av	40
L_90~270(75)av	57
L_90~270(85)av	19
L_45(65)av	43
L_45(75)av	61
L_45(85)av	11

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

Planar Illuminance Curve

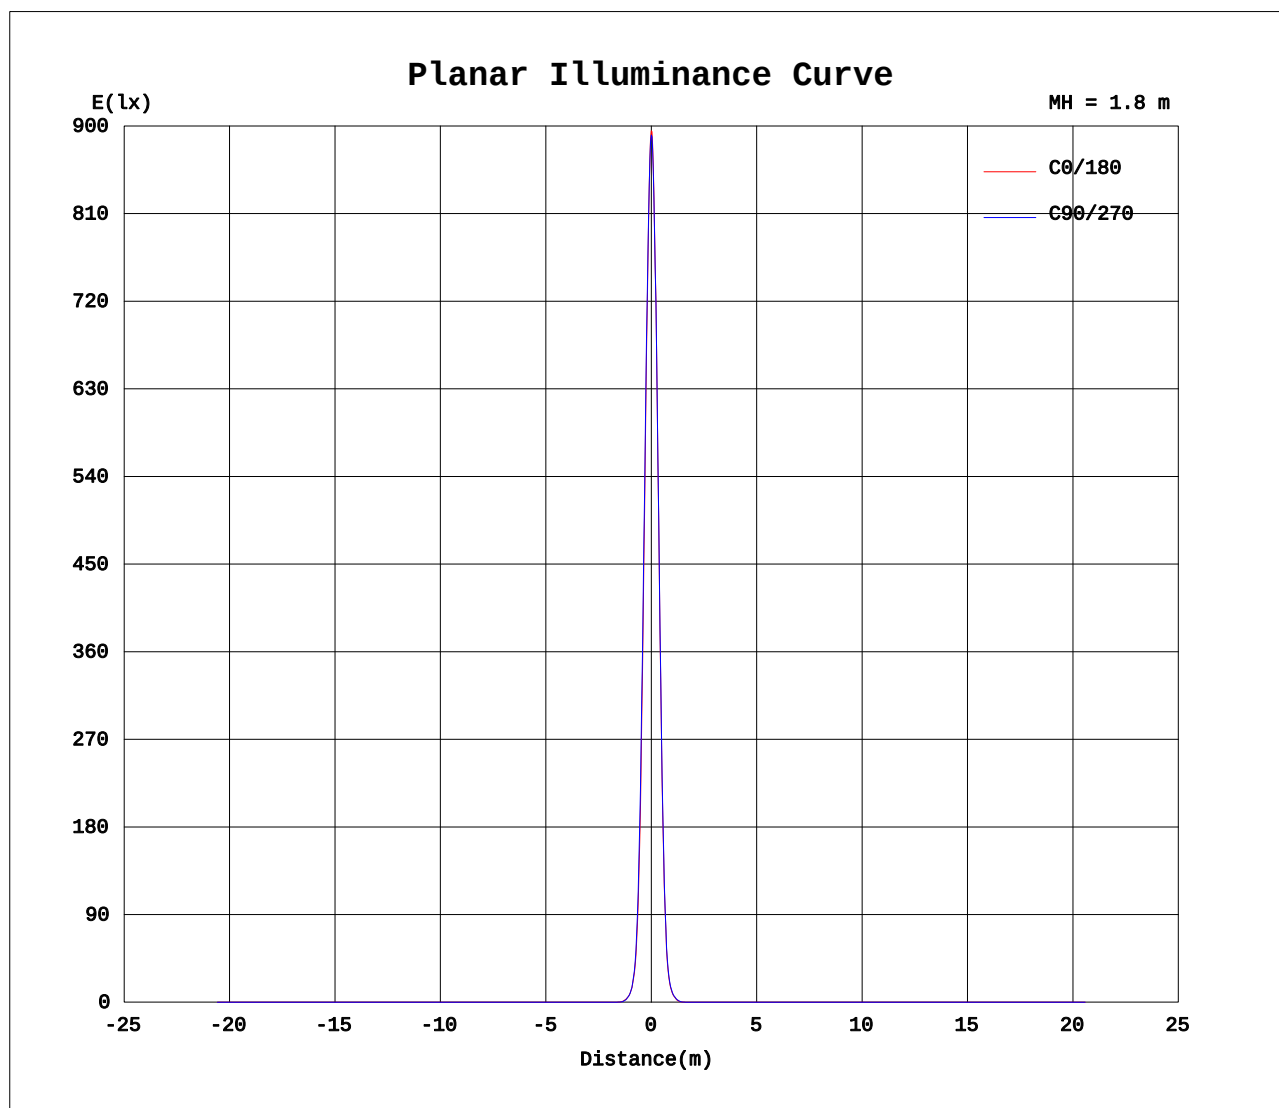

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888	2888			
5	2490	2491	2502	2518	2531	2539	2540	2532	2591	2584	2592	2593	2593	2586	2573	2567			
10	1707	1715	1731	1758	1779	1789	1781	1758	1875	1868	1882	1887	1892	1881	1859	1847			
15	864	878	898	924	950	952	940	903	987	981	996	1006	1012	1002	982	971			
20	310	316	326	340	348	343	333	314	372	368	376	385	377	375	367	377			
25	107	109	111	114	115	112	107	98.7	108	106	109	112	115	117	117	117			
30	38.4	38.4	38.5	38.7	38.1	37.2	35.6	33.8	37.9	37.6	38.6	39.7	41.2	42.4	43.0	43.5			
35	12.7	13.0	12.3	11.8	11.2	9.96	9.34	9.24	10.5	10.7	11.5	12.3	13.0	13.8	14.5	15.1			
40	2.25	2.14	1.98	1.83	1.70	1.57	1.49	1.52	1.86	1.81	1.88	1.97	2.09	2.34	2.64	2.84			
45	0.69	0.67	0.64	0.61	0.57	0.54	0.51	0.50	0.56	0.58	0.60	0.62	0.65	0.68	0.71	0.75			
50	0.22	0.21	0.19	0.18	0.16	0.15	0.15	0.14	0.17	0.18	0.19	0.20	0.21	0.23	0.24	0.26			
55	0.04	0.04	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.04	0.04			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.13	0.13	0.14	0.13	0.13	0.14	0.15	0.15			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.19	0.20	0.18	0.16	0.16	0.17	0.17	0.17			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.14	0.13	0.12	0.13	0.14	0.14	0.12	0.12			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.01	0.16	0.16	0.15	0.14	0.14	0.15	0.15	0.15			
80	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.01	0.16	0.16	0.16	0.16	0.16	0.15	0.15	0.16			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: