


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.15V I:0.0753A P:7.9960W PF:0.4821 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:566.071x1 lm


NAME: DDW31-LM07E-330SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 70.79 lm/W
MODEL		Imax(cd)	1674	S/MH(C0/180)	0.56	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.55	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	566.07	η UP, DN(C0-180)	0.0, 48.3	
NOMINAL FLUX(lm)	566.071	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 51.7	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

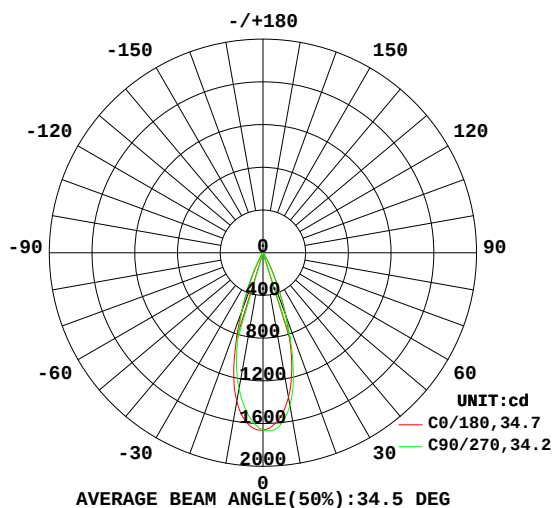

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

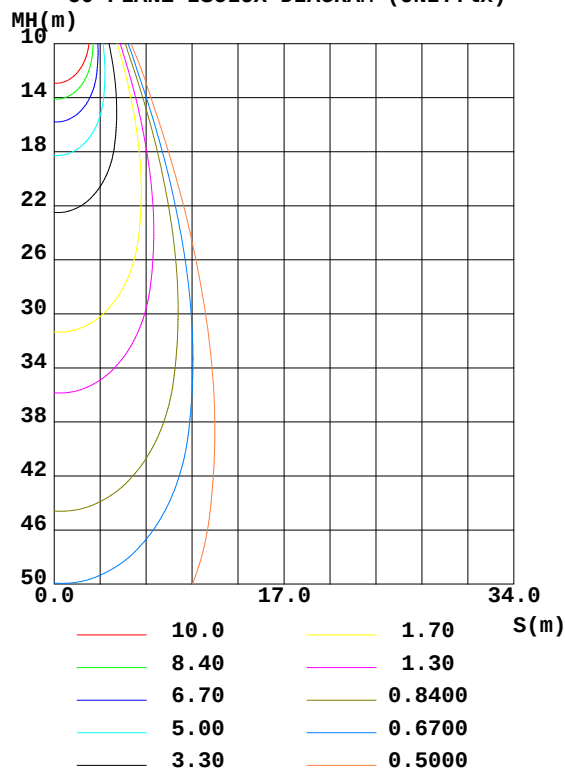

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	1414	1332	1294	1314	1375	1407	1454	1489	0- 10	145.3	145.3	25.7
20	585.1	585.4	580.3	576.1	627.3	623.5	624.8	631.3	10- 20	276.7	422.0	74.5
30	64.41	82.07	95.19	94.20	93.35	83.94	79.49	75.15	20- 30	126.9	548.9	97
40	2.970	3.493	3.826	3.562	3.847	3.406	3.273	3.180	30- 40	16.21	565.1	99.8
50	0.1914	0.2123	0.2263	0.2194	0.2273	0.2072	0.1950	0.1993	40- 50	0.7140	565.8	100
60	0.0084	0.0093	0.0084	0.0089	0.1266	0.1464	0.1557	0.1536	50- 60	0.0632	565.9	100
70	0.0084	0.0080	0.0080	0.0080	0.1303	0.1260	0.1355	0.1454	60- 70	0.0753	566.0	100
80	0.0071	0.0059	0.0063	0.0051	0.1459	0.1615	0.1566	0.1669	70- 80	0.0824	566.0	100
90	0	0	0	0	0	0	0	0	80- 90	0.0230	566.1	100
100	0	0	0	0	0	0	0	0	90-100	0	566.1	100
110	0	0	0	0	0	0	0	0	100-110	0	566.1	100
120	0	0	0	0	0	0	0	0	110-120	0	566.1	100
130	0	0	0	0	0	0	0	0	120-130	0	566.1	100
140	0	0	0	0	0	0	0	0	130-140	0	566.1	100
150	0	0	0	0	0	0	0	0	140-150	0	566.1	100
160	0	0	0	0	0	0	0	0	150-160	0	566.1	100
170	0	0	0	0	0	0	0	0	160-170	0	566.1	100
180	0	0	0	0	0	0	0	0	170-180	0	566.1	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 565.66 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 565.89 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

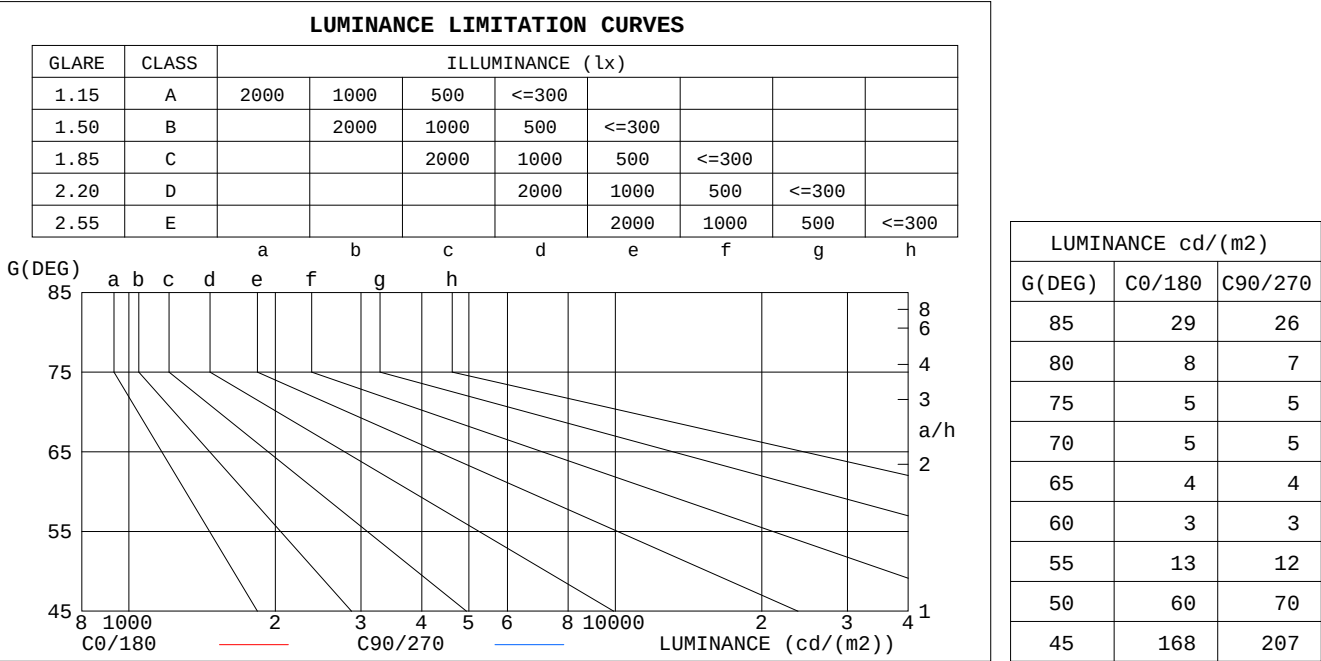


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.13	1.11	1.09	1.10	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.01	1.05	1.03	1.00	1.02	1.00	.98	.99	.98	.96	.97	.95	.94	.93
3.0	1.02	.98	.95	1.01	.97	.95	.98	.96	.93	.96	.94	.92	.94	.92	.90	.89
4.0	.98	.94	.91	.97	.93	.90	.95	.92	.89	.93	.90	.88	.91	.89	.87	.86
5.0	.94	.90	.86	.93	.89	.86	.91	.88	.85	.90	.87	.85	.88	.86	.84	.83
6.0	.90	.86	.83	.90	.85	.82	.88	.85	.82	.87	.84	.81	.86	.83	.81	.80
7.0	.87	.83	.79	.86	.82	.79	.85	.82	.79	.84	.81	.78	.83	.80	.78	.77
8.0	.84	.80	.76	.83	.79	.76	.82	.79	.76	.82	.78	.76	.81	.78	.75	.74
9.0	.81	.77	.74	.81	.76	.74	.80	.76	.73	.79	.76	.73	.78	.75	.73	.72
10.0	.78	.74	.71	.78	.74	.71	.77	.74	.71	.77	.73	.71	.76	.73	.71	.70

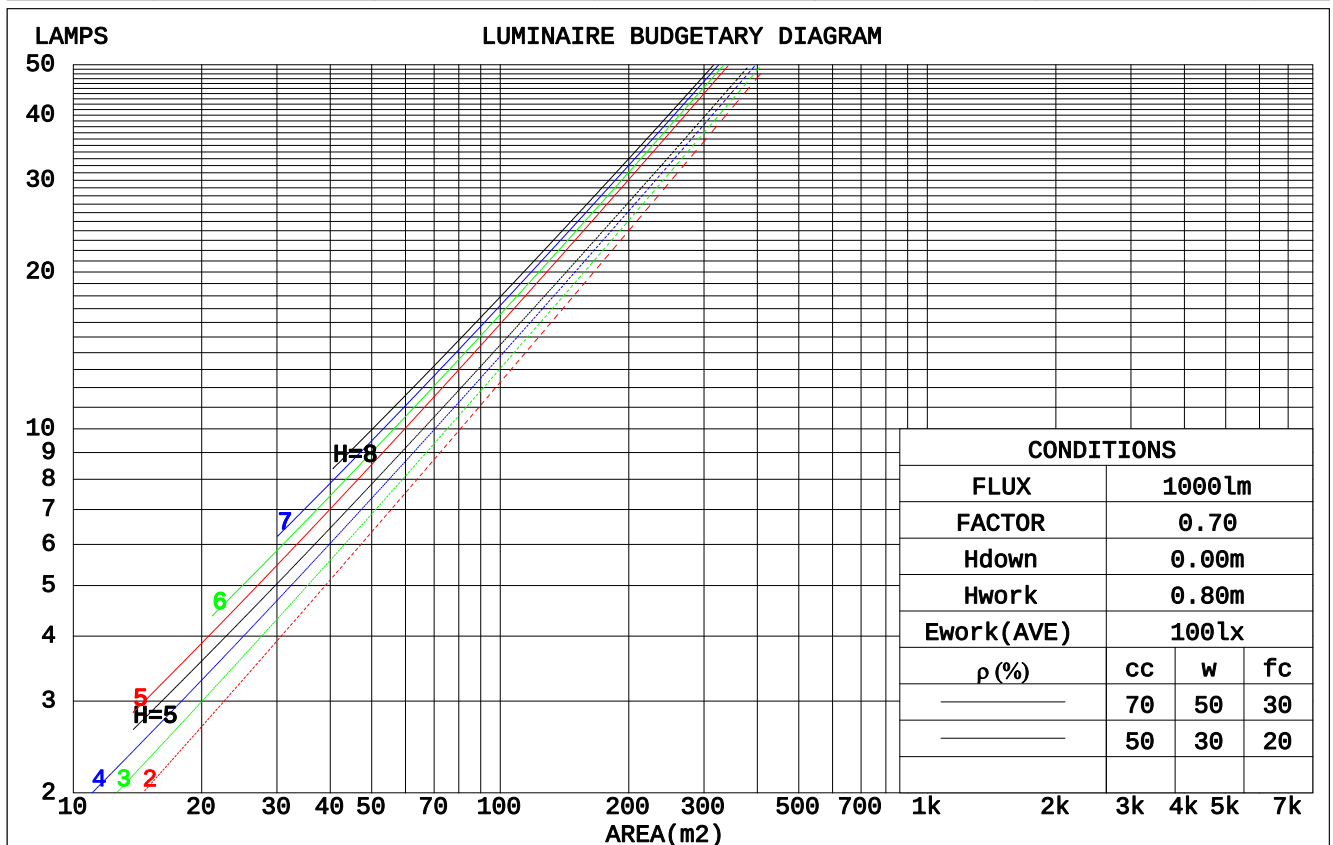

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0	
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.142	.081	.026	.135	.077	.025	.123	.071	.023	.112	.064	.021	.101	.059	.019		
2.0	.132	.072	.022	.127	.070	.021	.116	.065	.020	.107	.060	.019	.098	.056	.018		
3.0	.124	.066	.020	.119	.064	.019	.111	.060	.018	.103	.056	.017	.095	.053	.016		
4.0	.116	.061	.018	.113	.059	.017	.105	.056	.017	.099	.053	.016	.092	.050	.015		
5.0	.110	.056	.016	.107	.055	.016	.101	.052	.015	.095	.050	.015	.090	.048	.014		
6.0	.105	.053	.015	.102	.051	.015	.097	.049	.014	.092	.048	.014	.087	.046	.014		
7.0	.100	.049	.014	.097	.049	.014	.093	.047	.014	.088	.045	.013	.084	.044	.013		
8.0	.096	.047	.013	.093	.046	.013	.089	.045	.013	.085	.043	.012	.082	.042	.012		
9.0	.092	.044	.012	.090	.044	.012	.086	.043	.012	.083	.041	.012	.079	.040	.012		
10.0	.088	.042	.012	.086	.042	.012	.083	.041	.011	.080	.040	.011	.077	.039	.011		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.148	.144	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.151	.133	.117	.129	.114	.101	.089	.079	.071	.051	.046	.041	.016	.015	.014	
3.0	.136	.113	.095	.117	.098	.082	.080	.068	.058	.046	.040	.034	.015	.013	.011	
4.0	.124	.098	.078	.107	.085	.068	.073	.059	.048	.042	.035	.028	.014	.011	.009	
5.0	.114	.086	.065	.098	.074	.057	.067	.052	.040	.039	.030	.024	.013	.010	.008	
6.0	.105	.076	.055	.091	.066	.048	.062	.046	.034	.036	.027	.020	.012	.009	.007	
7.0	.098	.068	.047	.084	.059	.041	.058	.041	.029	.034	.024	.017	.011	.008	.006	
8.0	.092	.061	.040	.079	.053	.035	.055	.037	.025	.032	.022	.015	.010	.007	.005	
9.0	.086	.056	.035	.074	.048	.030	.052	.034	.022	.030	.020	.013	.010	.007	.004	
10.0	.082	.051	.031	.070	.044	.027	.049	.031	.019	.028	.018	.011	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	1.2	1.9	1.4	2.0	2.2	3.0	3.7	3.2	3.8	4.0
3H	1.0	1.7	1.3	1.9	2.1	2.8	3.5	3.1	3.6	3.8
4H	1.0	1.6	1.2	1.8	2.0	2.7	3.3	3.0	3.6	3.8
6H	0.9	1.5	1.2	1.7	1.9	2.6	3.2	2.9	3.5	3.7
8H	0.8	1.4	1.1	1.6	1.9	2.6	3.2	2.9	3.4	3.7
12H	0.8	1.3	1.1	1.6	1.9	2.6	3.1	2.9	3.4	3.6
4H 2H	1.0	1.6	1.2	1.8	2.0	2.7	3.3	3.0	3.6	3.8
3H	0.8	1.3	1.1	1.6	1.9	2.6	3.1	2.9	3.4	3.6
4H	0.7	1.2	1.0	1.5	1.8	2.5	2.9	2.8	3.2	3.5
6H	0.6	1.0	1.0	1.4	1.7	2.4	2.8	2.7	3.1	3.5
8H	0.5	0.9	0.9	1.3	1.7	2.3	2.7	2.7	3.1	3.4
12H	0.5	0.9	0.9	1.2	1.6	2.3	2.6	2.7	3.0	3.4
8H 4H	0.5	0.9	0.9	1.3	1.7	2.3	2.7	2.7	3.1	3.4
6H	0.4	0.8	0.9	1.2	1.6	2.2	2.5	2.6	2.9	3.3
8H	0.4	0.7	0.8	1.1	1.5	2.1	2.4	2.6	2.8	3.3
12H	0.3	0.6	0.8	1.0	1.5	2.1	2.3	2.5	2.8	3.2
12H 4H	0.5	0.9	0.9	1.2	1.6	2.3	2.6	2.7	3.0	3.4
6H	0.4	0.7	0.8	1.1	1.5	2.1	2.4	2.6	2.8	3.3
8H	0.3	0.6	0.8	1.0	1.5	2.1	2.3	2.5	2.8	3.2
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.0 / -24.1					+ 5.4 / -25.0				
1.5H	+ 7.8 / -22.7					+ 8.1 / -23.6				
2.0H	+ 7.2 / - 9.6					+ 7.5 / -10.2				

CIE Pub.117, 566.1 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.0$)
Area: 0.005 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	92	86	83	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	89	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	105	102	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

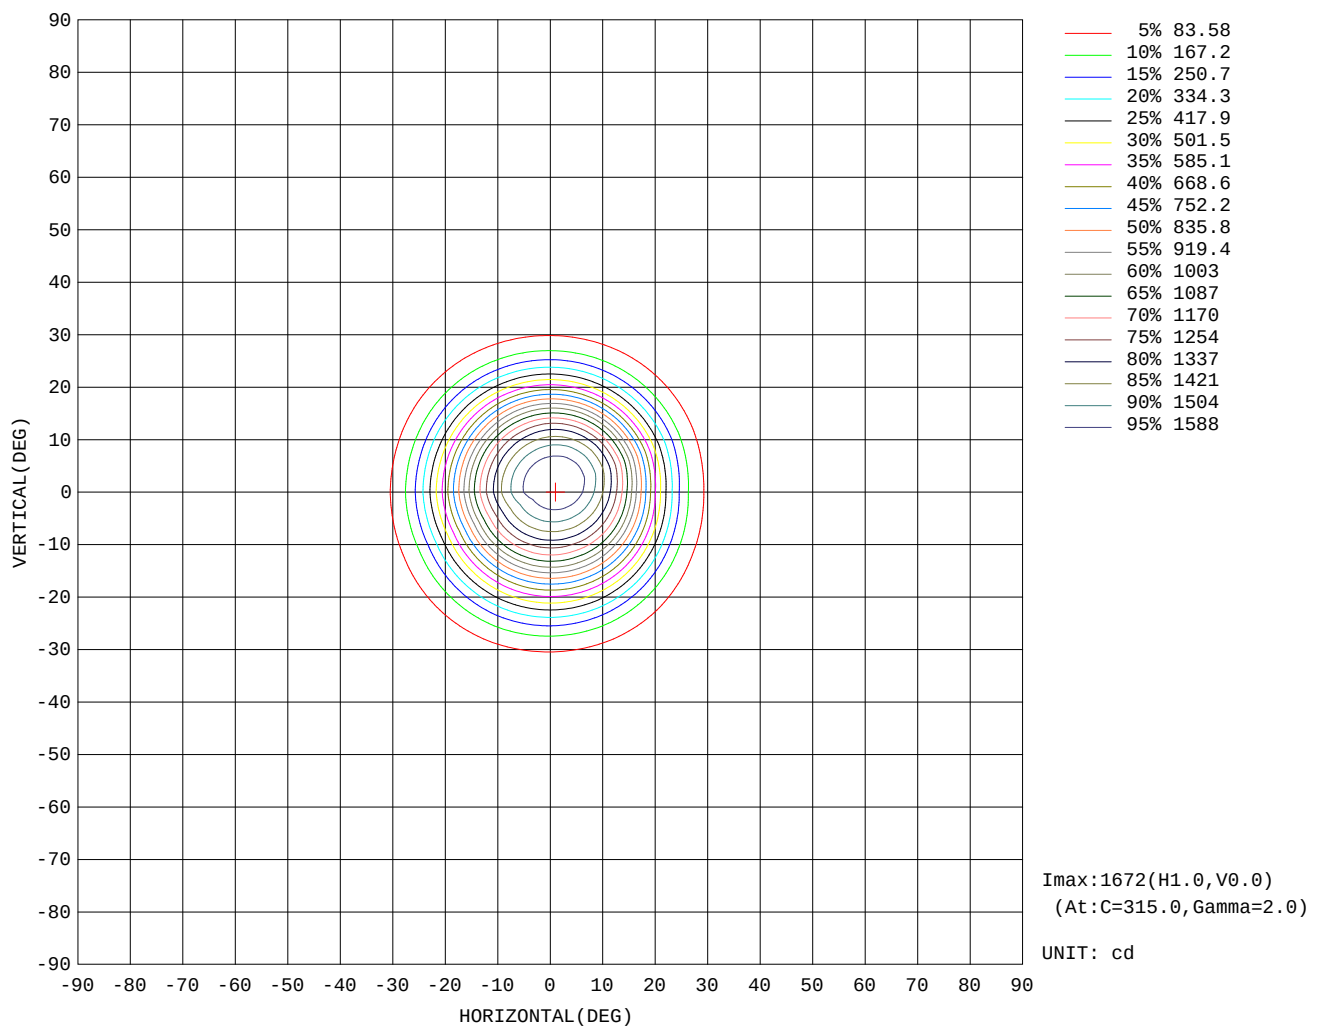

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

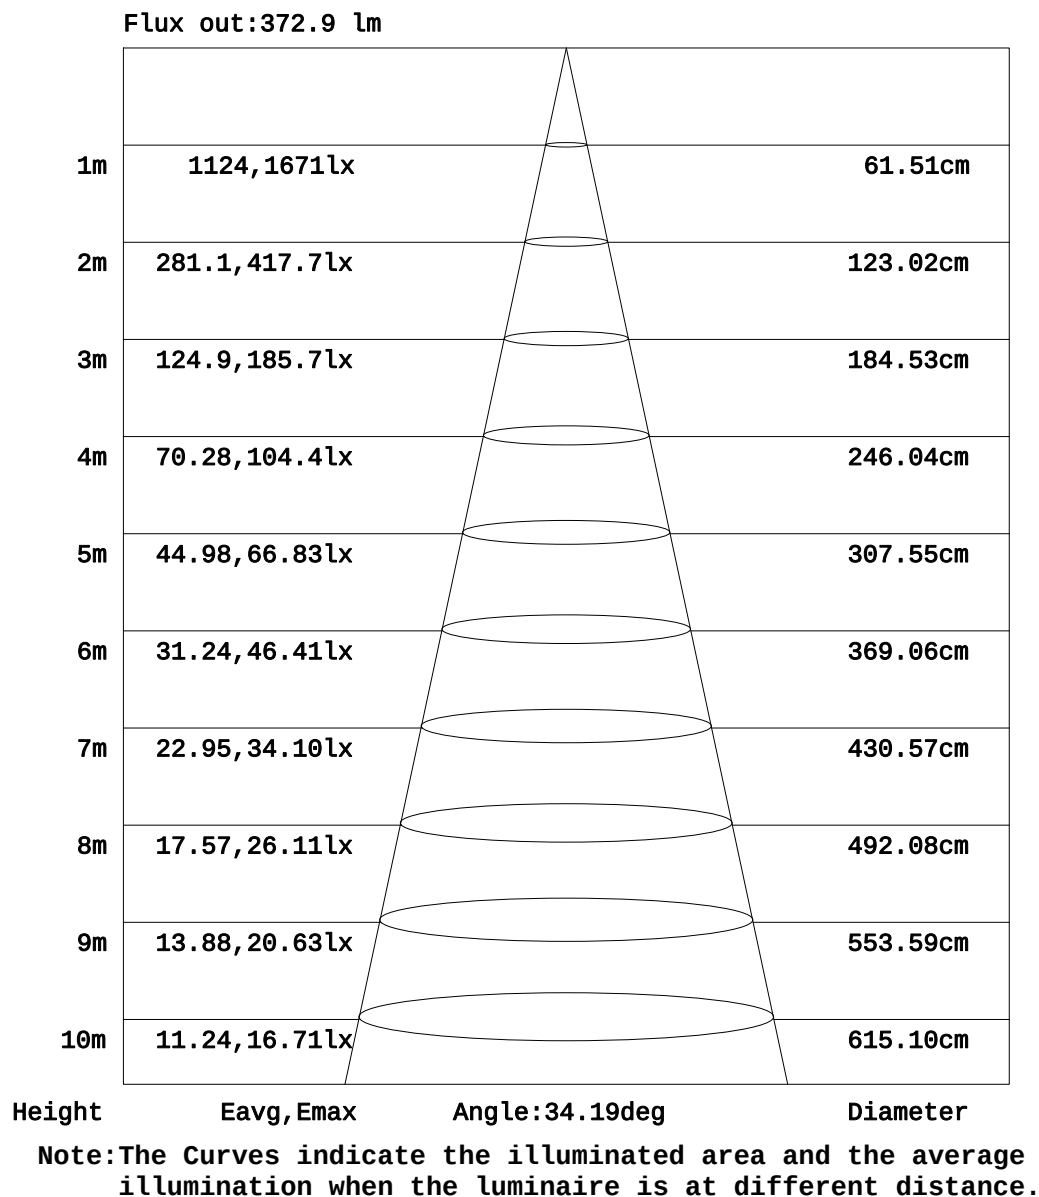

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

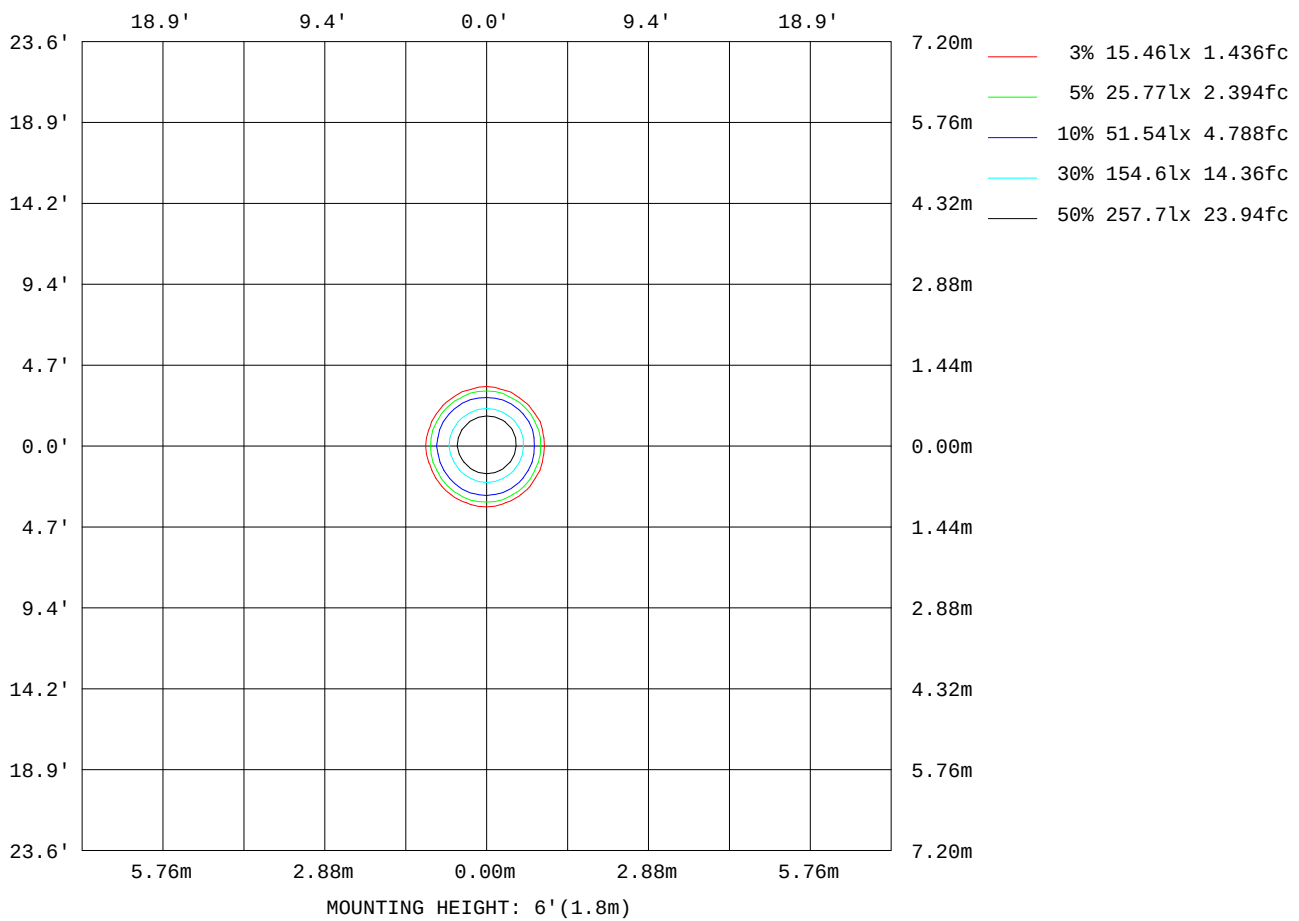

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.15V I:0.0753A P:7.9960W PF:0.4821 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:566.071X1 Lm		
NAME: DDW31-LM07E-330SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	41
L_0~180(75)av	58
L_0~180(85)av	18
L_90~270(65)av	38
L_90~270(75)av	60
L_90~270(85)av	17
L_45(65)av	42
L_45(75)av	59
L_45(85)av	13

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

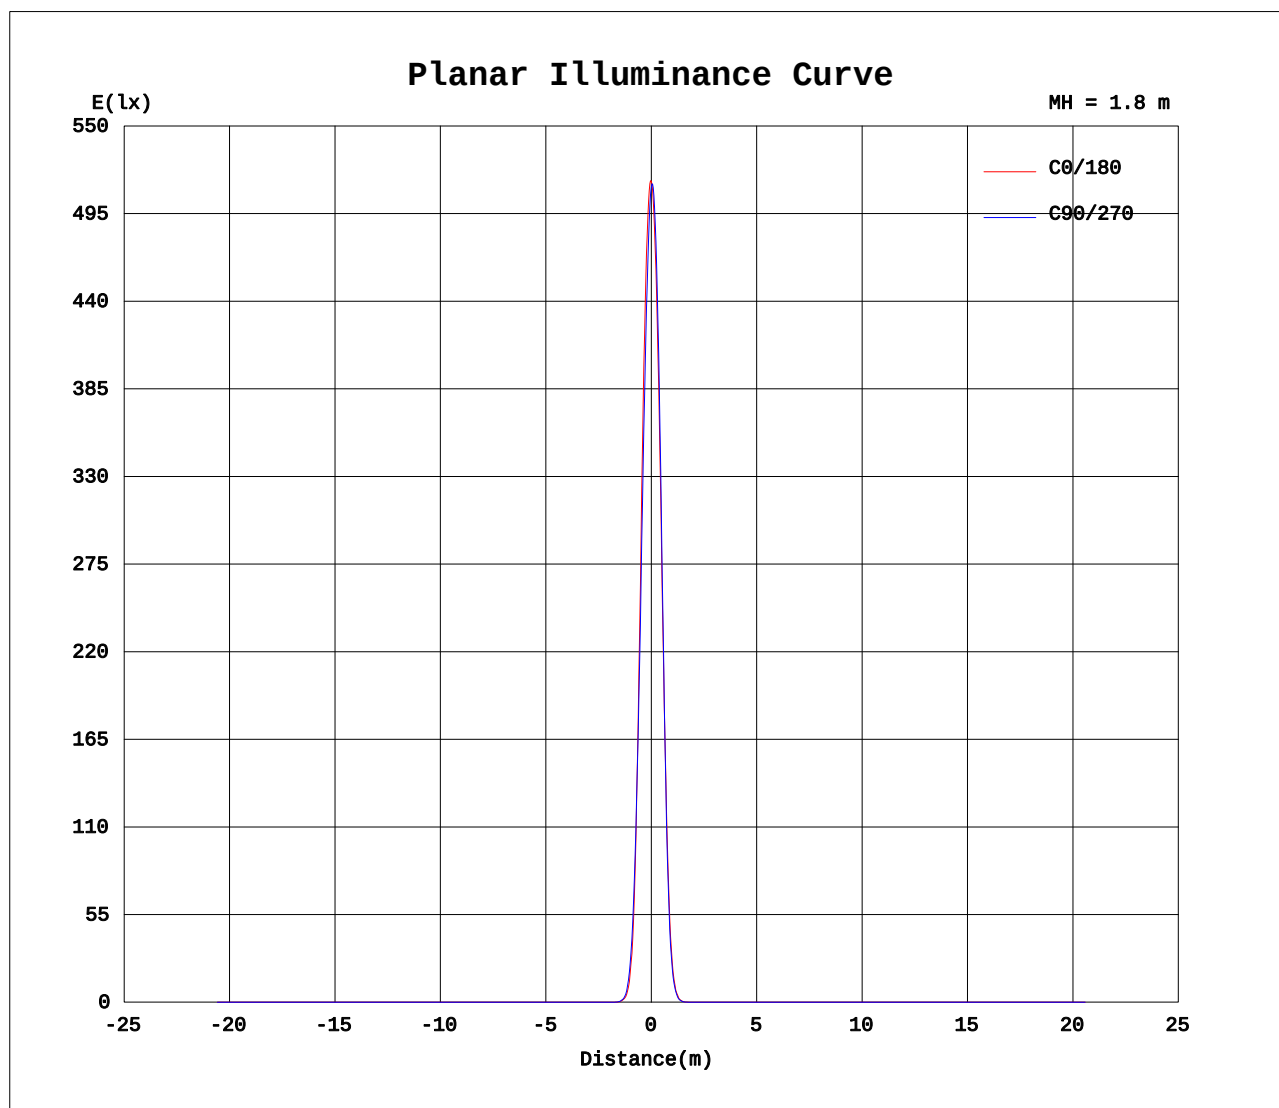

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660	1660			
5	1610	1584	1560	1543	1533	1534	1542	1554	1582	1594	1609	1626	1638	1649	1651	1644			
10	1414	1369	1332	1303	1294	1297	1314	1333	1375	1388	1407	1429	1454	1477	1489	1479			
15	1043	1012	985	961	952	955	967	981	1037	1046	1058	1072	1093	1115	1129	1122			
20	585	586	585	582	580	578	576	583	627	626	623	622	625	627	631	633			
25	225	237	253	267	276	276	267	264	290	284	275	267	264	261	258	259			
30	64.4	69.3	82.1	91.2	95.2	96.4	94.2	90.7	93.4	88.5	83.9	81.1	79.5	77.4	75.2	73.4			
35	14.8	16.0	17.7	19.4	20.9	21.3	20.1	19.0	23.8	22.4	18.4	17.9	17.7	17.0	16.7	16.6			
40	2.97	3.25	3.49	3.72	3.83	3.82	3.56	3.35	3.85	3.62	3.41	3.31	3.27	3.21	3.18	3.31			
45	0.59	0.62	0.67	0.71	0.73	0.74	0.75	0.74	0.75	0.68	0.65	0.62	0.60	0.59	0.59	0.61			
50	0.19	0.20	0.21	0.22	0.23	0.22	0.22	0.21	0.23	0.21	0.21	0.20	0.20	0.19	0.20	0.21			
55	0.04	0.04	0.04	0.04	0.04	0.04	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.04			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.13	0.13	0.15	0.15	0.16	0.15	0.15	0.16			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.17	0.17	0.16	0.15	0.15	0.16	0.17			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.13	0.13	0.13	0.13	0.14	0.14	0.15	0.13			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.14	0.14	0.14	0.15	0.15	0.14	0.15	0.15			
80	0.01	0.00	0.01	0.01	0.01	0.01	0.01	0.00	0.15	0.15	0.16	0.16	0.16	0.16	0.17	0.17			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.01	0.00	0.00	0.01	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: