


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.13V I:0.0904A P:10.043W PF:0.5045 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:557.696x1 lm


NAME: DDW31-LM10E-130SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 55.53 lm/W			
MODEL		Imax(cd)	4686	S/MH(C0/180)	0.31
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.33
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	557.70	η UP, DN(C0-180)	0.0, 46.8
NOMINAL FLUX(lm)	557.696	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 53.2
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	1.00

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

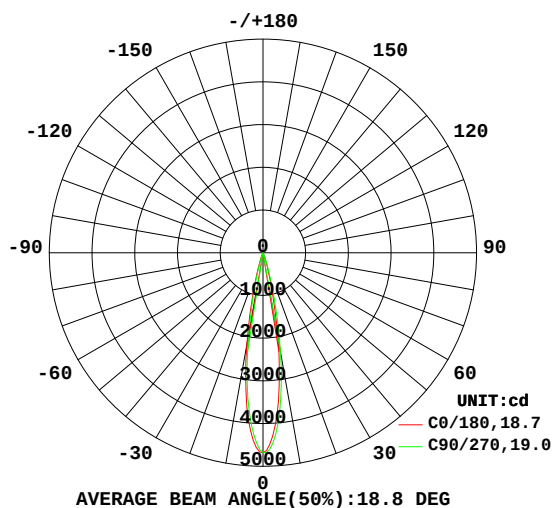

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

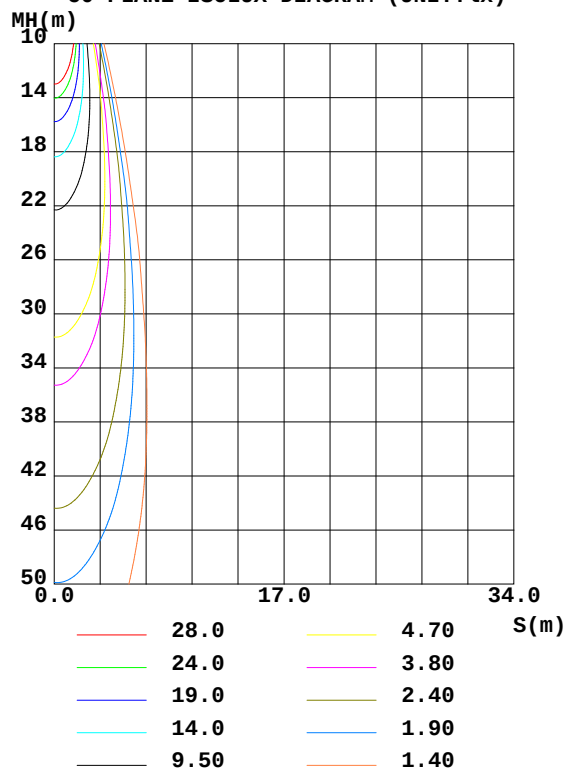

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	2186	2008	1924	1884	2027	2152	2371	2461	0- 10	311.7	311.7	55.9
20	177.4	151.7	137.4	131.9	147.8	170.1	205.8	216.1	10- 20	212.4	524.2	94
30	20.33	18.32	16.86	16.56	18.04	19.09	20.91	23.72	20- 30	27.83	552.0	99
40	1.742	1.718	1.441	1.427	1.690	1.802	2.037	2.018	30- 40	4.949	557.0	99.9
50	0.1624	0.1689	0.1610	0.1612	0.1833	0.1913	0.2070	0.1867	40- 50	0.4698	557.4	100
60	0.0109	0.0092	0.0110	0.0093	0.1674	0.1542	0.1660	0.1637	50- 60	0.0618	557.5	100
70	0.0096	0.0084	0.0097	0.0089	0.1359	0.1445	0.1494	0.1539	60- 70	0.0779	557.6	100
80	0.0063	0.0059	0.0063	0.0064	0.1840	0.1796	0.1877	0.1860	70- 80	0.0930	557.7	100
90	0	0	0	0	0	0	0	0	80- 90	0.0266	557.7	100
100	0	0	0	0	0	0	0	0	90-100	0	557.7	100
110	0	0	0	0	0	0	0	0	100-110	0	557.7	100
120	0	0	0	0	0	0	0	0	110-120	0	557.7	100
130	0	0	0	0	0	0	0	0	120-130	0	557.7	100
140	0	0	0	0	0	0	0	0	130-140	0	557.7	100
150	0	0	0	0	0	0	0	0	140-150	0	557.7	100
160	0	0	0	0	0	0	0	0	150-160	0	557.7	100
170	0	0	0	0	0	0	0	0	160-170	0	557.7	100
180	0	0	0	0	0	0	0	0	170-180	0	557.7	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 557.31 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 557.5 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

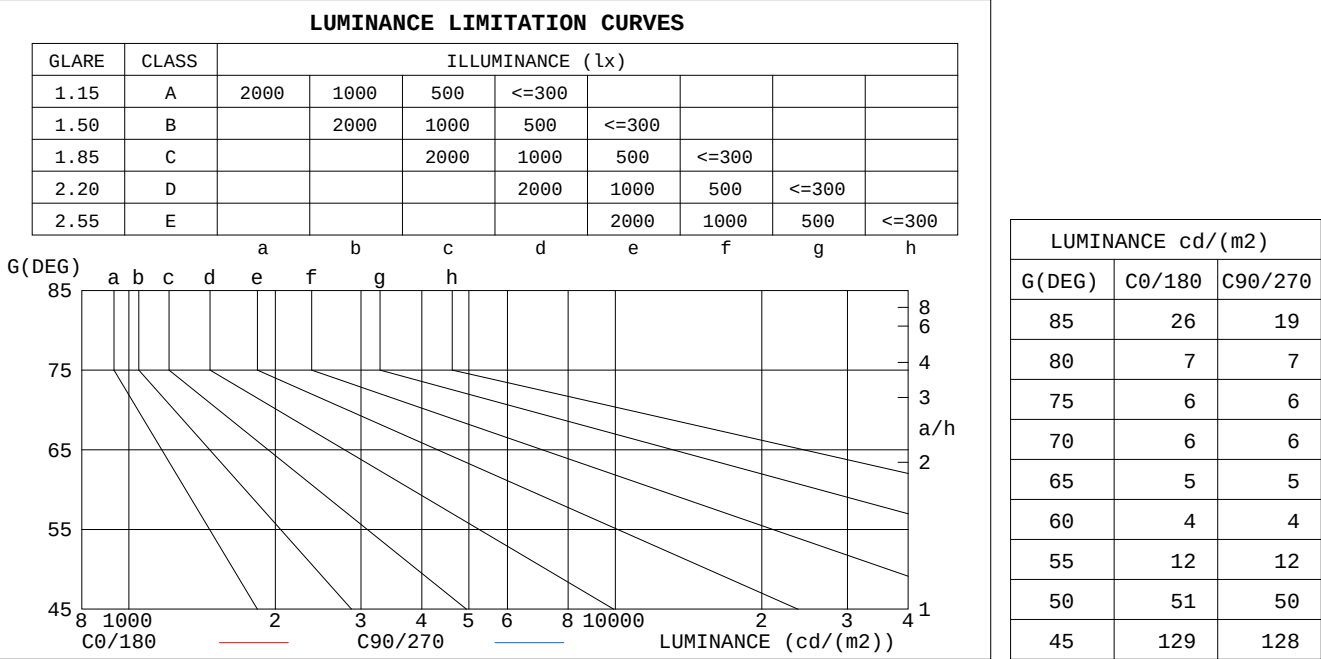


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.14	1.12	1.11	1.12	1.10	1.09	1.08	1.07	1.06	1.04	1.03	1.03	1.01	1.00	.00	.98
2.0	1.10	1.07	1.05	1.08	1.06	1.04	1.05	1.03	1.02	1.02	1.01	.00	.00	.98	.98	.96
3.0	1.06	1.03	1.01	1.05	1.02	.00	1.02	1.00	.98	1.00	.98	.97	.98	.97	.96	.94
4.0	1.03	.00	.97	1.02	.99	.97	1.00	.98	.96	.98	.96	.95	.97	.95	.94	.93
5.0	1.00	.97	.95	.00	.97	.94	.98	.96	.94	.97	.94	.93	.95	.94	.92	.91
6.0	.98	.95	.92	.97	.94	.92	.96	.94	.92	.95	.93	.91	.94	.92	.90	.90
7.0	.96	.93	.90	.95	.92	.90	.94	.92	.90	.94	.91	.89	.93	.91	.89	.88
8.0	.94	.91	.89	.94	.91	.88	.93	.90	.88	.92	.90	.88	.91	.89	.88	.87
9.0	.92	.89	.87	.92	.89	.87	.91	.89	.87	.91	.88	.86	.90	.88	.86	.85
10.0	.91	.88	.86	.90	.87	.85	.90	.87	.85	.89	.87	.85	.89	.86	.85	.84

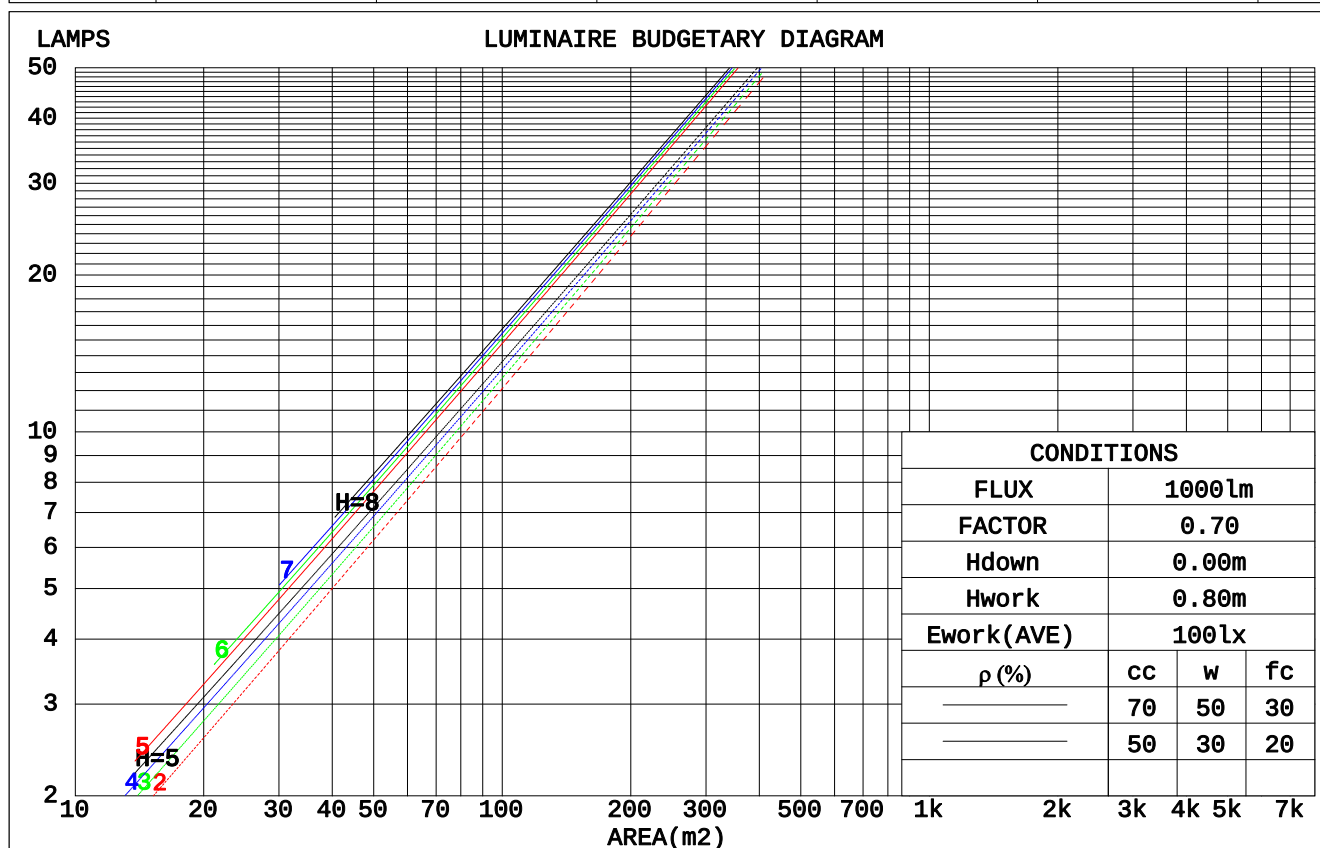

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρcc	80%			70%			50%			30%			10%			0	
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.118	.067	.021	.111	.064	.020	.099	.057	.018	.088	.051	.016	.077	.045	.014		
2.0	.107	.059	.018	.102	.056	.017	.092	.051	.016	.083	.046	.015	.074	.042	.013		
3.0	.098	.052	.016	.094	.050	.015	.086	.047	.014	.078	.043	.013	.071	.039	.012		
4.0	.091	.047	.014	.087	.046	.014	.081	.043	.013	.074	.040	.012	.068	.037	.011		
5.0	.085	.043	.013	.082	.042	.012	.076	.040	.012	.071	.037	.011	.066	.035	.011		
6.0	.080	.040	.011	.077	.039	.011	.072	.037	.011	.067	.035	.010	.063	.033	.010		
7.0	.075	.037	.010	.073	.036	.010	.068	.035	.010	.064	.033	.010	.061	.032	.009		
8.0	.071	.035	.010	.069	.034	.010	.065	.033	.009	.062	.031	.009	.059	.030	.009		
9.0	.067	.033	.009	.066	.032	.009	.062	.031	.009	.059	.030	.009	.057	.029	.008		
10.0	.064	.031	.009	.063	.030	.008	.060	.029	.008	.057	.028	.008	.055	.028	.008		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.167	.158	.150	.143	.135	.129	.098	.093	.089	.056	.054	.052	.018	.017	.017	
2.0	.148	.133	.120	.126	.114	.104	.087	.079	.073	.050	.046	.043	.016	.015	.014	
3.0	.131	.113	.099	.113	.098	.085	.077	.068	.060	.045	.040	.035	.014	.013	.012	
4.0	.118	.097	.082	.101	.084	.071	.070	.059	.050	.040	.034	.030	.013	.011	.010	
5.0	.106	.085	.069	.091	.073	.060	.063	.051	.042	.036	.030	.025	.012	.010	.008	
6.0	.097	.074	.058	.083	.065	.051	.057	.045	.036	.033	.027	.021	.011	.009	.007	
7.0	.089	.066	.050	.076	.057	.044	.053	.040	.031	.031	.024	.018	.010	.008	.006	
8.0	.082	.059	.043	.070	.051	.038	.049	.036	.027	.028	.021	.016	.009	.007	.005	
9.0	.076	.053	.038	.065	.046	.033	.045	.032	.023	.026	.019	.014	.009	.006	.005	
10.0	.070	.048	.033	.061	.042	.029	.042	.029	.021	.025	.017	.012	.008	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	-5.2	-4.7	-5.0	-4.5	-4.4	-6.1	-5.6	-5.9	-5.4	-5.3
3H	-5.3	-4.9	-5.1	-4.7	-4.5	-6.2	-5.7	-6.0	-5.5	-5.4
4H	-5.4	-4.9	-5.2	-4.7	-4.5	-6.3	-5.8	-6.0	-5.6	-5.4
6H	-5.5	-5.1	-5.2	-4.8	-4.6	-6.4	-5.9	-6.1	-5.7	-5.5
8H	-5.5	-5.1	-5.3	-4.9	-4.6	-6.4	-6.0	-6.1	-5.7	-5.5
12H	-5.6	-5.2	-5.3	-4.9	-4.7	-6.4	-6.0	-6.2	-5.8	-5.5
4H 2H	-5.4	-4.9	-5.2	-4.7	-4.5	-6.3	-5.8	-6.0	-5.6	-5.4
3H	-5.6	-5.2	-5.3	-4.9	-4.7	-6.5	-6.0	-6.2	-5.8	-5.5
4H	-5.7	-5.3	-5.4	-5.0	-4.7	-6.5	-6.2	-6.2	-5.9	-5.6
6H	-5.8	-5.4	-5.4	-5.1	-4.8	-6.7	-6.3	-6.3	-6.0	-5.6
8H	-5.8	-5.5	-5.5	-5.2	-4.8	-6.7	-6.4	-6.3	-6.0	-5.7
12H	-5.9	-5.6	-5.5	-5.2	-4.8	-6.8	-6.5	-6.4	-6.1	-5.7
8H 4H	-5.8	-5.5	-5.5	-5.2	-4.8	-6.7	-6.4	-6.3	-6.0	-5.7
6H	-6.0	-5.7	-5.5	-5.3	-4.9	-6.8	-6.6	-6.4	-6.2	-5.8
8H	-6.0	-5.8	-5.6	-5.4	-4.9	-6.9	-6.6	-6.4	-6.2	-5.8
12H	-6.1	-5.9	-5.6	-5.4	-5.0	-7.0	-6.7	-6.5	-6.3	-5.8
12H 4H	-5.9	-5.6	-5.5	-5.2	-4.9	-6.8	-6.5	-6.4	-6.1	-5.7
6H	-6.0	-5.8	-5.6	-5.4	-4.9	-6.9	-6.7	-6.5	-6.2	-5.8
8H	-6.1	-5.9	-5.6	-5.4	-5.0	-7.0	-6.7	-6.5	-6.3	-5.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.7 / -18.4					+ 4.4 / -17.0				
1.5H	+ 7.4 / -17.4					+ 7.0 / -16.0				
2.0H	+ 6.9 / - 7.9					+ 6.9 / - 7.8				

CIE Pub.117, 557.7 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.0$)
Area: 0.005 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	92	86	83	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	90	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	105	100	98	103	99	97	93
1.50	108	104	101	107	103	100	105	102	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

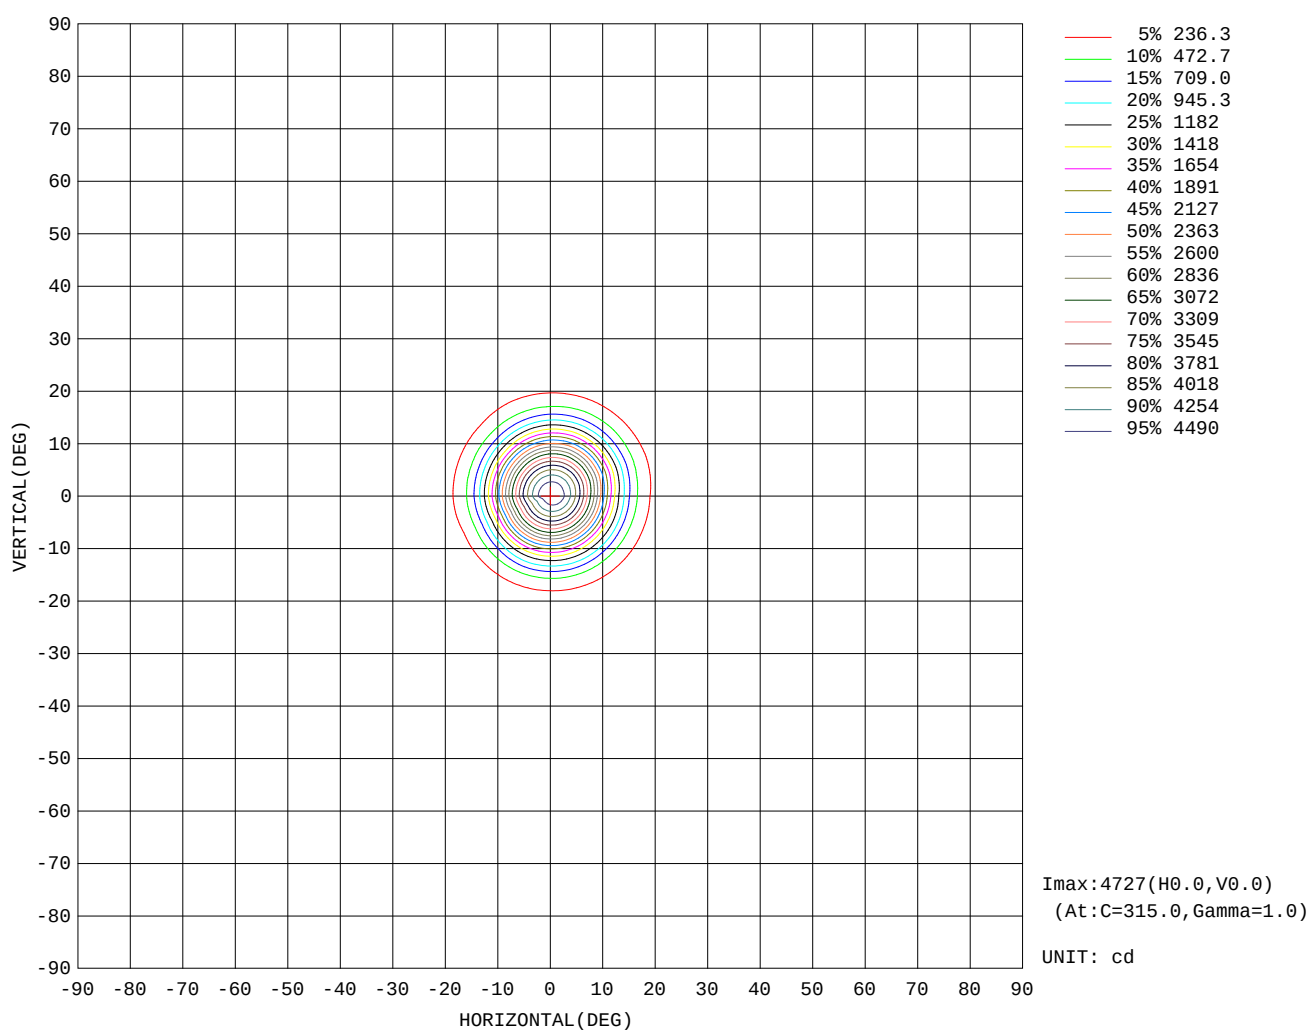

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

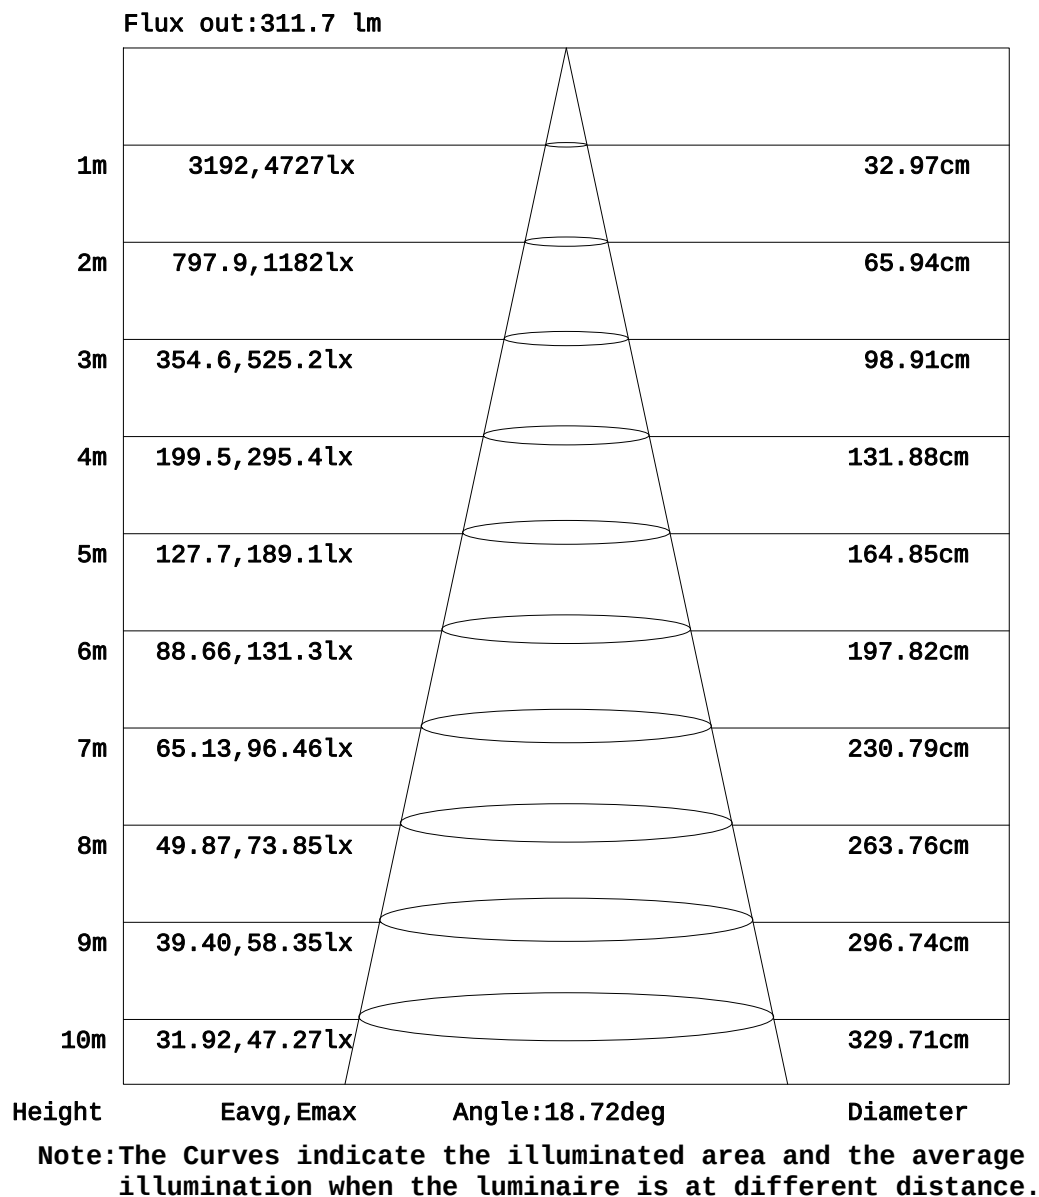

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

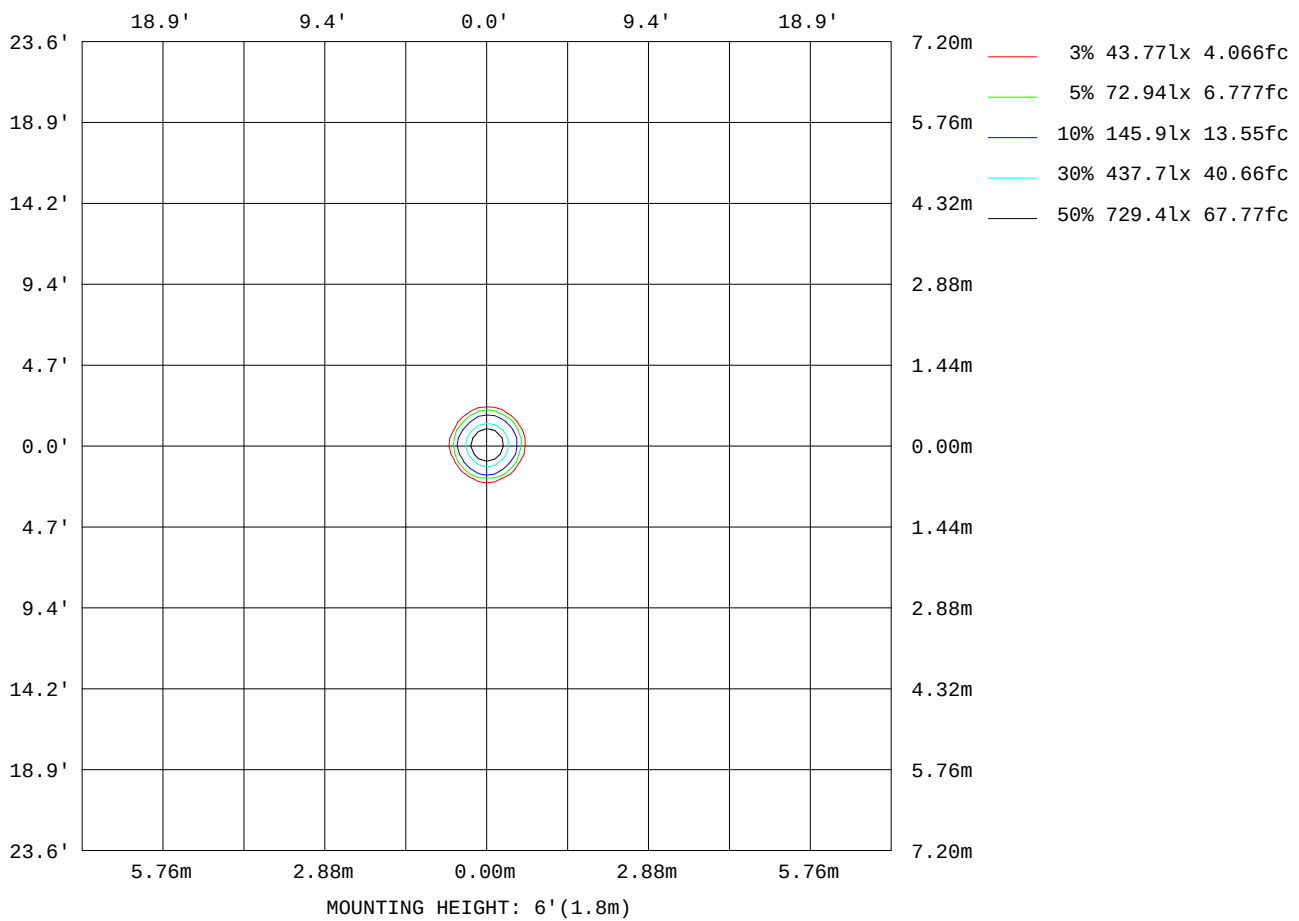

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.13V I:0.0904A P:10.043W PF:0.5045 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:557.696x1 Lm		
NAME: DDW31-LM10E-130SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	41
L_0~180(75)av	74
L_0~180(85)av	20
L_90~270(65)av	38
L_90~270(75)av	71
L_90~270(85)av	16
L_45(65)av	39
L_45(75)av	71
L_45(85)av	18

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

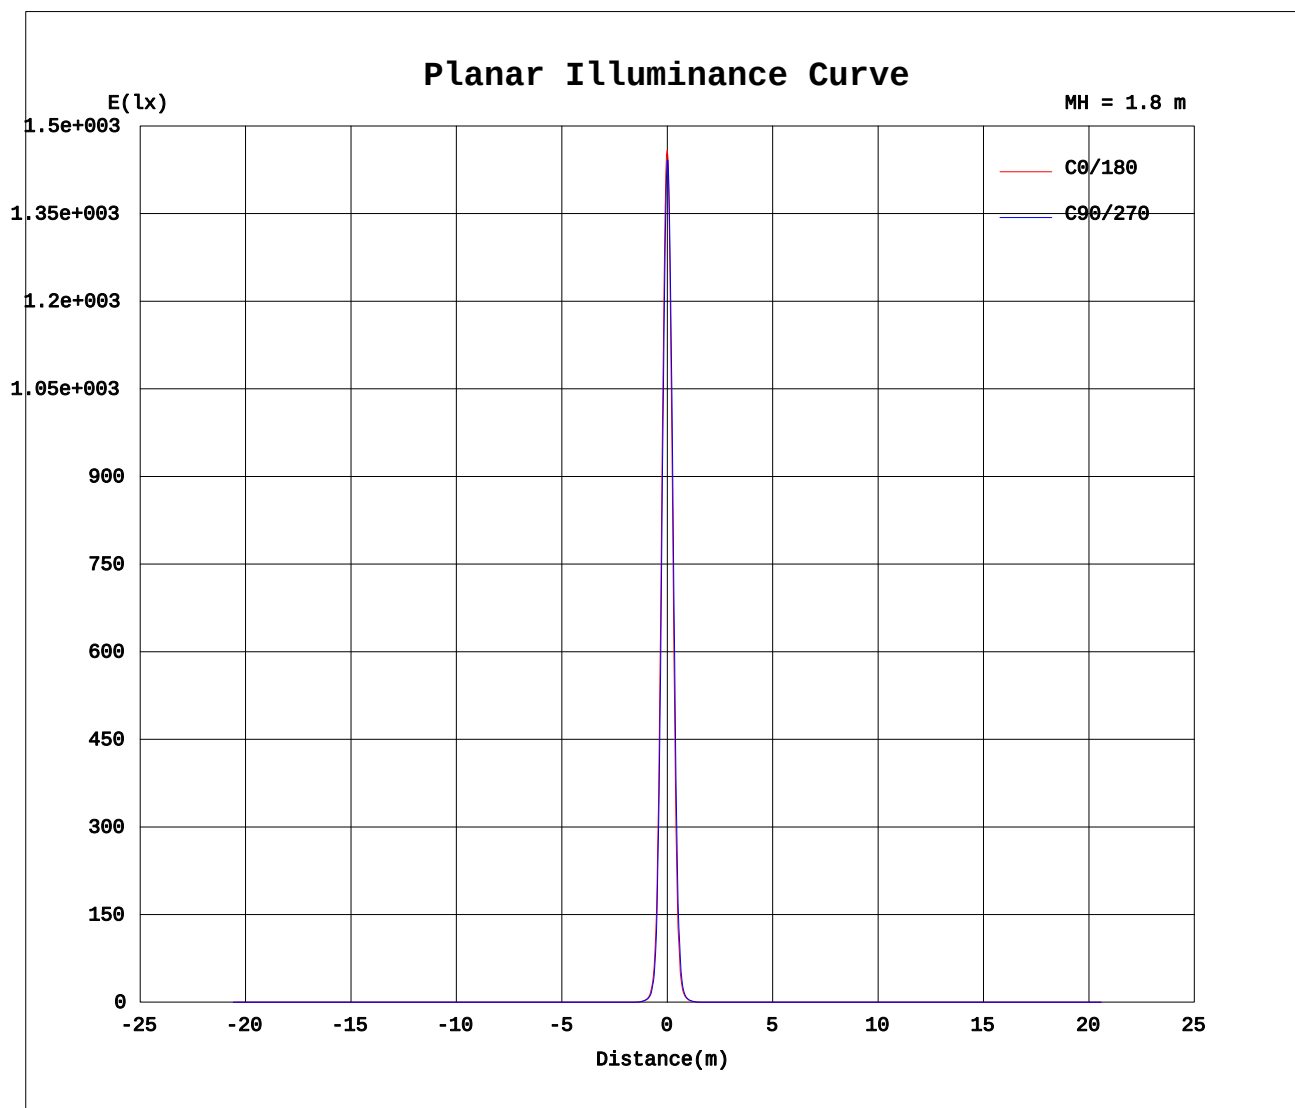

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681	4681			
5	3929	3856	3802	3761	3725	3705	3687	3688	3796	3832	3888	3961	4028	4077	4088	4065			
10	2186	2080	2008	1961	1924	1908	1884	1867	2027	2071	2152	2271	2371	2452	2461	2413			
15	719	654	615	594	571	561	548	538	609	635	682	757	825	876	880	847			
20	177	162	152	144	137	134	132	131	148	156	170	190	206	215	216	209			
25	53.0	49.3	46.6	44.2	42.2	41.6	41.3	41.6	45.8	47.4	50.6	54.7	57.8	59.7	60.4	59.9			
30	20.3	19.2	18.3	17.6	16.9	16.5	16.6	16.7	18.0	18.3	19.1	20.1	20.9	21.6	23.7	23.8			
35	7.46	7.22	6.89	6.54	6.18	5.84	5.91	6.06	6.95	7.21	7.55	7.99	8.26	8.36	8.36	8.14			
40	1.74	1.80	1.72	1.59	1.44	1.40	1.43	1.46	1.69	1.74	1.80	1.92	2.04	2.08	2.02	1.91			
45	0.45	0.46	0.47	0.46	0.45	0.45	0.44	0.44	0.48	0.48	0.48	0.50	0.52	0.51	0.49	0.47			
50	0.16	0.17	0.17	0.17	0.16	0.16	0.16	0.16	0.18	0.19	0.19	0.20	0.21	0.20	0.19	0.17			
55	0.03	0.03	0.03	0.04	0.03	0.03	0.03	0.03	0.04	0.04	0.04	0.04	0.05	0.05	0.04	0.03			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.16	0.15	0.15	0.17	0.17	0.16	0.16			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.15	0.15	0.15	0.15	0.16	0.16			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.14	0.14	0.14	0.14	0.15	0.15	0.15	0.15			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.18	0.18	0.17	0.17	0.18	0.18	0.18	0.18			
80	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.18	0.18	0.18	0.19	0.19	0.19	0.19	0.18			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: