


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.14V I:0.0919A P:10.221W PF:0.5050 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:717.13x1 lm


NAME: DDW31-LM10E-330SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 70.16 lm/W
MODEL		Imax(cd)	2128	S/MH(C0/180)	0.53	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.56	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	717.13	η UP, DN(C0-180)	0.0, 48.9	
NOMINAL FLUX(lm)	717.13	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 51.1	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

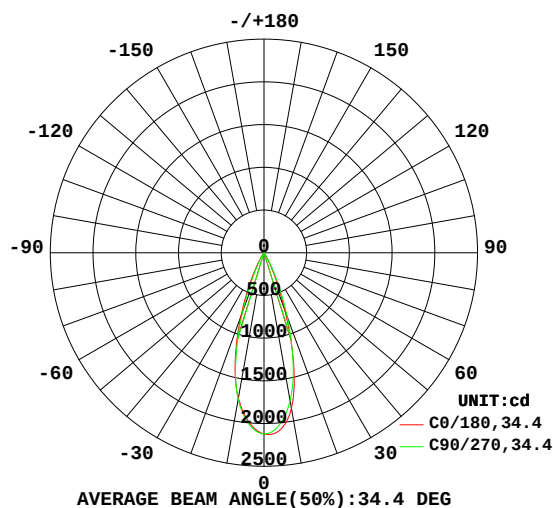

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

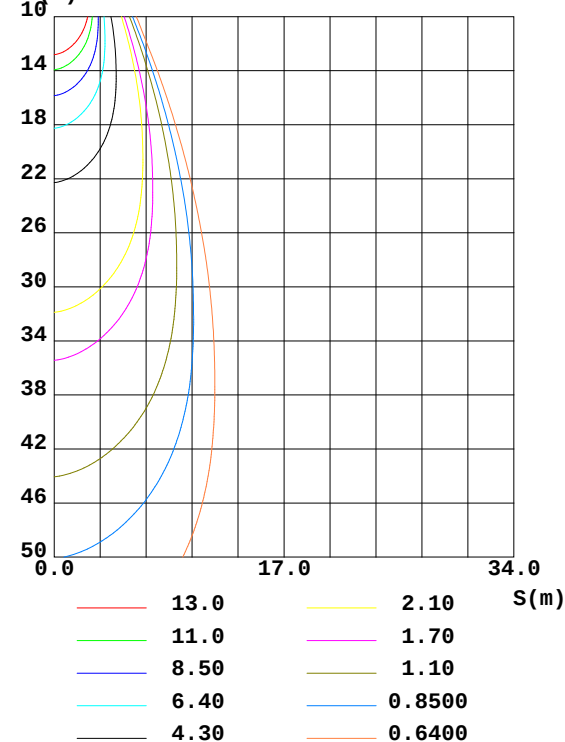

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	1730	1720	1742	1794	1852	1819	1758	1739	0- 10	185.6	185.6	25.9
20	790.8	770.7	731.1	687.7	712.1	754.2	798.9	824.7	10- 20	350.7	536.3	74.8
30	132.6	115.3	87.34	79.01	80.92	94.30	115.4	140.0	20- 30	159.2	695.5	97
40	5.787	4.615	3.314	2.806	3.240	3.997	5.073	6.040	30- 40	20.48	716.0	99.8
50	0.3547	0.3110	0.2504	0.2194	0.2261	0.2422	0.2983	0.3506	40- 50	0.8976	716.9	100
60	0.0096	0.0093	0.0097	0.0089	0.1226	0.1450	0.1306	0.1456	50- 60	0.0857	717.0	100
70	0.0071	0.0076	0.0084	0.0076	0.1309	0.1370	0.1287	0.1422	60- 70	0.0722	717.0	100
80	0.0054	0.0051	0.0059	0.0051	0.1651	0.1669	0.1510	0.1642	70- 80	0.0861	717.1	100
90	0	0	0	0	0	0	0	0	80- 90	0.0208	717.1	100
100	0	0	0	0	0	0	0	0	90-100	0	717.1	100
110	0	0	0	0	0	0	0	0	100-110	0	717.1	100
120	0	0	0	0	0	0	0	0	110-120	0	717.1	100
130	0	0	0	0	0	0	0	0	120-130	0	717.1	100
140	0	0	0	0	0	0	0	0	130-140	0	717.1	100
150	0	0	0	0	0	0	0	0	140-150	0	717.1	100
160	0	0	0	0	0	0	0	0	150-160	0	717.1	100
170	0	0	0	0	0	0	0	0	160-170	0	717.1	100
180	0	0	0	0	0	0	0	0	170-180	0	717.1	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 716.66 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 716.95 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

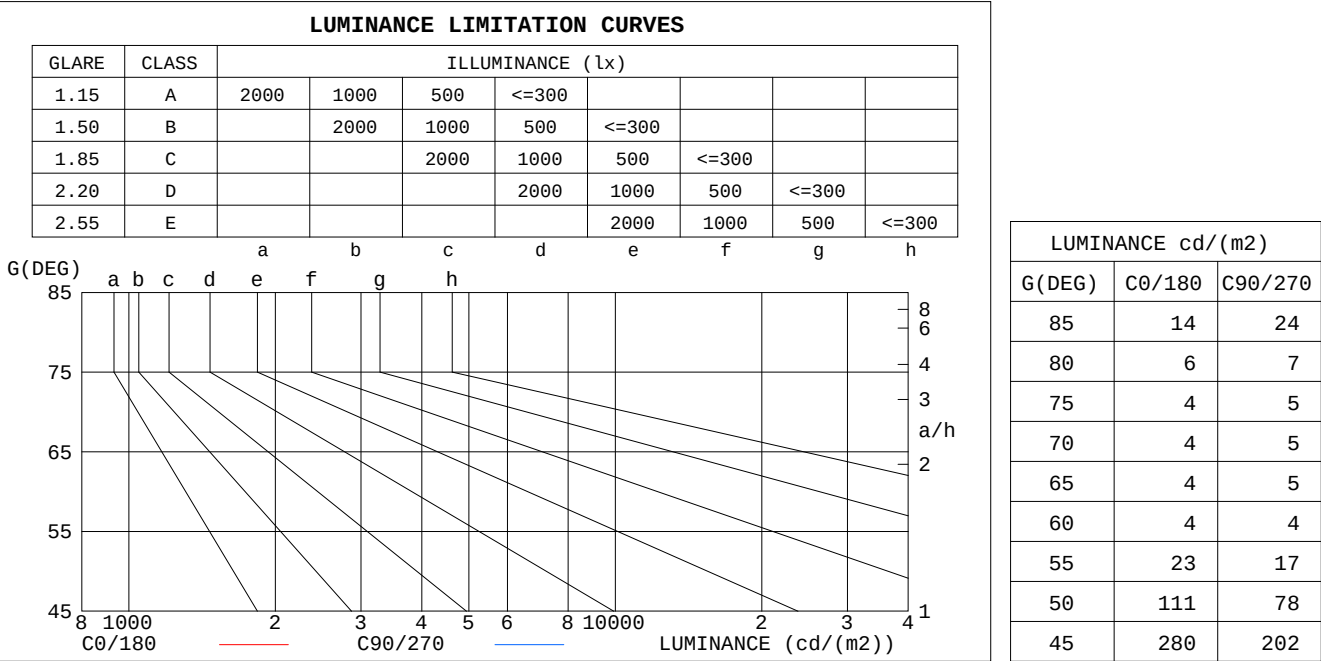


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.11	1.09	1.11	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.01	1.05	1.03	1.00	1.02	1.00	.98	.99	.98	.96	.97	.95	.94	.93
3.0	1.02	.98	.95	1.01	.97	.95	.98	.96	.93	.96	.94	.92	.94	.92	.90	.89
4.0	.98	.94	.91	.97	.93	.90	.95	.92	.89	.93	.90	.88	.91	.89	.87	.86
5.0	.94	.90	.86	.93	.89	.86	.91	.88	.85	.90	.87	.85	.89	.86	.84	.83
6.0	.90	.86	.83	.90	.86	.83	.88	.85	.82	.87	.84	.81	.86	.83	.81	.80
7.0	.87	.83	.80	.86	.82	.79	.85	.82	.79	.84	.81	.79	.83	.80	.78	.77
8.0	.84	.80	.77	.83	.79	.76	.83	.79	.76	.82	.78	.76	.81	.78	.76	.75
9.0	.81	.77	.74	.81	.77	.74	.80	.76	.74	.79	.76	.73	.78	.75	.73	.72
10.0	.79	.74	.71	.78	.74	.71	.77	.74	.71	.77	.73	.71	.76	.73	.71	.70

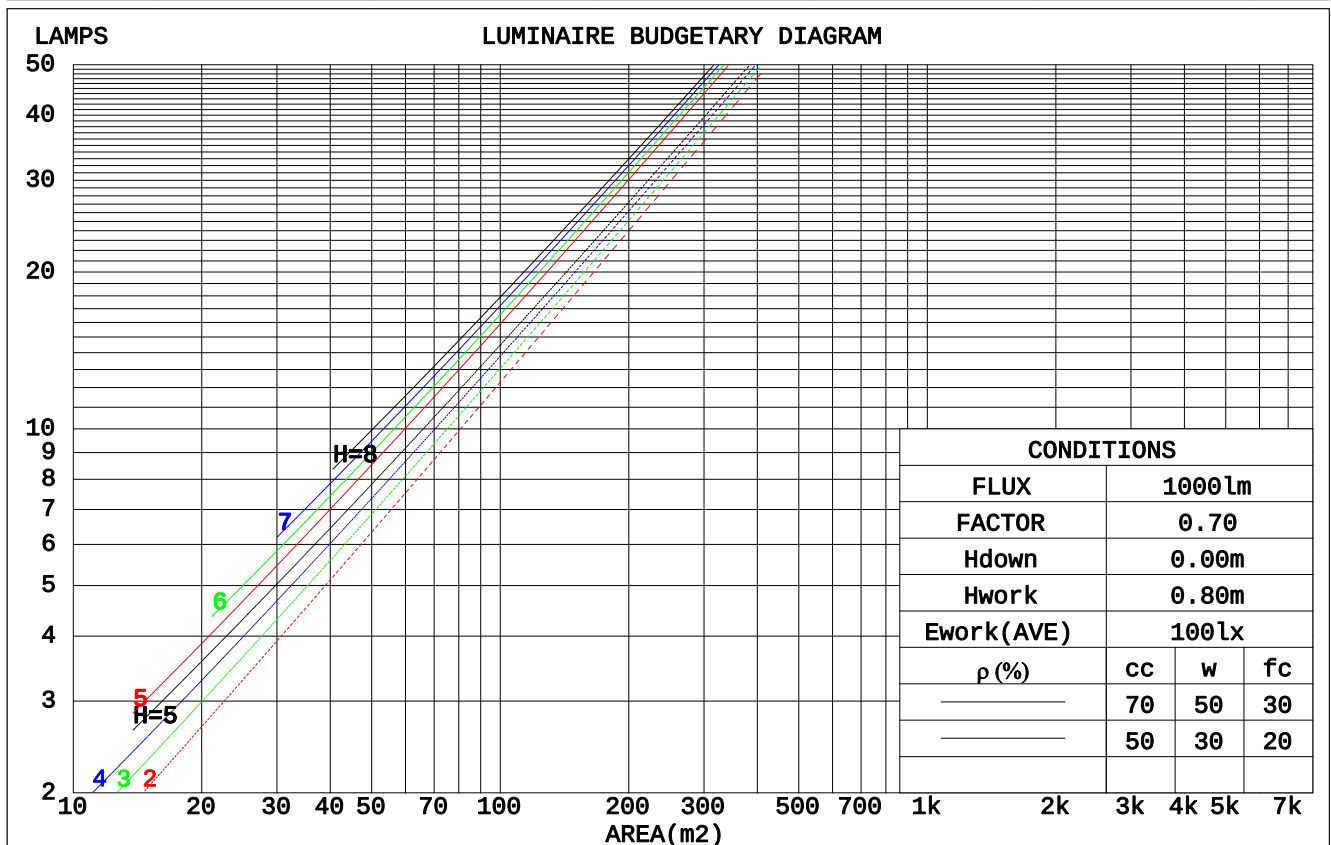

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ _{CC}	80%			70%			50%			30%			10%			0	
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ _{FC}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.142	.081	.026	.135	.077	.024	.123	.070	.022	.111	.064	.021	.101	.058	.019		
2.0	.132	.072	.022	.126	.070	.021	.116	.065	.020	.107	.060	.019	.098	.055	.017		
3.0	.123	.066	.020	.119	.064	.019	.110	.060	.018	.102	.056	.017	.095	.053	.016		
4.0	.116	.060	.018	.112	.059	.017	.105	.056	.017	.098	.053	.016	.092	.050	.015		
5.0	.110	.056	.016	.107	.055	.016	.100	.052	.015	.095	.050	.015	.089	.048	.014		
6.0	.105	.052	.015	.102	.051	.015	.096	.049	.014	.091	.047	.014	.087	.046	.014		
7.0	.100	.049	.014	.097	.048	.014	.093	.047	.013	.088	.045	.013	.084	.044	.013		
8.0	.095	.047	.013	.093	.046	.013	.089	.044	.013	.085	.043	.012	.082	.042	.012		
9.0	.091	.044	.012	.090	.044	.012	.086	.042	.012	.082	.041	.012	.079	.040	.012		
10.0	.088	.042	.012	.086	.042	.012	.083	.041	.011	.080	.040	.011	.077	.039	.011		

ρ _{CC}	80%			70%			50%			30%			10%			0
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ _{fC}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.148	.144	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.151	.133	.117	.129	.114	.101	.089	.079	.071	.051	.046	.041	.016	.015	.014	
3.0	.136	.113	.095	.117	.098	.082	.080	.068	.058	.046	.040	.034	.015	.013	.011	
4.0	.124	.098	.078	.106	.085	.068	.073	.059	.048	.042	.035	.028	.014	.011	.009	
5.0	.114	.086	.065	.098	.074	.057	.067	.052	.040	.039	.030	.024	.013	.010	.008	
6.0	.105	.076	.055	.091	.066	.048	.062	.046	.034	.036	.027	.020	.012	.009	.007	
7.0	.098	.068	.047	.084	.059	.041	.058	.041	.029	.034	.024	.017	.011	.008	.006	
8.0	.092	.061	.040	.079	.053	.035	.055	.037	.025	.032	.022	.015	.010	.007	.005	
9.0	.086	.056	.035	.074	.048	.030	.051	.034	.022	.030	.020	.013	.010	.007	.004	
10.0	.082	.051	.031	.070	.044	.027	.049	.031	.019	.028	.018	.011	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	4.8	5.5	5.0	5.6	5.8	1.9	2.5	2.1	2.7	2.8
3H	4.6	5.3	4.9	5.5	5.7	1.7	2.3	1.9	2.5	2.7
4H	4.6	5.2	4.8	5.4	5.6	1.6	2.2	1.9	2.4	2.6
6H	4.5	5.0	4.8	5.3	5.5	1.5	2.1	1.8	2.3	2.6
8H	4.4	5.0	4.7	5.2	5.5	1.5	2.0	1.8	2.3	2.5
12H	4.4	4.9	4.7	5.2	5.4	1.4	2.0	1.8	2.2	2.5
4H 2H	4.6	5.2	4.8	5.4	5.6	1.6	2.2	1.9	2.4	2.6
3H	4.4	4.9	4.7	5.2	5.4	1.4	2.0	1.8	2.2	2.5
4H	4.3	4.8	4.6	5.1	5.4	1.3	1.8	1.7	2.1	2.4
6H	4.2	4.6	4.6	4.9	5.3	1.2	1.7	1.6	2.0	2.3
8H	4.1	4.5	4.5	4.9	5.2	1.2	1.6	1.6	1.9	2.3
12H	4.1	4.4	4.5	4.8	5.2	1.1	1.5	1.5	1.9	2.3
8H 4H	4.1	4.5	4.5	4.9	5.2	1.2	1.6	1.6	1.9	2.3
6H	4.0	4.4	4.4	4.7	5.2	1.1	1.4	1.5	1.8	2.2
8H	4.0	4.3	4.4	4.7	5.1	1.0	1.3	1.5	1.7	2.2
12H	3.9	4.2	4.4	4.6	5.1	1.0	1.2	1.4	1.7	2.1
12H 4H	4.1	4.4	4.5	4.8	5.2	1.1	1.5	1.5	1.9	2.3
6H	4.0	4.3	4.4	4.7	5.1	1.0	1.3	1.5	1.7	2.2
8H	3.9	4.2	4.4	4.6	5.1	1.0	1.2	1.4	1.7	2.1
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.0 / -27.1					+ 4.8 / -24.5				
1.5H	+ 7.8 / -24.5					+ 7.6 / -22.4				
2.0H	+ 7.4 / -13.3					+ 6.8 / -11.8				

CIE Pub.117, 717.1 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -1.2$)
Area: 0.005 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	92	86	83	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	89	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	104	100	98	103	99	97	93
1.50	108	104	101	107	103	100	105	102	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

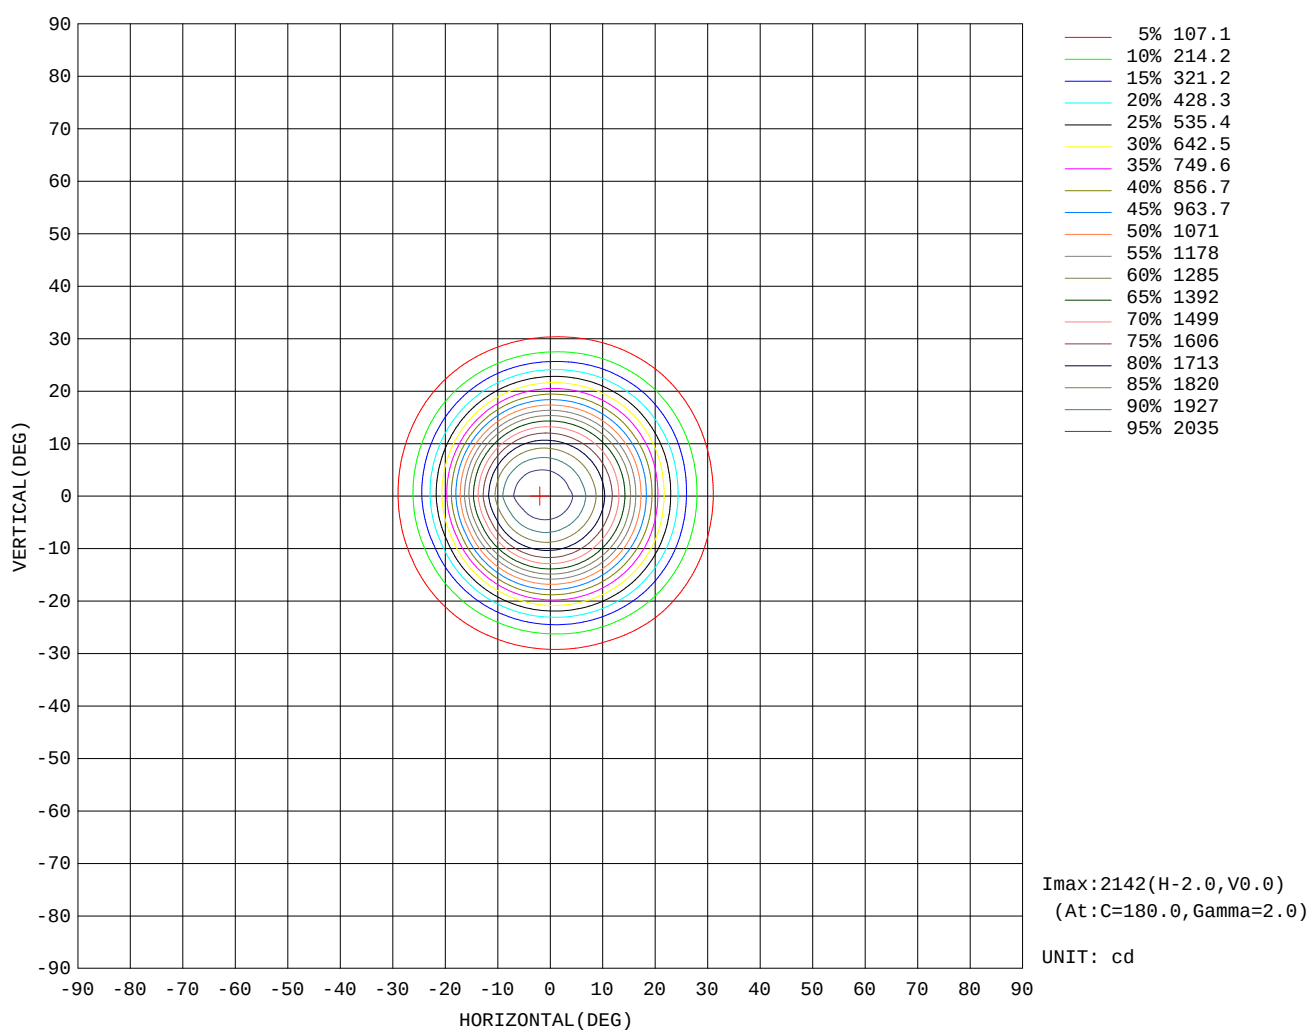

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

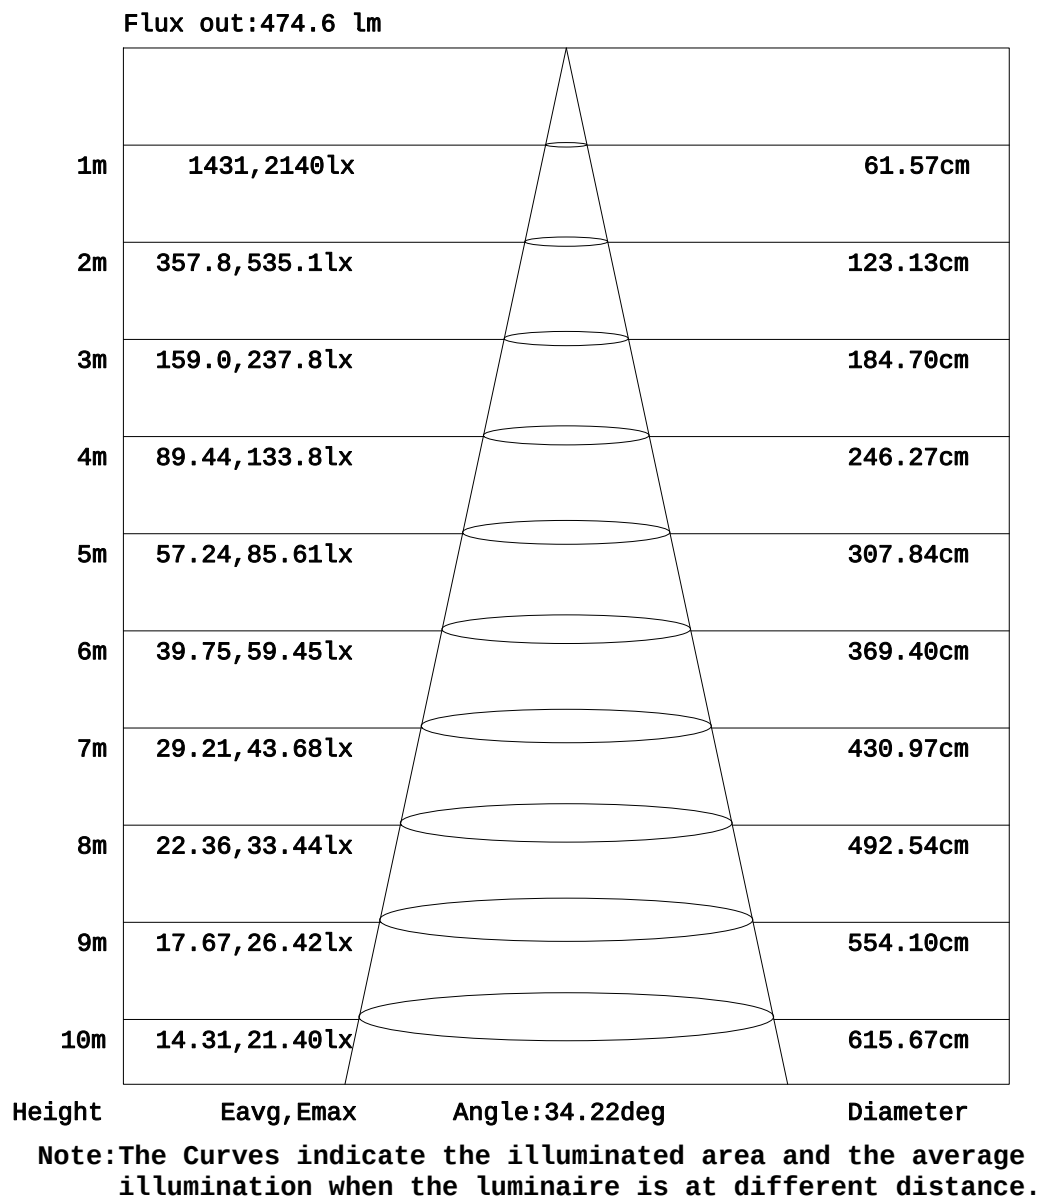

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

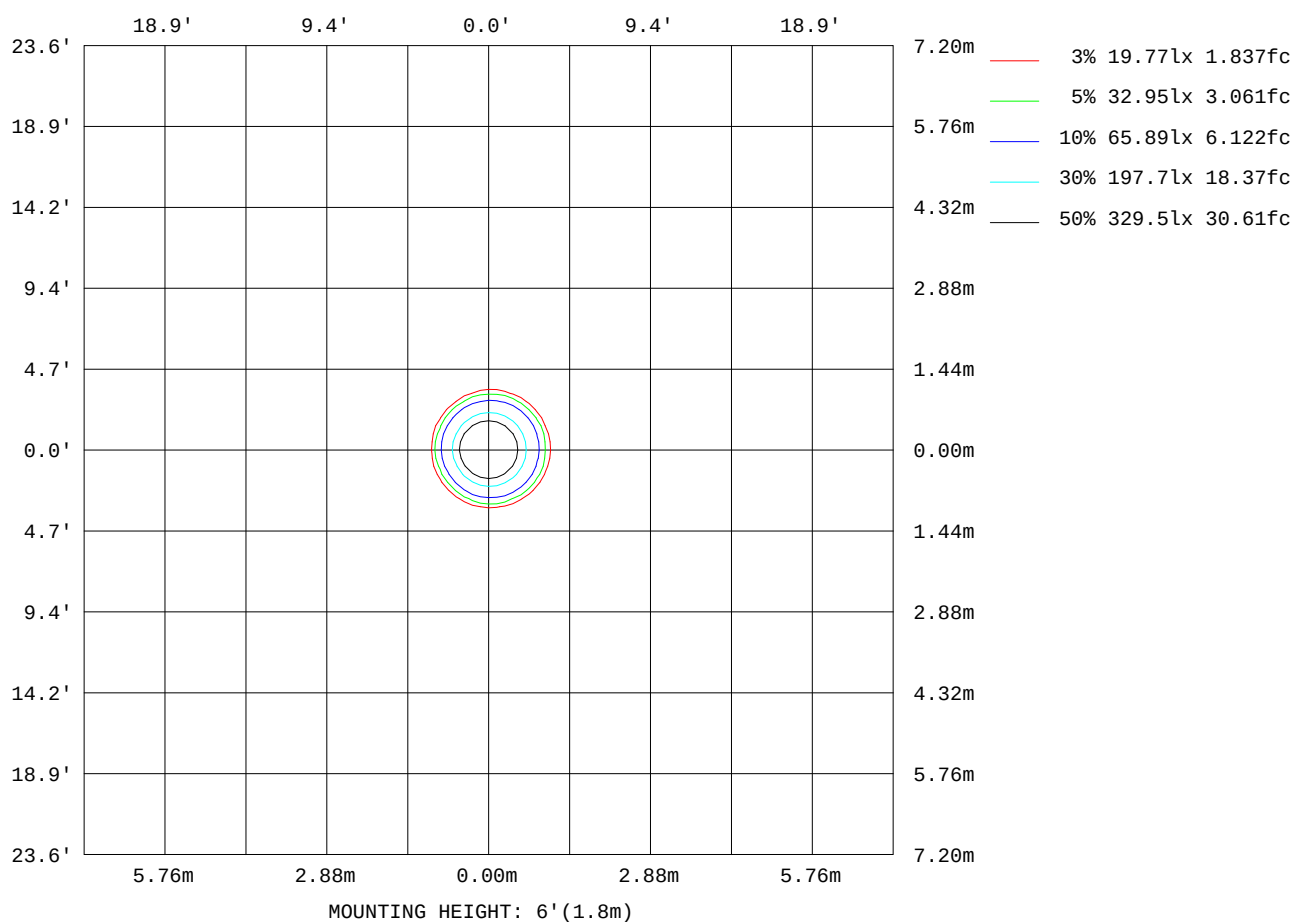

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.14V I:0.0919A P:10.221W PF:0.5050 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:717.13x1 lm

NAME: DDW31-LM10E-330SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	38
L_0~180(75)av	64
L_0~180(85)av	9
L_90~270(65)av	34
L_90~270(75)av	71
L_90~270(85)av	16
L_45(65)av	37
L_45(75)av	58
L_45(85)av	13

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

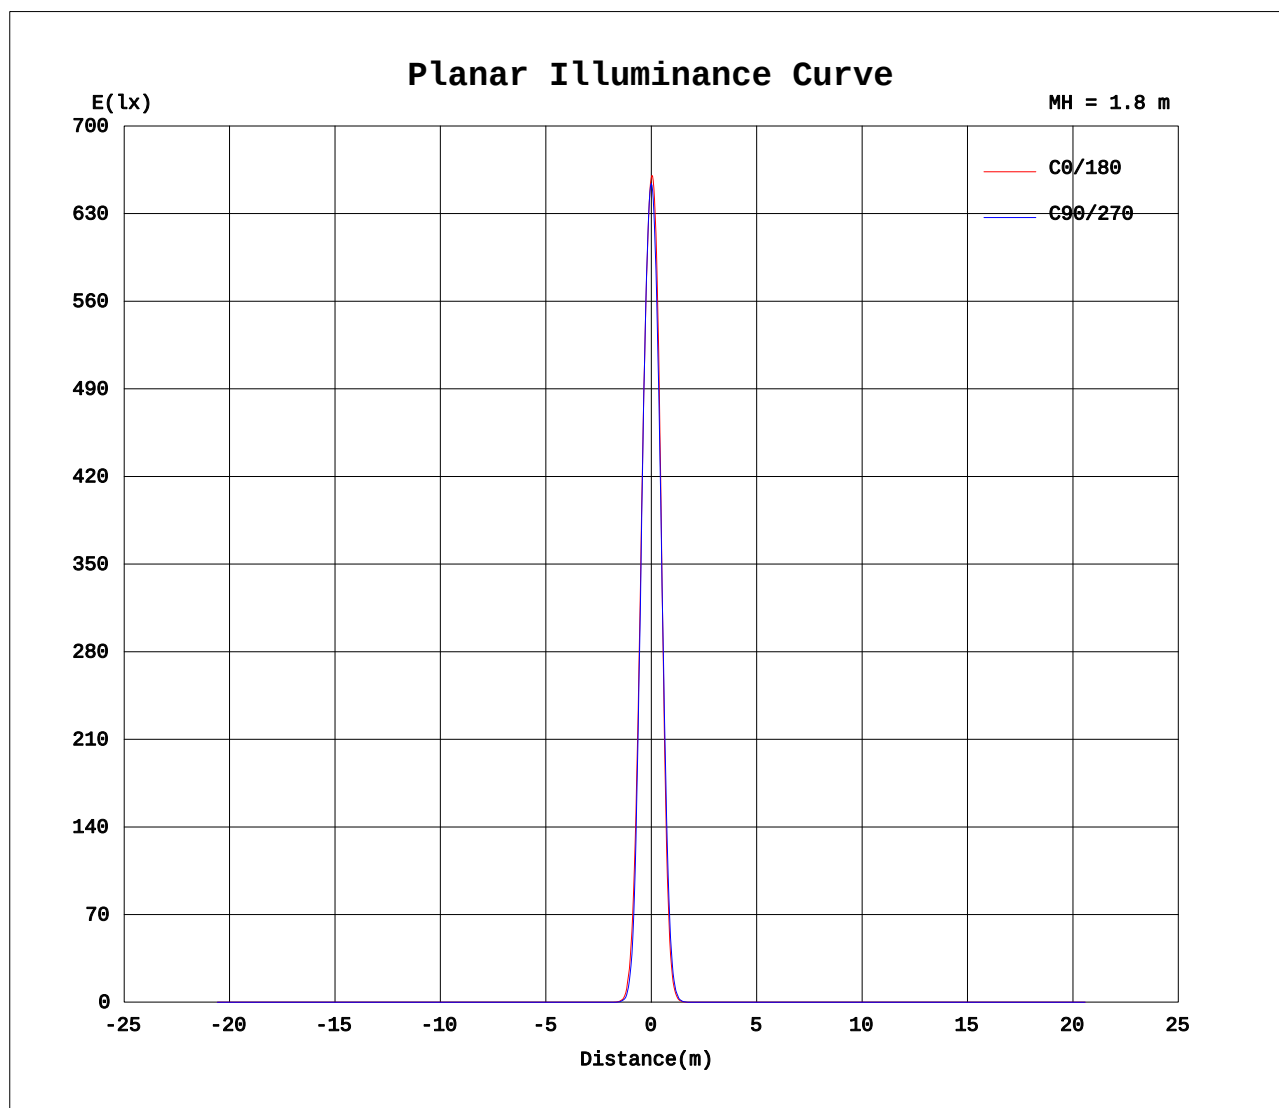

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121	2121			
5	1995	1994	1997	2004	2016	2034	2056	2072	2088	2084	2068	2048	2029	2013	2006	2004			
10	1730	1723	1720	1729	1742	1764	1794	1818	1852	1845	1819	1789	1758	1742	1739	1741			
15	1308	1299	1287	1280	1272	1272	1280	1296	1339	1344	1338	1330	1321	1323	1327	1329			
20	791	786	771	752	731	710	688	679	712	729	754	779	799	816	825	819			
25	380	368	345	315	286	268	258	256	285	297	318	343	359	385	401	398			
30	133	124	115	96.2	87.3	81.6	79.0	79.2	80.9	85.6	94.3	104	115	130	140	141			
35	29.7	27.2	23.1	18.9	16.5	15.5	15.2	15.4	17.7	19.2	24.2	27.1	29.9	33.5	36.4	37.1			
40	5.79	5.38	4.62	3.86	3.31	3.00	2.81	2.76	3.24	3.60	4.00	4.56	5.07	5.51	6.04	6.36			
45	0.98	0.96	0.90	0.80	0.72	0.65	0.62	0.62	0.65	0.66	0.70	0.77	0.84	0.90	0.95	0.99			
50	0.35	0.34	0.31	0.28	0.25	0.23	0.22	0.21	0.23	0.23	0.24	0.27	0.30	0.32	0.35	0.36			
55	0.07	0.06	0.06	0.05	0.05	0.05	0.04	0.04	0.04	0.04	0.04	0.05	0.05	0.06	0.07	0.08			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.12	0.14	0.15	0.14	0.13	0.14	0.15	0.15			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.15	0.16	0.15	0.14	0.13	0.14	0.14	0.14			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.13	0.14	0.14	0.13	0.13	0.13	0.14	0.14			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.14	0.14	0.17	0.18	0.17	0.14	0.14			
80	0.01	0.01	0.01	0.01	0.01	0.00	0.01	0.01	0.17	0.16	0.17	0.16	0.15	0.17	0.16	0.18			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: