


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.14V I:0.0926A P:10.302W PF:0.5051 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:506.307x1 lm


NAME: DDW31-LM10E-530SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 49.15 lm/W			
MODEL		Imax(cd)	697.3	S/MH(C0/180)	0.80
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.82
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	506.31	η UP, DN(C0-180)	0.0, 49.4
NOMINAL FLUX(lm)	506.307	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 50.6
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.75
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.80

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

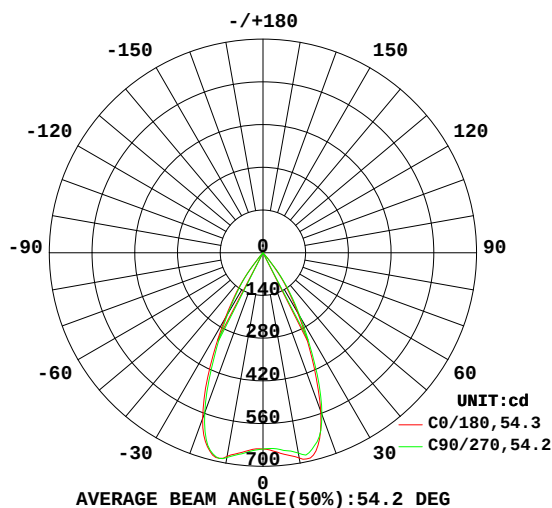

C0 PLANE ISOLUX DIAGRAM (UNIT: lx)

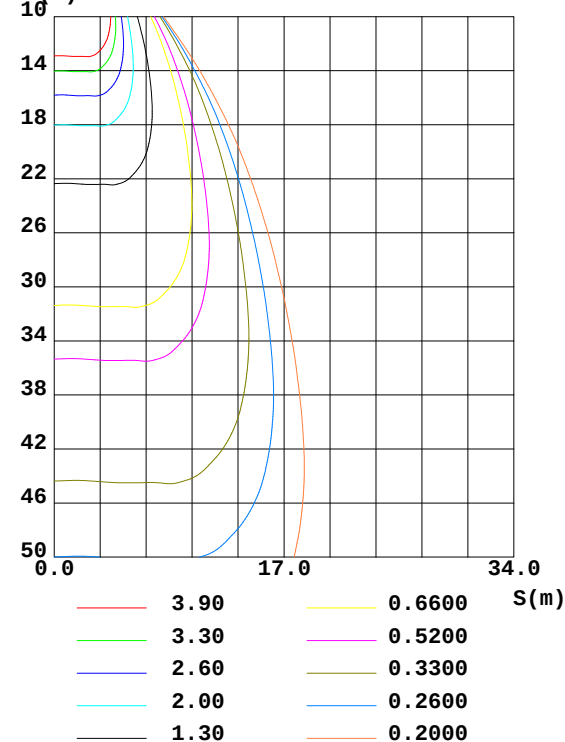

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	677.7	677.9	681.0	688.5	682.7	675.0	666.5	671.9	0- 10	63.18	63.18	12.5
20	578.0	569.2	558.2	550.0	553.7	550.8	564.3	587.1	10- 20	183.1	246.3	48.6
30	248.1	241.8	231.1	220.1	230.3	235.4	246.2	263.1	20- 30	178.8	425.1	84
40	20.72	20.10	16.36	12.23	22.90	23.62	30.20	34.86	30- 40	78.08	503.2	99.4
50	0.7316	0.6861	0.6082	0.5233	0.5537	0.5711	0.6596	0.7628	40- 50	2.753	505.9	99.9
60	0.0104	0.0097	0.0101	0.0081	0.1428	0.1566	0.1381	0.1412	50- 60	0.1709	506.1	100
70	0.0084	0.0093	0.0089	0.0081	0.1362	0.1457	0.1623	0.1347	60- 70	0.0754	506.2	100
80	0.0046	0.0055	0.0055	0.0055	0.1724	0.1762	0.1575	0.1568	70- 80	0.0919	506.3	100
90	0	0	0	0	0	0	0	0	80- 90	0.0240	506.3	100
100	0	0	0	0	0	0	0	0	90-100	0	506.3	100
110	0	0	0	0	0	0	0	0	100-110	0	506.3	100
120	0	0	0	0	0	0	0	0	110-120	0	506.3	100
130	0	0	0	0	0	0	0	0	120-130	0	506.3	100
140	0	0	0	0	0	0	0	0	130-140	0	506.3	100
150	0	0	0	0	0	0	0	0	140-150	0	506.3	100
160	0	0	0	0	0	0	0	0	150-160	0	506.3	100
170	0	0	0	0	0	0	0	0	160-170	0	506.3	100
180	0	0	0	0	0	0	0	0	170-180	0	506.3	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 505.49 lm

%lum = 99.8%

%lamp = 99.8%

Conical surface Flux(120deg): 506.12 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

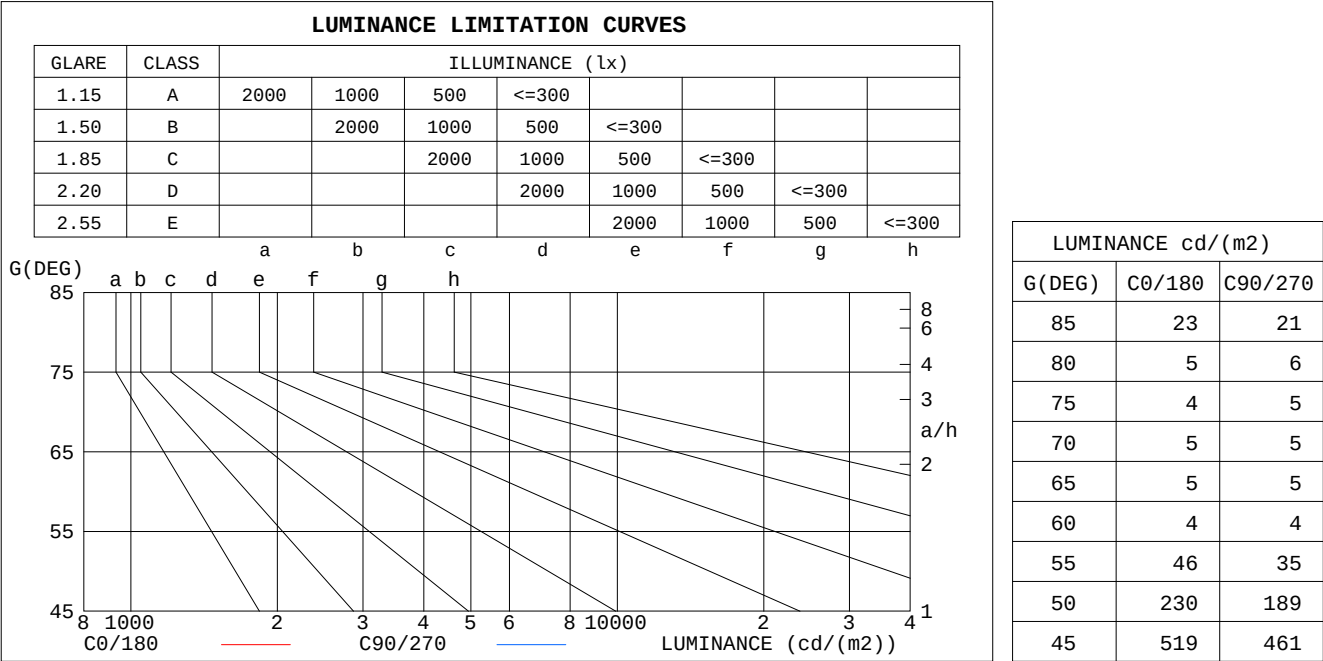


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.09	1.07	1.09	1.07	1.05	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.95
2.0	1.05	1.01	.98	1.03	.99	.97	.99	.97	.95	.97	.95	.93	.94	.92	.91	.89
3.0	.99	.94	.90	.97	.93	.90	.95	.91	.88	.92	.89	.87	.90	.88	.86	.84
4.0	.93	.88	.84	.92	.87	.84	.90	.86	.83	.88	.84	.82	.86	.83	.81	.79
5.0	.88	.83	.79	.87	.82	.78	.85	.81	.78	.84	.80	.77	.82	.79	.76	.75
6.0	.83	.78	.74	.82	.77	.74	.81	.76	.73	.80	.76	.73	.78	.75	.72	.71
7.0	.79	.73	.70	.78	.73	.69	.77	.72	.69	.76	.72	.69	.75	.71	.68	.67
8.0	.75	.69	.66	.74	.69	.66	.73	.69	.65	.72	.68	.65	.71	.68	.65	.64
9.0	.71	.66	.62	.71	.66	.62	.70	.65	.62	.69	.65	.62	.68	.64	.61	.60
10.0	.68	.62	.59	.67	.62	.59	.67	.62	.59	.66	.62	.59	.65	.61	.58	.57

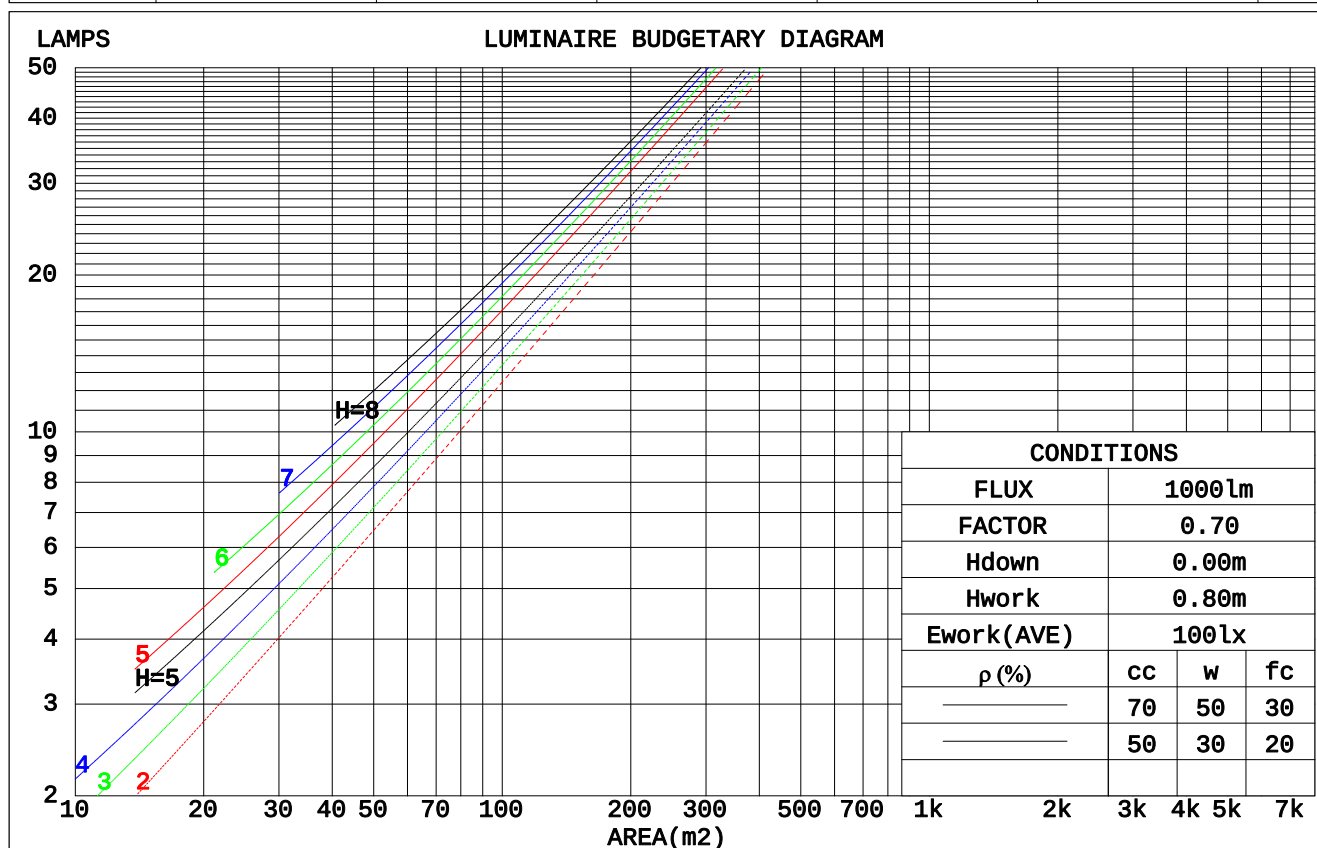

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0	
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.164	.093	.029	.157	.089	.028	.144	.083	.026	.133	.077	.025	.122	.071	.023		
2.0	.155	.085	.026	.150	.082	.025	.139	.077	.024	.130	.073	.023	.121	.068	.022		
3.0	.147	.078	.023	.143	.076	.023	.134	.072	.022	.126	.069	.021	.118	.065	.020		
4.0	.140	.073	.021	.136	.071	.021	.129	.068	.020	.121	.065	.020	.115	.062	.019		
5.0	.134	.068	.020	.130	.067	.019	.124	.064	.019	.118	.062	.018	.112	.060	.018		
6.0	.128	.064	.018	.125	.063	.018	.119	.061	.018	.114	.059	.017	.109	.057	.017		
7.0	.123	.061	.017	.120	.060	.017	.115	.058	.017	.110	.056	.016	.105	.055	.016		
8.0	.118	.057	.016	.115	.057	.016	.111	.055	.016	.106	.054	.016	.102	.053	.015		
9.0	.113	.055	.015	.111	.054	.015	.107	.053	.015	.103	.052	.015	.099	.050	.015		
10.0	.109	.052	.014	.107	.052	.014	.103	.051	.014	.100	.050	.014	.096	.049	.014		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.146	.135	.126	.100	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.154	.133	.115	.132	.114	.099	.090	.079	.069	.052	.046	.040	.017	.015	.013	
3.0	.141	.113	.092	.121	.098	.079	.083	.068	.056	.048	.040	.033	.015	.013	.011	
4.0	.130	.099	.075	.112	.085	.065	.077	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.121	.087	.062	.104	.075	.054	.072	.052	.038	.041	.031	.022	.013	.010	.007	
6.0	.113	.077	.051	.097	.067	.045	.067	.047	.032	.039	.028	.019	.013	.009	.006	
7.0	.107	.070	.044	.092	.060	.038	.063	.042	.027	.037	.025	.016	.012	.008	.005	
8.0	.101	.063	.037	.087	.055	.033	.060	.039	.023	.035	.023	.014	.011	.007	.005	
9.0	.096	.058	.032	.083	.050	.028	.057	.035	.020	.033	.021	.012	.011	.007	.004	
10.0	.091	.054	.028	.079	.046	.025	.055	.033	.018	.032	.019	.010	.010	.006	.003	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	14.1	15.0	14.3	15.1	15.3	13.8	14.6	14.0	14.8	14.9
3H	13.9	14.7	14.2	14.9	15.1	13.6	14.4	13.8	14.6	14.8
4H	13.9	14.6	14.1	14.8	15.0	13.5	14.2	13.8	14.5	14.7
6H	13.8	14.5	14.1	14.7	14.9	13.4	14.1	13.7	14.4	14.6
8H	13.7	14.4	14.0	14.6	14.9	13.4	14.0	13.7	14.3	14.6
12H	13.7	14.3	14.0	14.6	14.9	13.3	14.0	13.6	14.2	14.5
4H 2H	13.9	14.6	14.1	14.8	15.0	13.5	14.2	13.8	14.5	14.7
3H	13.7	14.3	14.0	14.6	14.9	13.3	14.0	13.6	14.2	14.5
4H	13.6	14.2	13.9	14.5	14.8	13.2	13.8	13.6	14.1	14.4
6H	13.5	14.0	13.9	14.3	14.7	13.1	13.6	13.5	14.0	14.3
8H	13.4	13.9	13.8	14.3	14.6	13.1	13.6	13.5	13.9	14.3
12H	13.4	13.8	13.8	14.2	14.6	13.0	13.5	13.4	13.8	14.2
8H 4H	13.4	13.9	13.8	14.3	14.6	13.1	13.6	13.5	13.9	14.3
6H	13.3	13.7	13.8	14.1	14.5	13.0	13.4	13.4	13.8	14.2
8H	13.3	13.6	13.7	14.0	14.5	12.9	13.3	13.4	13.7	14.1
12H	13.2	13.5	13.7	14.0	14.4	12.9	13.2	13.3	13.6	14.1
12H 4H	13.4	13.8	13.8	14.2	14.6	13.0	13.5	13.4	13.8	14.2
6H	13.3	13.6	13.7	14.0	14.5	12.9	13.3	13.4	13.7	14.1
8H	13.2	13.5	13.7	14.0	14.4	12.9	13.2	13.3	13.6	14.1
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.2 / -39.3					+ 5.2 / -38.7				
1.5H	+ 8.0 / -33.0					+ 8.0 / -32.9				
2.0H	+ 7.1 / -18.3					+ 7.0 / -17.1				

CIE Pub.117, 506.3 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -2.4)
Area: 0.005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	97	93	90	96	92	89	86
1.00	102	97	94	101	96	93	100	96	93	89
1.25	105	101	98	104	100	97	102	99	96	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	102	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	110	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

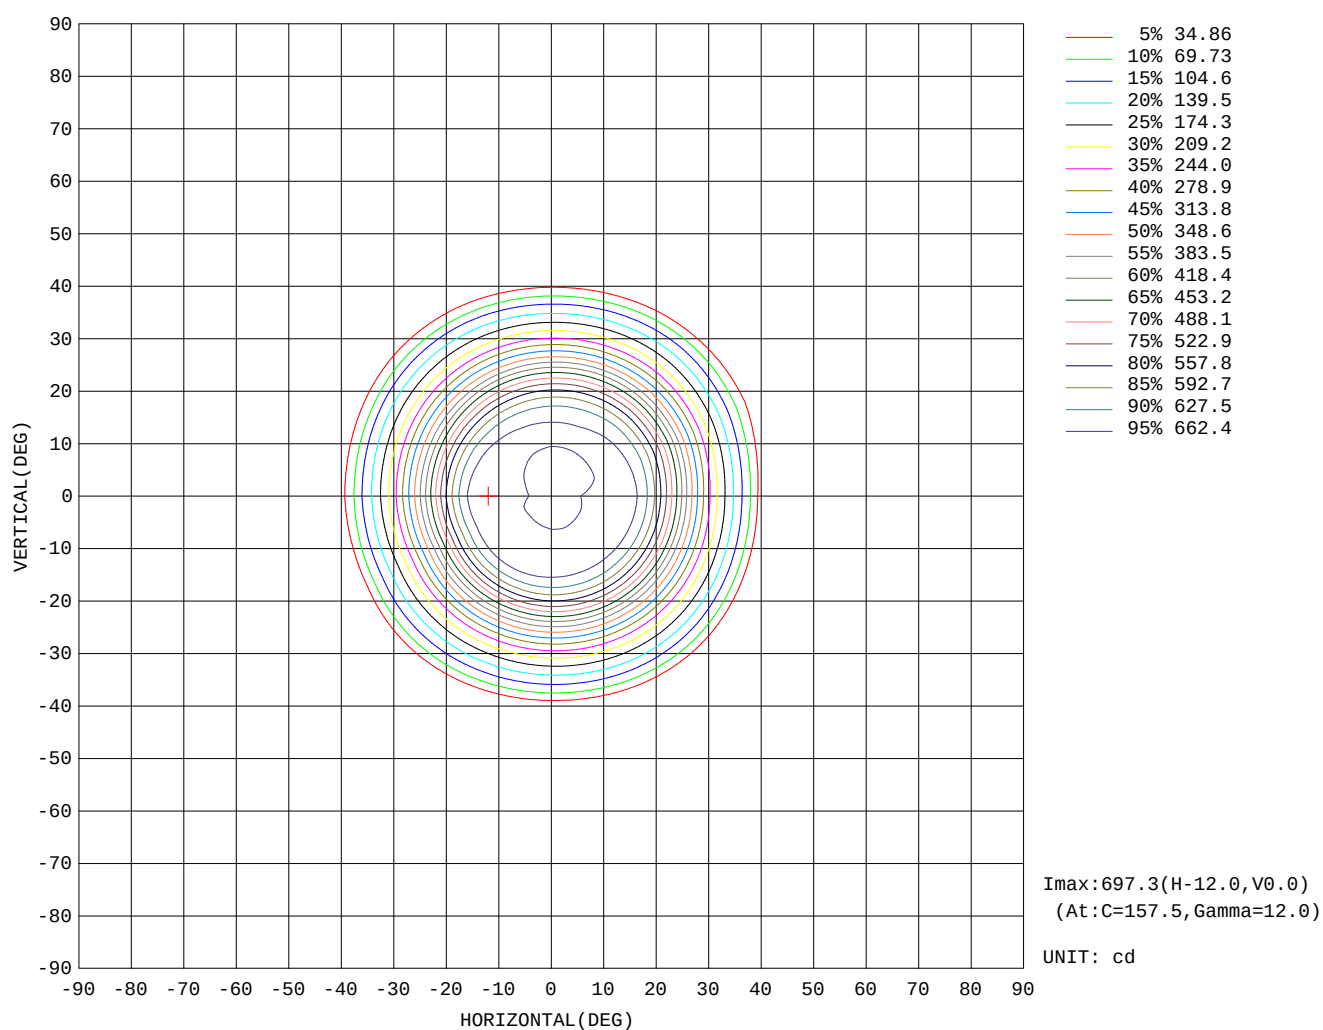

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

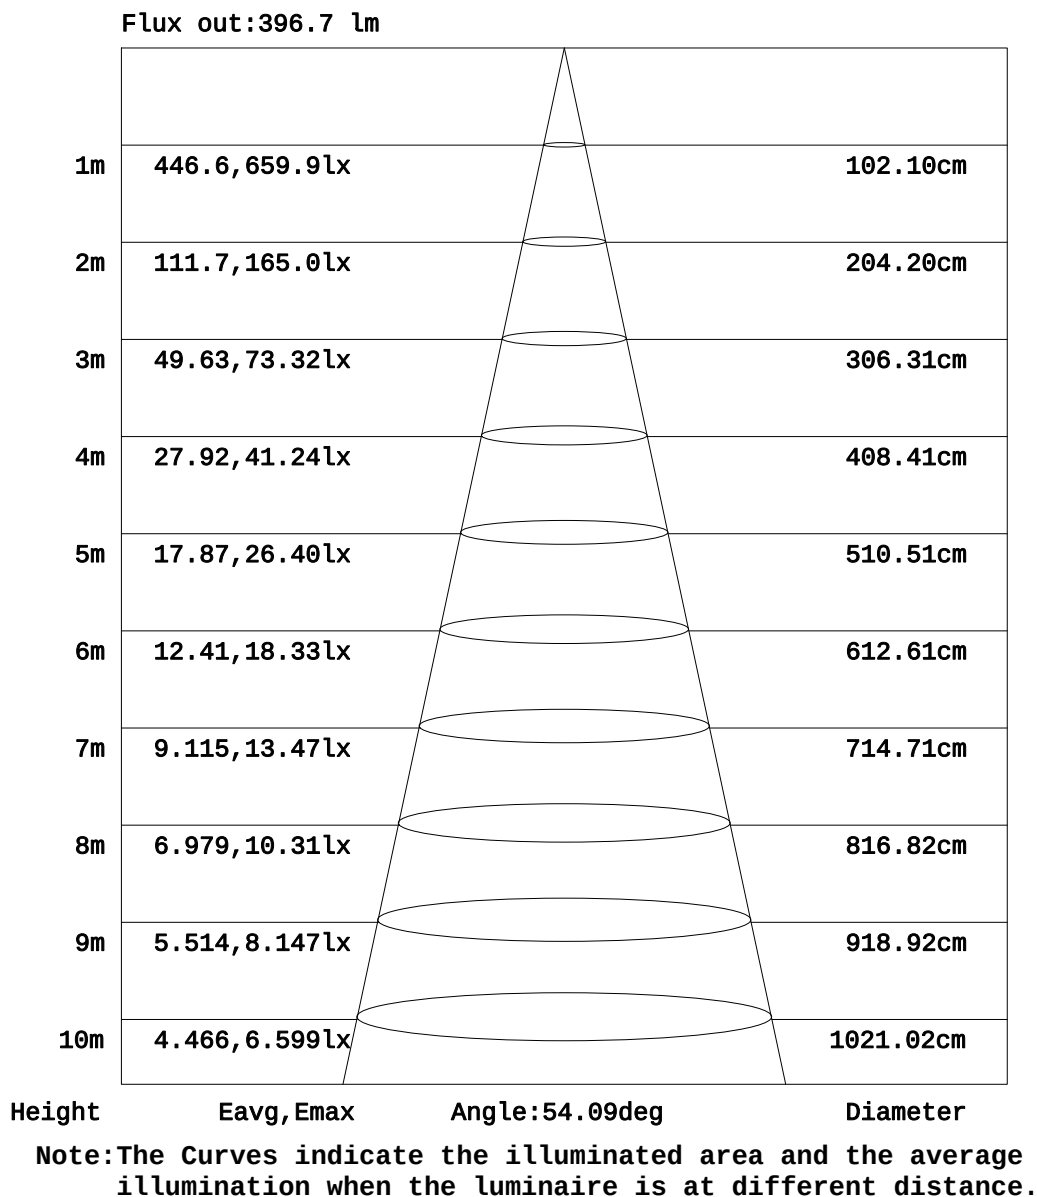

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

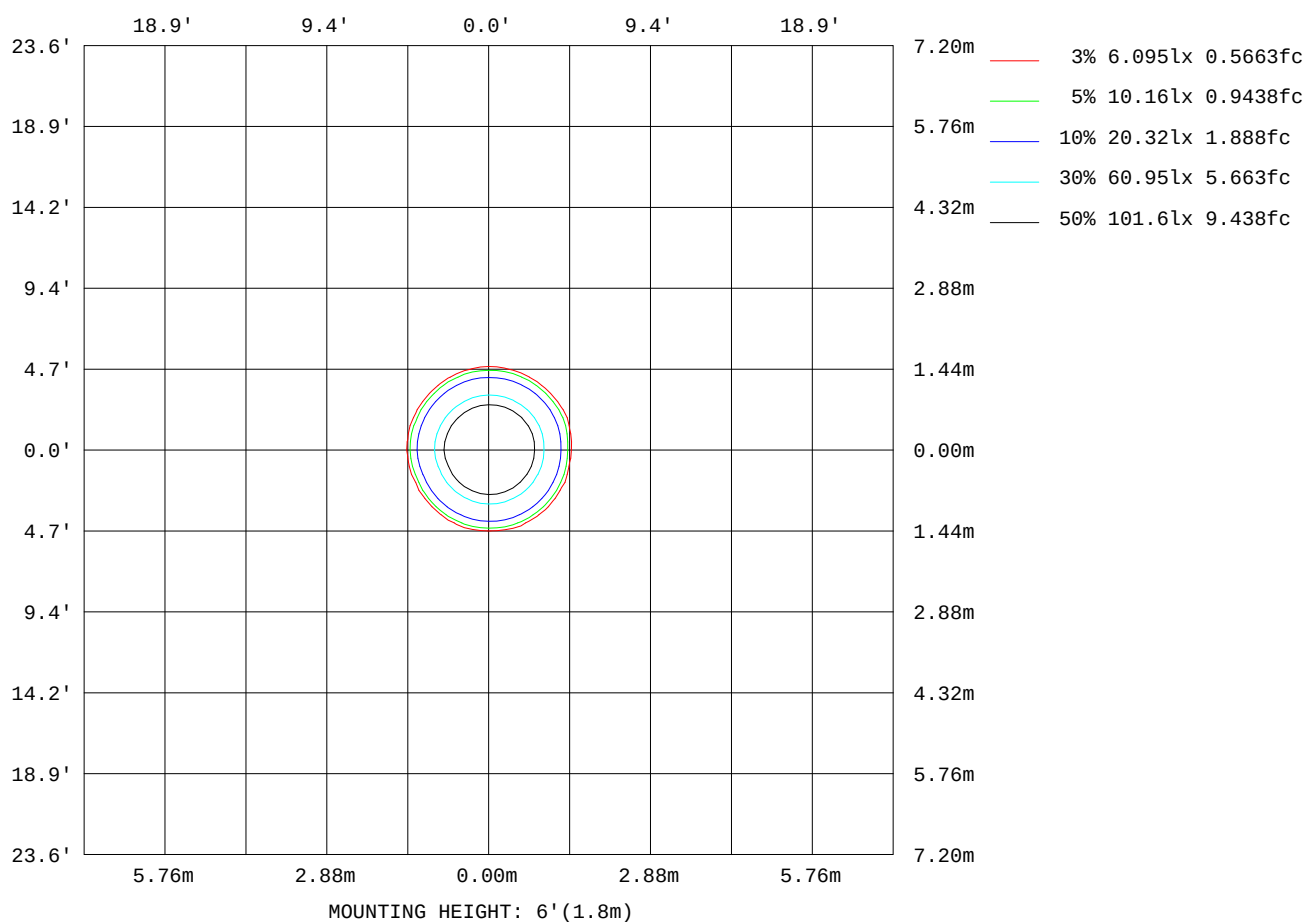

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.14V I:0.0926A P:10.302W PF:0.5051 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:506.307x1 Lm		
NAME: DDW31-LM10E-530SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	40
L_0~180(75)av	62
L_0~180(85)av	15
L_90~270(65)av	38
L_90~270(75)av	68
L_90~270(85)av	16
L_45(65)av	40
L_45(75)av	63
L_45(85)av	11

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

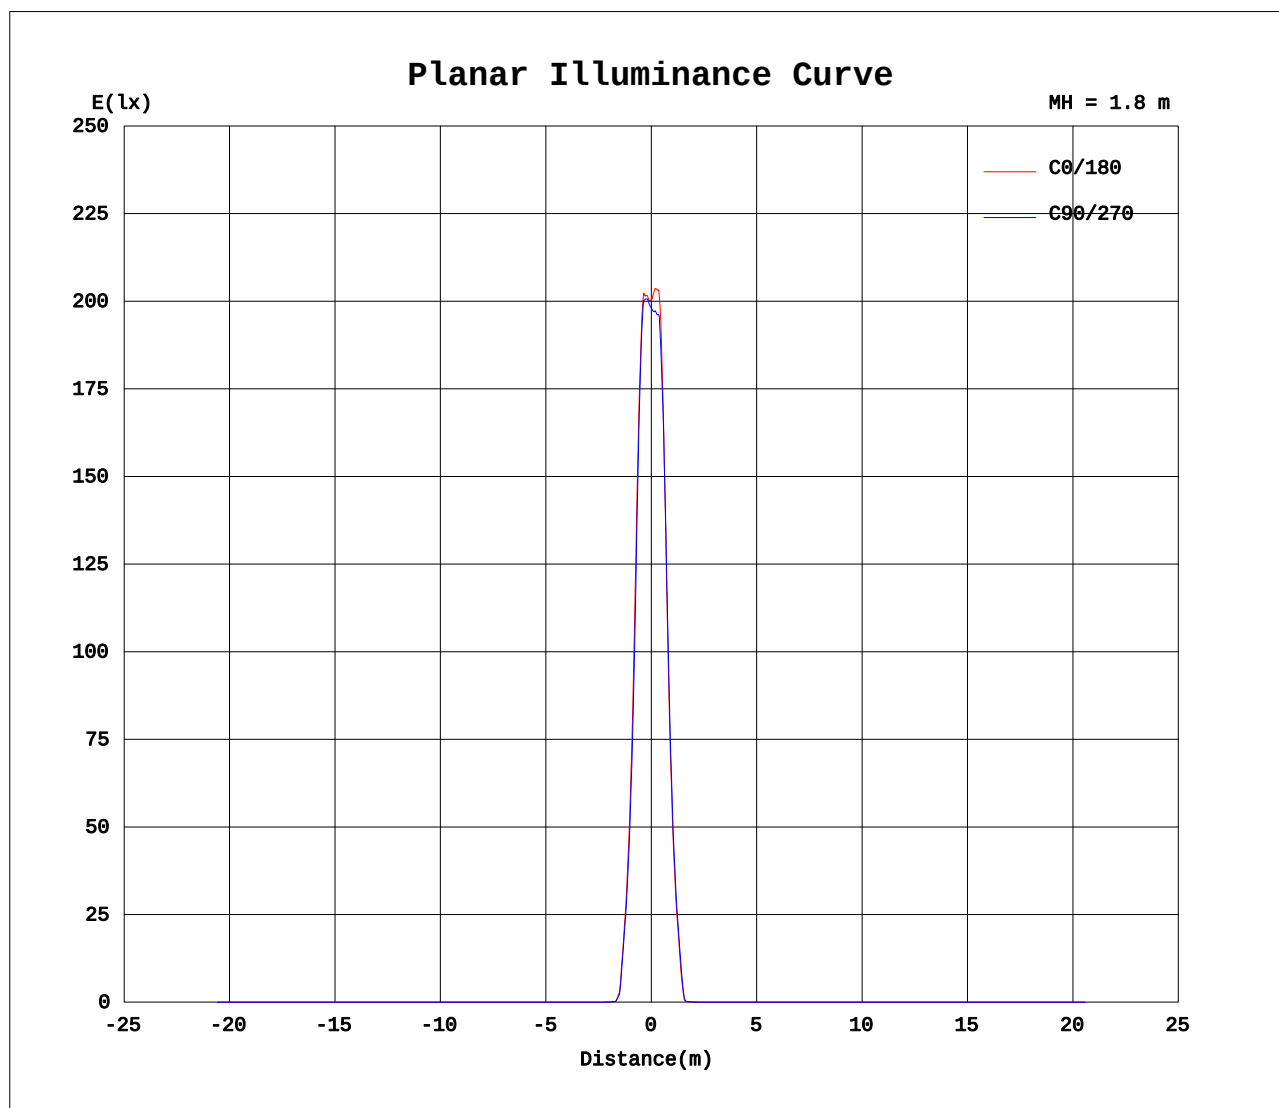

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	643	643	643	643	643	643	643	643	643	643	643	643	643	643	643	643			
5	653	654	654	656	658	660	663	664	660	658	654	649	647	647	649	649			
10	678	677	678	679	681	684	689	687	683	680	675	670	667	669	672	675			
15	673	672	668	669	670	673	674	673	672	663	657	652	654	658	668	675			
20	578	574	569	563	558	553	550	544	554	551	551	555	564	574	587	595			
25	409	403	396	388	381	373	368	363	379	380	382	390	402	414	426	432			
30	248	246	242	237	231	224	220	218	230	233	235	240	246	253	263	266			
35	132	132	130	128	123	118	114	112	124	126	129	133	136	139	143	143			
40	20.7	20.3	20.1	18.7	16.4	14.0	12.2	10.8	22.9	22.7	23.6	27.2	30.2	32.2	34.9	43.6			
45	1.82	1.77	1.72	1.66	1.63	1.55	1.48	1.44	1.52	1.54	1.58	1.62	1.67	1.68	1.75	1.88			
50	0.73	0.71	0.69	0.64	0.61	0.56	0.52	0.50	0.55	0.55	0.57	0.62	0.66	0.70	0.76	0.81			
55	0.13	0.12	0.12	0.11	0.10	0.09	0.08	0.08	0.10	0.09	0.09	0.10	0.12	0.13	0.15	0.17			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.14	0.15	0.16	0.15	0.14	0.13	0.14	0.14			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.15	0.15	0.15	0.16	0.17	0.16			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.14	0.14	0.15	0.16	0.16	0.15	0.13	0.13			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.15	0.15	0.16	0.18	0.17	0.15	0.15	0.16			
80	0.00	0.01	0.01	0.01	0.01	0.00	0.01	0.01	0.17	0.17	0.18	0.17	0.16	0.15	0.16	0.17			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: