


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.15V I:0.0516A P:5.0706W PF:0.4461 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:372.596x1 lm


NAME: DDW21-LM04E-330SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 73.48 lm/W
MODEL		Imax(cd)	1006	S/MH(C0/180)	0.57	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.58	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	372.60	η UP, DN(C0-180)	0.0, 52.0	
NOMINAL FLUX(lm)	372.596	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 48.0	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.60	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

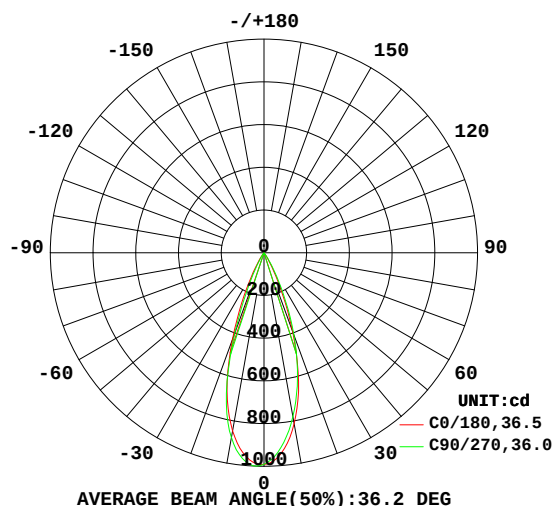

C0 PLANE ISOLUX DIAGRAM (UNIT: lx)

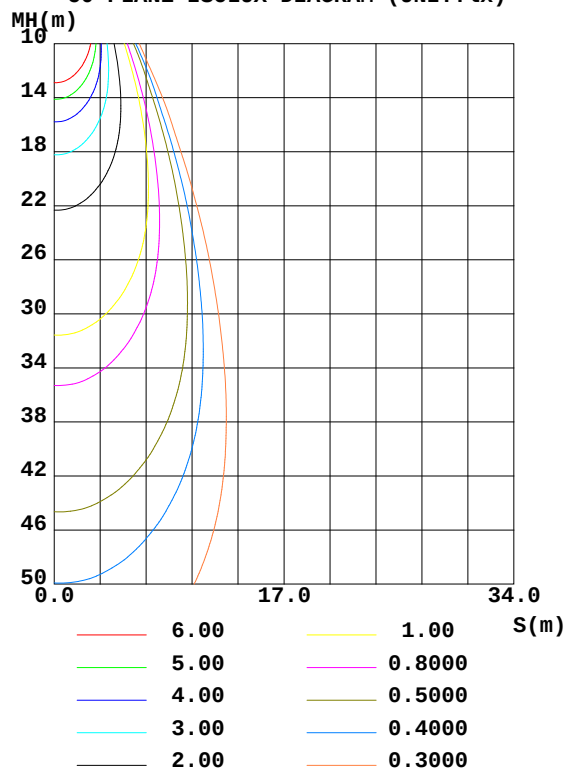

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	847.4	869.7	879.1	918.9	812.8	777.2	779.6	765.3	0- 10	86.86	86.86	23.3
20	433.5	420.4	396.8	492.0	392.6	392.8	410.7	356.8	10- 20	174.3	261.1	70.1
30	85.36	64.35	53.61	89.37	61.26	73.85	86.24	63.18	20- 30	94.13	355.2	95.3
40	5.537	4.142	3.275	5.582	3.775	4.748	5.906	3.895	30- 40	15.95	371.2	99.6
50	0.2635	0.2225	0.2120	0.3083	0.2408	0.2837	0.3161	0.2283	40- 50	1.104	372.3	99.9
60	0.0157	0.0109	0.0110	0.0173	0.1685	0.1737	0.1792	0.1460	50- 60	0.1073	372.4	99.9
70	0.0067	0.0080	0.0093	0.0077	0.1576	0.1609	0.1584	0.1637	60- 70	0.0793	372.5	100
80	0.0025	0.0046	0.0055	0.0047	0.1965	0.1942	0.1955	0.1071	70- 80	0.0928	372.6	100
90	0	0	0	0	0	0	0	0	80- 90	0.0205	372.6	100
100	0	0	0	0	0	0	0	0	90-100	0	372.6	100
110	0	0	0	0	0	0	0	0	100-110	0	372.6	100
120	0	0	0	0	0	0	0	0	110-120	0	372.6	100
130	0	0	0	0	0	0	0	0	120-130	0	372.6	100
140	0	0	0	0	0	0	0	0	130-140	0	372.6	100
150	0	0	0	0	0	0	0	0	140-150	0	372.6	100
160	0	0	0	0	0	0	0	0	150-160	0	372.6	100
170	0	0	0	0	0	0	0	0	160-170	0	372.6	100
180	0	0	0	0	0	0	0	0	170-180	0	372.6	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 372.08 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 372.4 lm


%lum = 99.9%

%lamp = 99.9%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

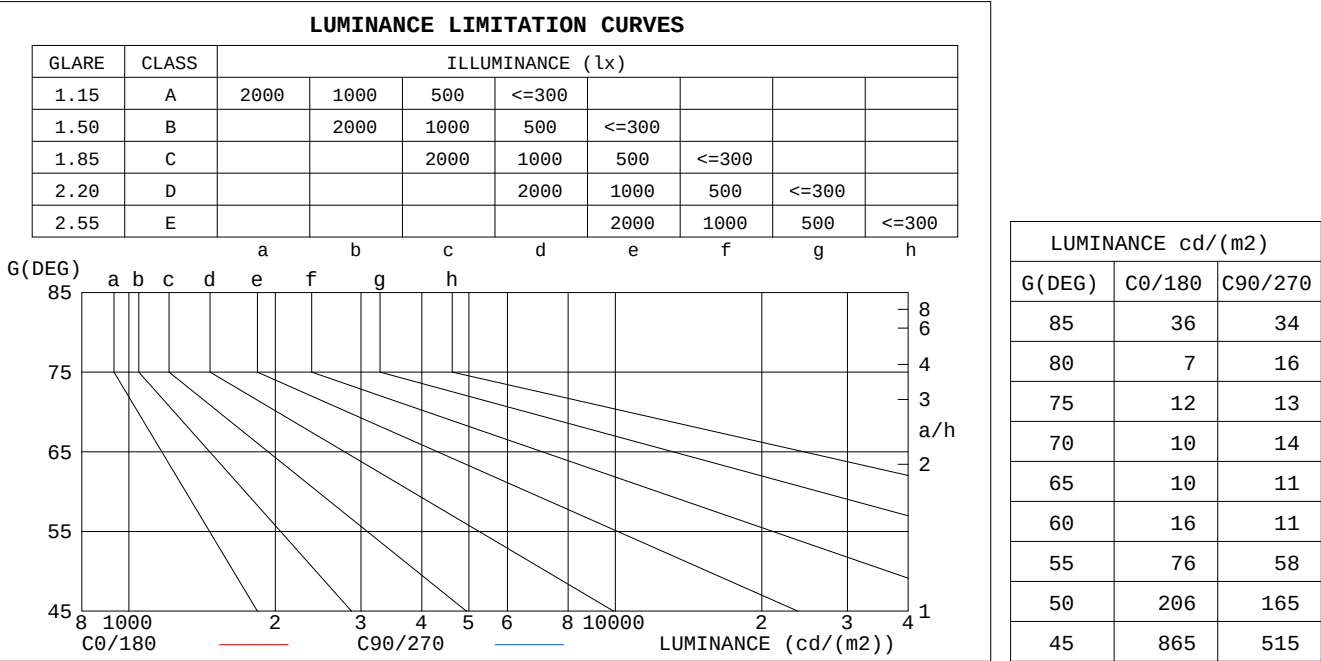


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.10	1.09	1.10	1.08	1.07	1.06	1.05	1.04	1.03	1.02	1.01	.99	.98	.98	.96
2.0	1.07	1.03	1.01	1.05	1.02	.00	1.02	.00	.98	.99	.97	.95	.96	.95	.93	.92
3.0	1.02	.98	.95	1.00	.97	.94	.98	.95	.92	.95	.93	.91	.93	.91	.90	.88
4.0	.97	.93	.89	.96	.92	.89	.94	.91	.88	.92	.89	.87	.90	.88	.86	.85
5.0	.93	.88	.85	.92	.88	.85	.90	.87	.84	.89	.86	.83	.87	.85	.83	.81
6.0	.89	.85	.81	.88	.84	.81	.87	.83	.80	.86	.82	.80	.85	.82	.79	.78
7.0	.86	.81	.78	.85	.81	.78	.84	.80	.77	.83	.79	.77	.82	.79	.76	.75
8.0	.82	.78	.75	.82	.78	.75	.81	.77	.74	.80	.77	.74	.79	.76	.74	.73
9.0	.79	.75	.72	.79	.75	.72	.78	.74	.72	.77	.74	.71	.77	.73	.71	.70
10.0	.77	.72	.69	.76	.72	.69	.76	.72	.69	.75	.71	.69	.74	.71	.69	.68

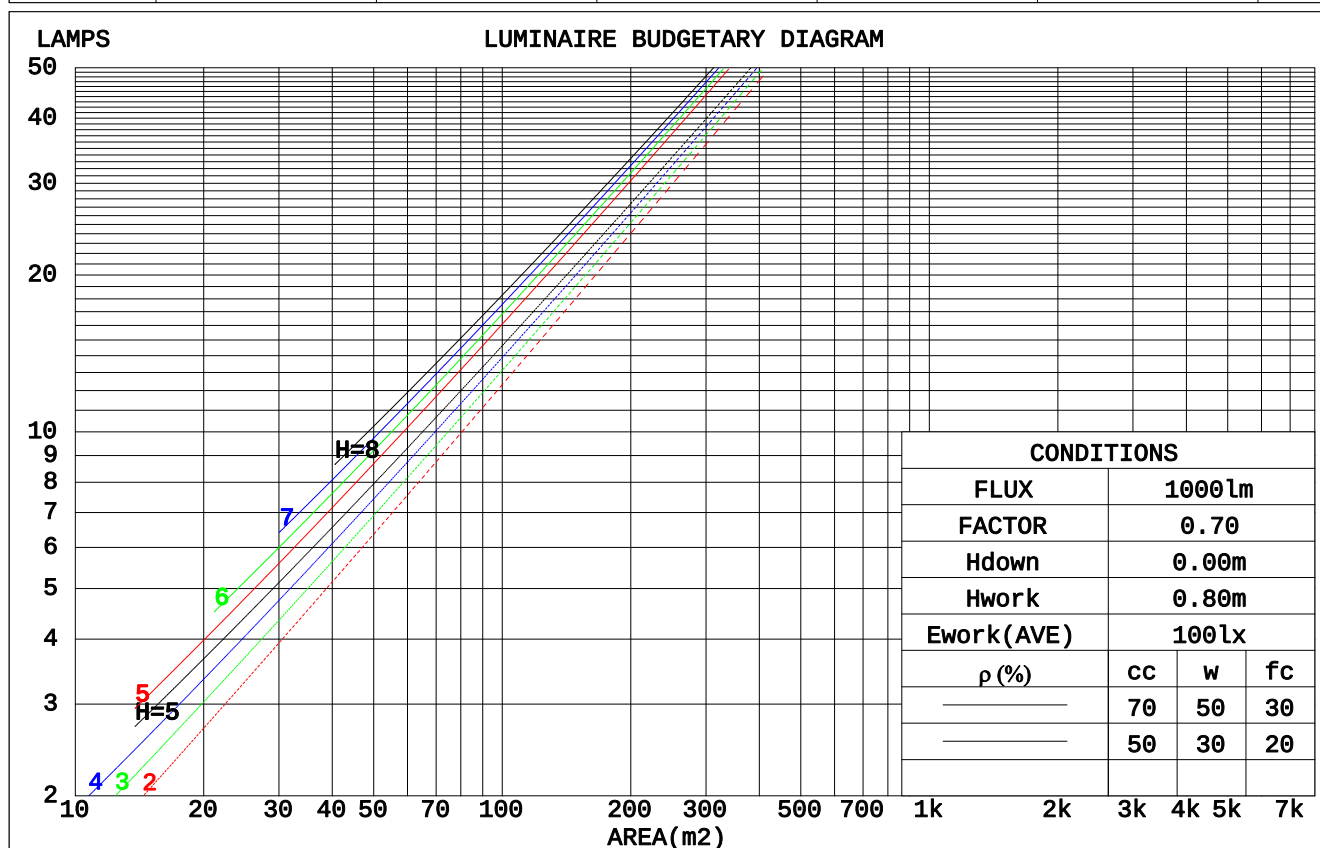

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ _{CC}	80%			70%			50%			30%			10%			0	
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ _{FC}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.146	.083	.026	.139	.079	.025	.127	.073	.023	.115	.066	.021	.105	.061	.020		
2.0	.136	.075	.023	.131	.072	.022	.120	.067	.021	.111	.062	.019	.102	.058	.018		
3.0	.128	.068	.020	.123	.066	.020	.114	.062	.019	.106	.058	.018	.099	.055	.017		
4.0	.120	.063	.018	.117	.061	.018	.109	.058	.017	.102	.055	.017	.096	.052	.016		
5.0	.114	.058	.017	.111	.057	.017	.105	.054	.016	.099	.052	.015	.093	.050	.015		
6.0	.109	.054	.016	.106	.053	.015	.100	.051	.015	.095	.049	.015	.090	.048	.014		
7.0	.104	.051	.015	.101	.050	.014	.096	.049	.014	.092	.047	.014	.088	.046	.013		
8.0	.099	.048	.014	.097	.048	.014	.093	.046	.013	.089	.045	.013	.085	.044	.013		
9.0	.095	.046	.013	.093	.045	.013	.090	.044	.013	.086	.043	.012	.083	.042	.012		
10.0	.092	.044	.012	.090	.043	.012	.086	.042	.012	.083	.041	.012	.080	.040	.012		

ρ _{CC}	80%			70%			50%			30%			10%			0
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ _{fC}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.147	.145	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.016	
2.0	.151	.133	.117	.130	.114	.101	.089	.079	.070	.051	.046	.041	.016	.015	.013	
3.0	.137	.113	.094	.118	.098	.082	.081	.068	.057	.047	.040	.034	.015	.013	.011	
4.0	.125	.098	.077	.107	.085	.067	.074	.059	.047	.043	.035	.028	.014	.011	.009	
5.0	.115	.086	.064	.099	.074	.056	.068	.052	.040	.039	.031	.023	.013	.010	.008	
6.0	.107	.076	.054	.092	.066	.047	.063	.046	.033	.037	.027	.020	.012	.009	.007	
7.0	.099	.068	.046	.086	.059	.040	.059	.041	.029	.034	.024	.017	.011	.008	.006	
8.0	.093	.062	.040	.080	.053	.035	.056	.037	.025	.032	.022	.015	.010	.007	.005	
9.0	.088	.056	.034	.076	.049	.030	.052	.034	.021	.031	.020	.013	.010	.007	.004	
10.0	.083	.051	.030	.072	.045	.026	.050	.031	.019	.029	.019	.011	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	7.4	8.1	7.6	8.2	8.4	5.3	6.0	5.5	6.2	6.3
3H	7.2	7.9	7.5	8.1	8.3	5.1	5.8	5.4	6.0	6.2
4H	7.1	7.8	7.4	8.0	8.2	5.0	5.7	5.3	5.9	6.1
6H	7.0	7.6	7.3	7.9	8.1	5.0	5.6	5.2	5.8	6.0
8H	7.0	7.6	7.3	7.8	8.1	4.9	5.5	5.2	5.7	6.0
12H	7.0	7.5	7.3	7.8	8.0	4.9	5.4	5.2	5.7	6.0
4H 2H	7.1	7.8	7.4	8.0	8.2	5.0	5.7	5.3	5.9	6.1
3H	7.0	7.5	7.3	7.8	8.0	4.9	5.4	5.2	5.7	6.0
4H	6.9	7.4	7.2	7.7	8.0	4.8	5.3	5.1	5.6	5.9
6H	6.8	7.2	7.1	7.5	7.9	4.7	5.1	5.0	5.5	5.8
8H	6.7	7.1	7.1	7.5	7.8	4.6	5.0	5.0	5.4	5.7
12H	6.7	7.0	7.1	7.4	7.8	4.6	4.9	5.0	5.3	5.7
8H 4H	6.7	7.1	7.1	7.5	7.8	4.6	5.0	5.0	5.4	5.7
6H	6.6	6.9	7.0	7.3	7.7	4.5	4.9	4.9	5.2	5.7
8H	6.5	6.8	7.0	7.3	7.7	4.5	4.8	4.9	5.2	5.6
12H	6.5	6.7	6.9	7.2	7.6	4.4	4.7	4.9	5.1	5.6
12H 4H	6.7	7.0	7.1	7.4	7.8	4.6	4.9	5.0	5.3	5.7
6H	6.5	6.8	7.0	7.3	7.7	4.5	4.8	4.9	5.2	5.6
8H	6.5	6.7	6.9	7.2	7.6	4.4	4.7	4.9	5.1	5.6
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.2 / -26.4					+ 5.1 / -23.7				
1.5H	+ 8.0 / -22.3					+ 7.8 / -20.1				
2.0H	+ 8.9 / -14.2					+ 7.7 / -11.3				

CIE Pub.117, 372.6 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -3.4)
Area: 0.002 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	89	86
1.00	102	97	94	101	97	94	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	105	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

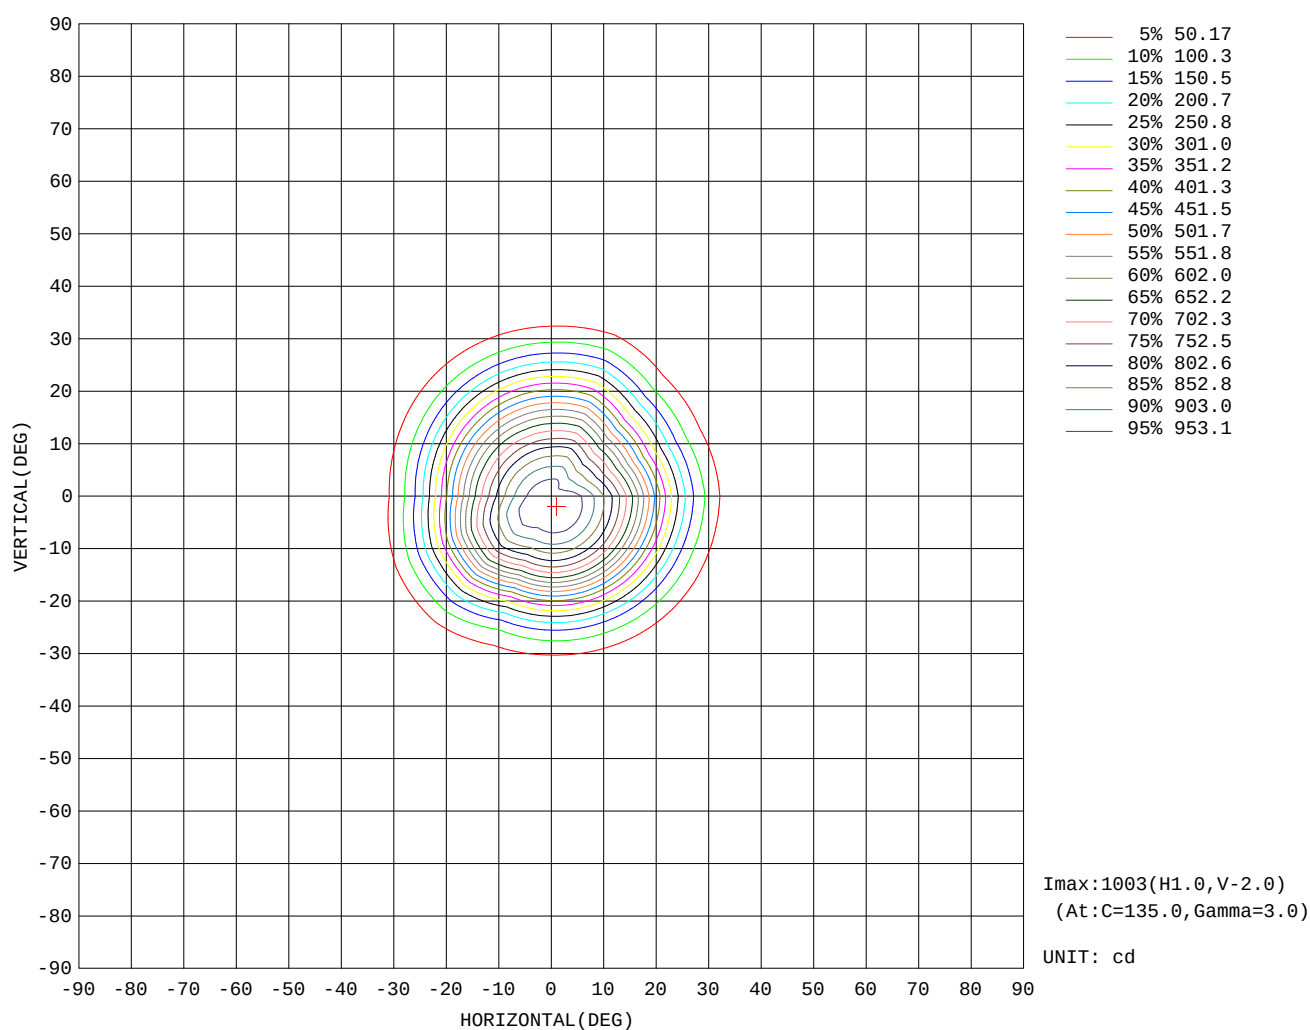

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

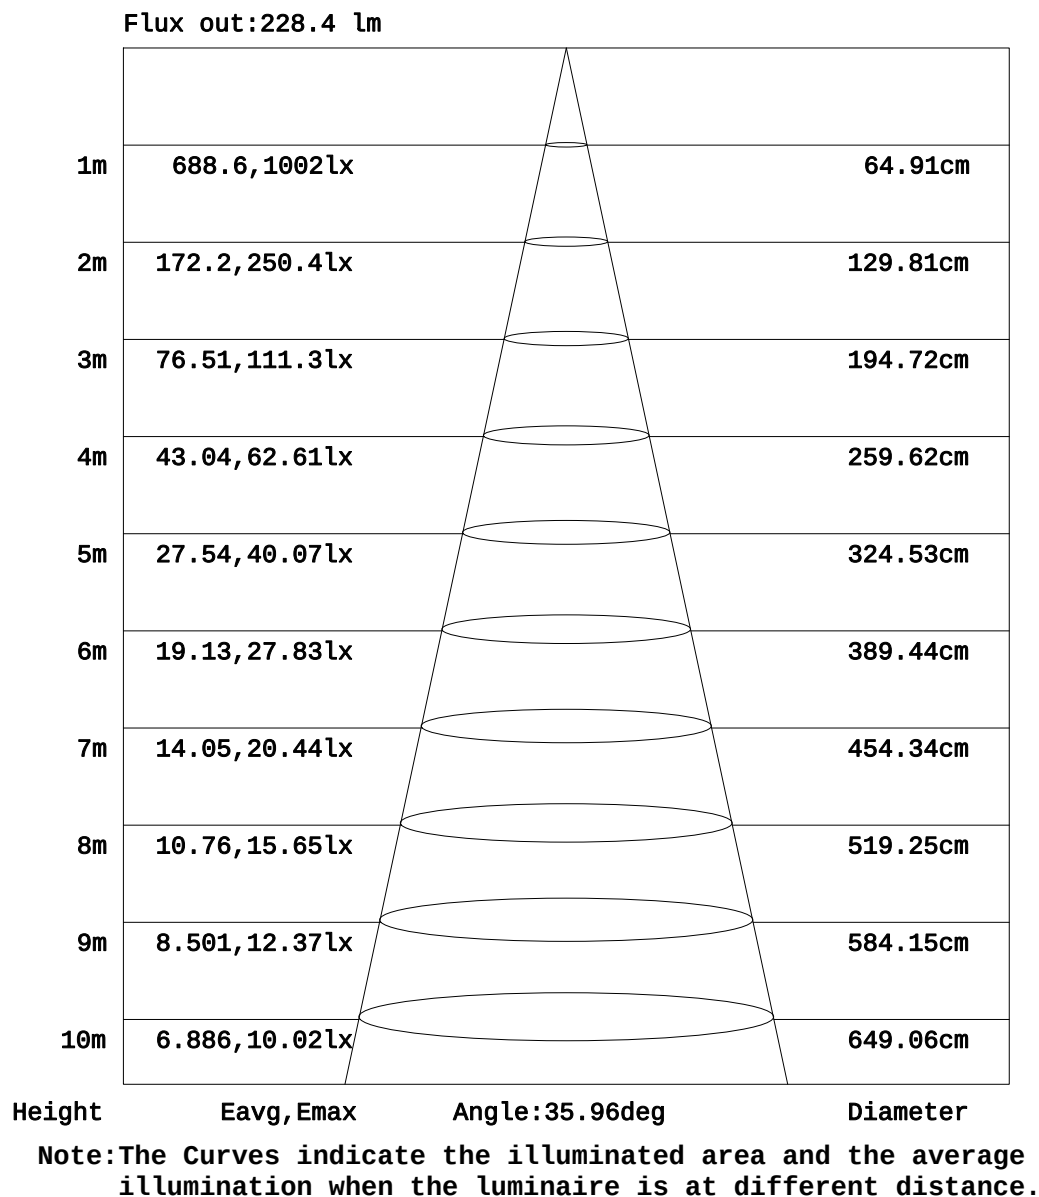

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

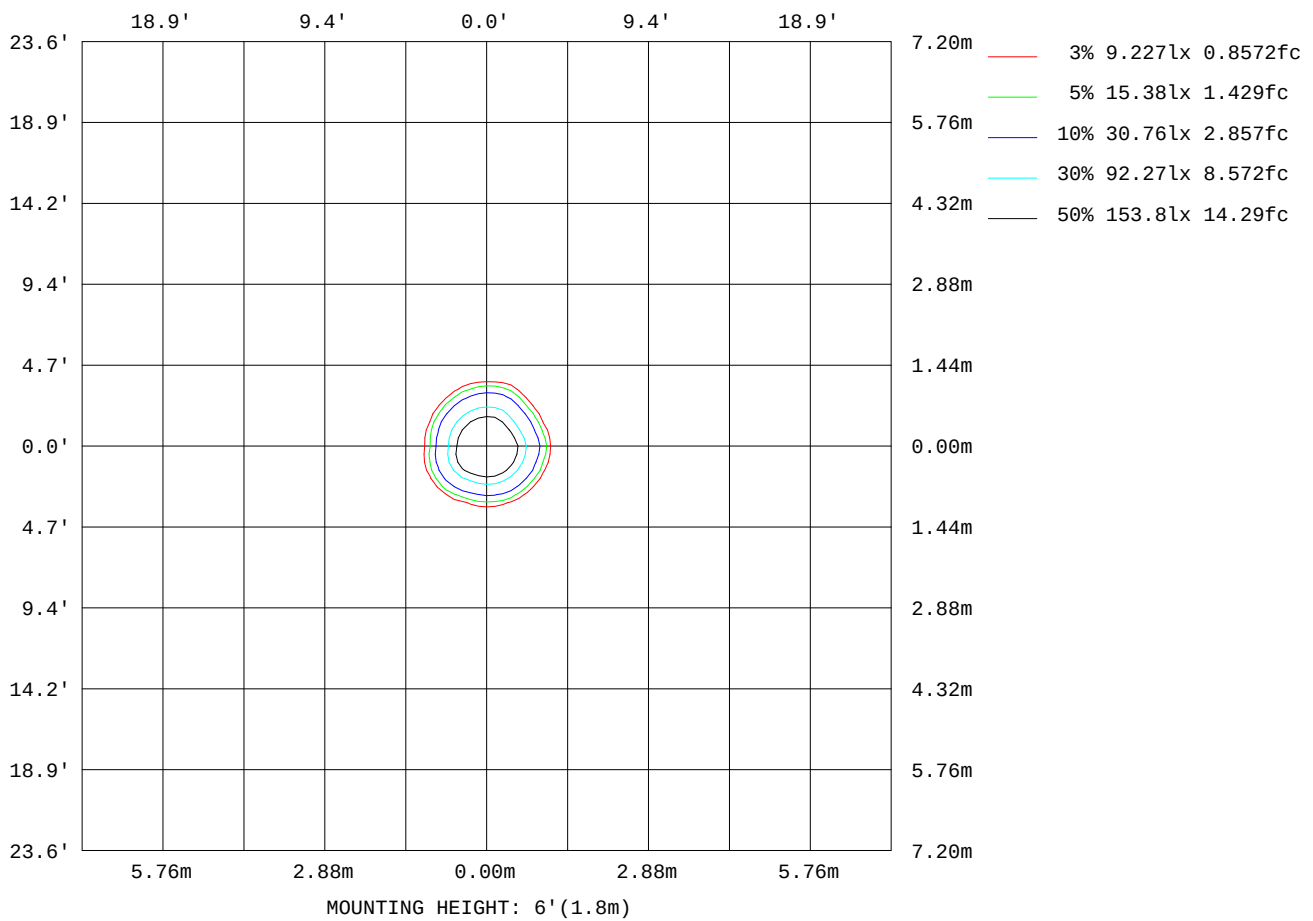

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.15V I:0.0516A P:5.0706W PF:0.4461 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:372.596x1 Lm		
NAME: DDW21-LM04E-330SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	99
L_0~180(75)av	174
L_0~180(85)av	28
L_90~270(65)av	100
L_90~270(75)av	173
L_90~270(85)av	31
L_45(65)av	99
L_45(75)av	188
L_45(85)av	26

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

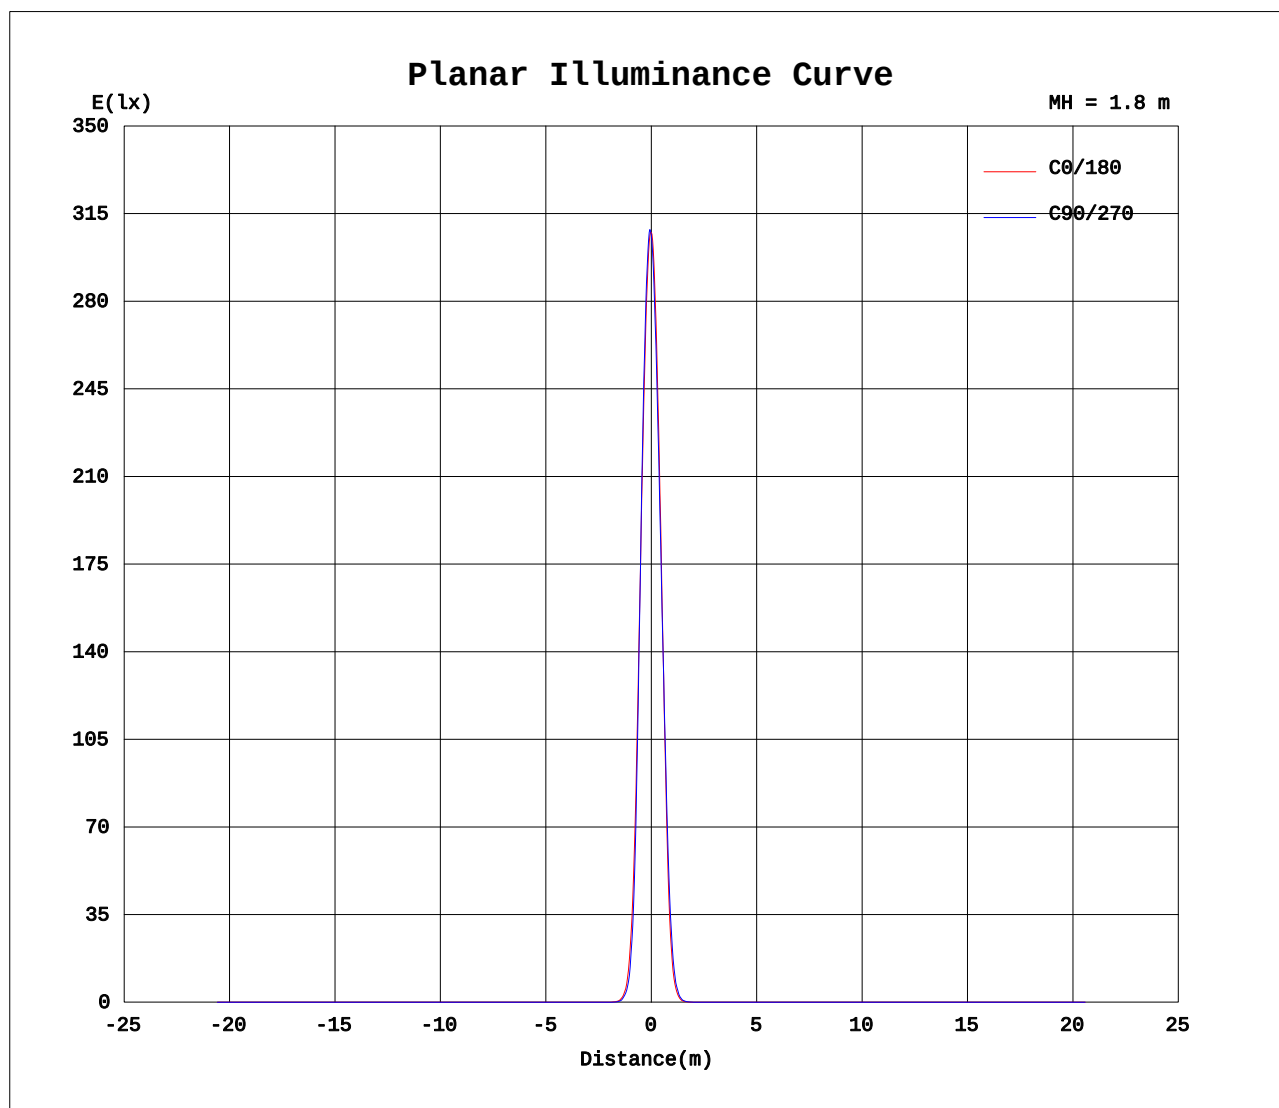

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	990	990	990	990	990	990	990	990	990	990	990	990	990	990	990	990			
5	958	969	978	983	982	976	1000	984	941	927	918	914	915	923	907	920			
10	847	860	870	879	879	870	919	891	813	790	777	775	780	797	765	786			
15	669	675	683	684	681	667	753	723	626	608	600	598	607	626	573	590			
20	433	428	420	410	397	384	492	480	393	391	393	401	411	424	357	362			
25	218	205	193	178	168	162	239	239	178	187	198	208	217	232	177	175			
30	85.4	72.5	64.3	57.6	53.6	54.8	89.4	90.8	61.3	66.7	73.8	80.7	86.2	94.7	63.2	61.9			
35	24.4	21.7	19.3	17.5	16.4	15.4	26.2	26.3	17.4	18.7	22.3	25.0	27.2	29.9	17.5	17.3			
40	5.54	4.80	4.14	3.62	3.27	3.02	5.58	5.74	3.78	4.19	4.75	5.36	5.91	6.46	3.90	3.81			
45	1.22	1.03	0.86	0.79	0.73	0.70	1.23	1.29	0.87	0.96	1.10	1.26	1.39	1.50	0.77	0.74			
50	0.26	0.24	0.22	0.22	0.21	0.21	0.31	0.32	0.24	0.26	0.28	0.30	0.32	0.33	0.23	0.21			
55	0.09	0.08	0.07	0.07	0.07	0.06	0.11	0.11	0.07	0.08	0.10	0.11	0.12	0.12	0.09	0.08			
60	0.02	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.17	0.17	0.17	0.18	0.18	0.18	0.15	0.14			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.15			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.18	0.18	0.17	0.17	0.18	0.20	0.20			
80	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.01	0.20	0.20	0.19	0.19	0.20	0.19	0.11	0.11			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.01	0.01	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: