


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.15V I:0.0514A P:5.0401W PF:0.4452 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:395.12x1 lm


NAME: DDW21-LM04E-530SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 78.39 lm/W
MODEL		Imax(cd)	770.4	S/MH(C0/180)	0.68	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.65	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	395.12	η UP, DN(C0-180)	0.0, 55.1	
NOMINAL FLUX(lm)	395.12	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 44.9	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.70	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

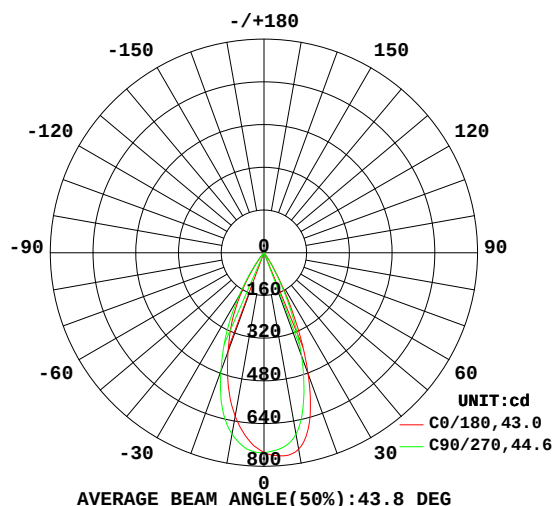

C0 PLANE ISOLUX DIAGRAM (UNIT: lx)

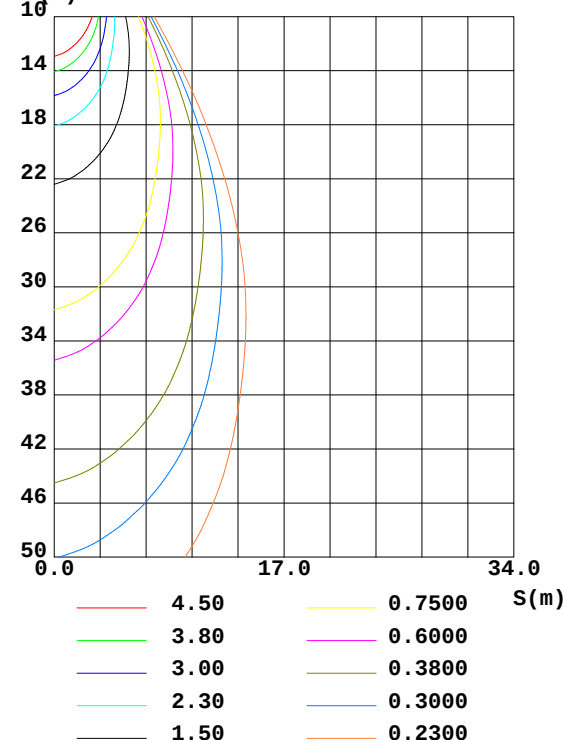

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	621.5	652.6	689.8	737.7	747.2	726.4	690.1	634.3	0- 10	68.66	68.66	17.4
20	394.5	440.0	472.6	520.3	484.3	417.4	412.3	385.0	10- 20	160.4	229.0	58
30	165.4	208.6	189.9	176.4	111.4	75.36	95.37	114.8	20- 30	127.9	356.9	90.3
40	14.52	22.69	17.31	13.49	4.335	2.662	3.366	5.216	30- 40	35.64	392.6	99.4
50	0.2306	0.5362	0.3483	0.2030	0.0850	0.0572	0.0767	0.1078	40- 50	2.266	394.8	99.9
60	0.0168	0.0269	0.0197	0.0141	0.1642	0.1368	0.1363	0.1402	50- 60	0.0877	394.9	100
70	0.0096	0.0075	0.0089	0.0081	0.1588	0.1596	0.1511	0.1475	60- 70	0.0822	395.0	100
80	0.0063	0.0062	0.0059	0.0064	0.1971	0.0176	0.0196	0.0173	70- 80	0.0928	395.1	100
90	0	0	0	0	0	0	0	0	80- 90	0.0082	395.1	100
100	0	0	0	0	0	0	0	0	90-100	0	395.1	100
110	0	0	0	0	0	0	0	0	100-110	0	395.1	100
120	0	0	0	0	0	0	0	0	110-120	0	395.1	100
130	0	0	0	0	0	0	0	0	120-130	0	395.1	100
140	0	0	0	0	0	0	0	0	130-140	0	395.1	100
150	0	0	0	0	0	0	0	0	140-150	0	395.1	100
160	0	0	0	0	0	0	0	0	150-160	0	395.1	100
170	0	0	0	0	0	0	0	0	160-170	0	395.1	100
180	0	0	0	0	0	0	0	0	170-180	0	395.1	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 394.51 lm

%lum = 99.8%

%lamp = 99.8%

Conical surface Flux(120deg): 394.94 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

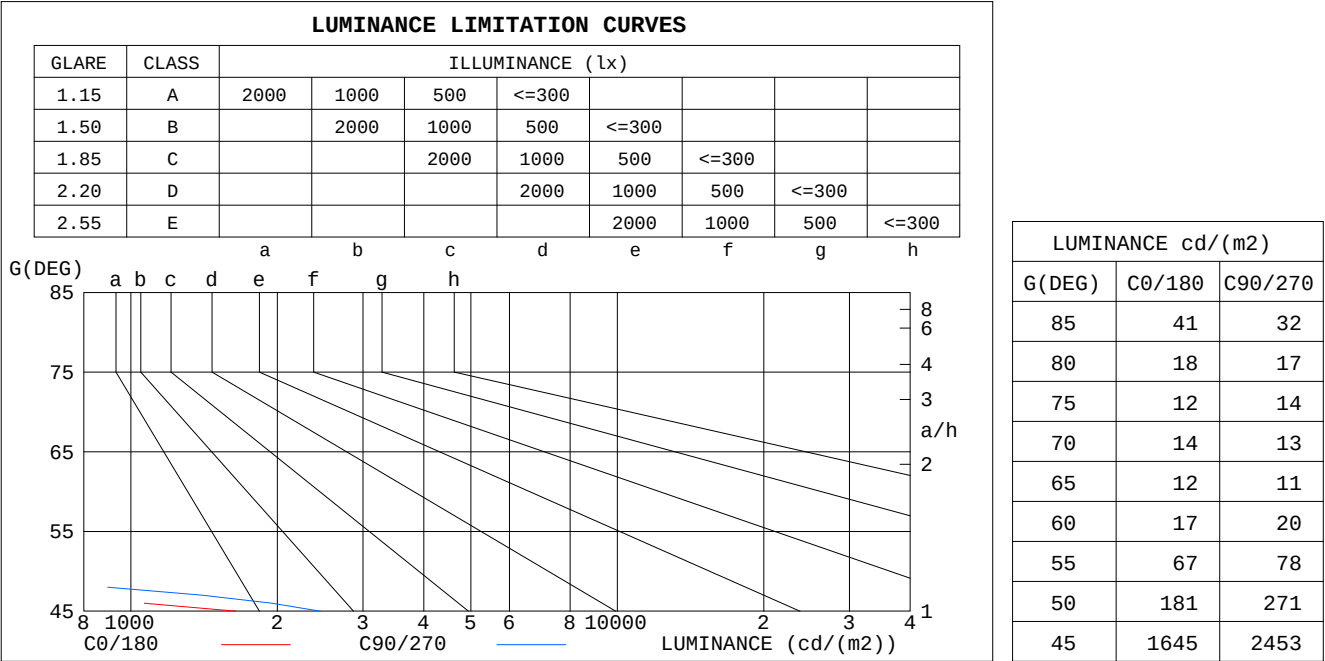

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.99	.99	.98	.97	.95
2.0	1.06	1.02	.99	1.04	1.01	.98	1.01	.98	.96	.98	.96	.94	.95	.94	.92	.91
3.0	.99	.96	.92	.99	.95	.92	.96	.93	.90	.94	.91	.89	.92	.89	.87	.86
4.0	.95	.90	.87	.94	.89	.86	.92	.88	.85	.90	.87	.84	.88	.85	.83	.82
5.0	.90	.85	.82	.89	.85	.81	.88	.84	.81	.86	.83	.80	.85	.82	.79	.78
6.0	.86	.81	.77	.85	.80	.77	.84	.80	.77	.82	.79	.76	.81	.78	.76	.74
7.0	.82	.77	.73	.81	.77	.73	.80	.76	.73	.79	.75	.72	.78	.75	.72	.71
8.0	.78	.73	.70	.78	.73	.70	.77	.73	.69	.76	.72	.69	.75	.72	.69	.68
9.0	.75	.70	.67	.75	.70	.67	.74	.69	.66	.73	.69	.66	.72	.69	.66	.65
10.0	.72	.67	.64	.71	.67	.64	.71	.66	.63	.70	.66	.63	.69	.66	.63	.62

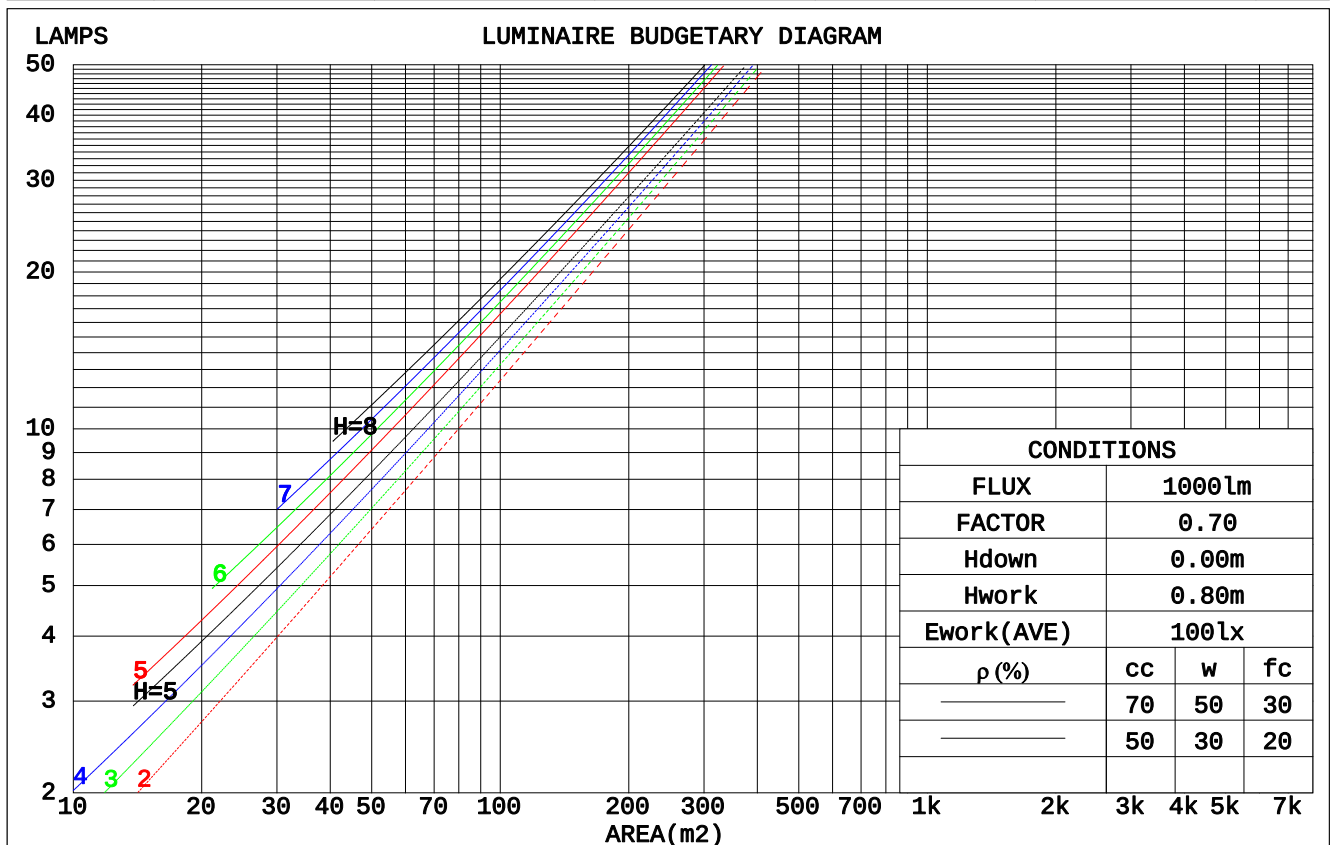

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.155	.088	.028	.149	.085	.027	.136	.078	.025	.125	.072	.023	.114	.066	.021	
2.0	.146	.080	.025	.141	.077	.024	.130	.072	.023	.121	.068	.021	.112	.063	.020	
3.0	.138	.073	.022	.133	.071	.022	.125	.068	.021	.117	.064	.020	.109	.060	.019	
4.0	.131	.068	.020	.127	.066	.020	.120	.063	.019	.113	.060	.018	.106	.058	.018	
5.0	.125	.063	.018	.121	.062	.018	.115	.060	.018	.109	.057	.017	.103	.055	.017	
6.0	.119	.060	.017	.116	.059	.017	.110	.057	.016	.105	.055	.016	.100	.053	.016	
7.0	.114	.056	.016	.111	.055	.016	.106	.054	.015	.102	.052	.015	.097	.050	.015	
8.0	.109	.053	.015	.107	.053	.015	.102	.051	.015	.098	.050	.014	.094	.048	.014	
9.0	.105	.051	.014	.103	.050	.014	.099	.049	.014	.095	.048	.014	.092	.047	.013	
10.0	.101	.048	.013	.099	.048	.013	.095	.047	.013	.092	.046	.013	.089	.045	.013	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.158	.147	.145	.135	.126	.099	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.153	.133	.116	.131	.114	.100	.090	.079	.070	.052	.046	.041	.017	.015	.013	
3.0	.139	.113	.093	.119	.098	.081	.082	.068	.057	.047	.040	.033	.015	.013	.011	
4.0	.128	.098	.076	.110	.085	.066	.075	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.118	.086	.063	.102	.075	.055	.070	.052	.039	.041	.031	.023	.013	.010	.008	
6.0	.110	.077	.053	.095	.066	.046	.065	.047	.033	.038	.027	.019	.012	.009	.006	
7.0	.103	.069	.045	.089	.060	.039	.061	.042	.028	.036	.025	.016	.012	.008	.005	
8.0	.097	.062	.038	.084	.054	.034	.058	.038	.024	.034	.022	.014	.011	.007	.005	
9.0	.092	.057	.033	.079	.050	.029	.055	.035	.021	.032	.021	.012	.010	.007	.004	
10.0	.088	.053	.029	.076	.046	.026	.052	.032	.018	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	15.8	16.6	16.0	16.8	16.9	15.4	16.2	15.6	16.3	16.5
3H	15.7	16.4	15.9	16.6	16.8	15.2	16.0	15.5	16.2	16.4
4H	15.6	16.3	15.9	16.5	16.7	15.2	15.8	15.4	16.1	16.3
6H	15.5	16.2	15.8	16.4	16.6	15.1	15.7	15.4	16.0	16.2
8H	15.5	16.1	15.8	16.3	16.6	15.0	15.6	15.3	15.9	16.2
12H	15.4	16.0	15.7	16.3	16.5	15.0	15.6	15.3	15.8	16.1
4H 2H	15.6	16.3	15.9	16.5	16.7	15.2	15.8	15.4	16.1	16.3
3H	15.4	16.0	15.7	16.3	16.5	15.0	15.6	15.3	15.8	16.1
4H	15.3	15.9	15.7	16.2	16.5	14.9	15.4	15.2	15.7	16.0
6H	15.2	15.7	15.6	16.0	16.4	14.8	15.3	15.2	15.6	15.9
8H	15.2	15.6	15.6	16.0	16.3	14.7	15.2	15.1	15.5	15.9
12H	15.1	15.5	15.5	15.9	16.3	14.7	15.1	15.1	15.5	15.8
8H 4H	15.2	15.6	15.6	16.0	16.3	14.7	15.2	15.1	15.5	15.9
6H	15.1	15.4	15.5	15.8	16.2	14.6	15.0	15.0	15.4	15.8
8H	15.0	15.3	15.4	15.7	16.2	14.6	14.9	15.0	15.3	15.7
12H	14.9	15.2	15.4	15.7	16.1	14.5	14.8	15.0	15.2	15.7
12H 4H	15.1	15.5	15.5	15.9	16.3	14.7	15.1	15.1	15.5	15.8
6H	15.0	15.3	15.4	15.7	16.2	14.6	14.9	15.0	15.3	15.7
8H	14.9	15.2	15.4	15.7	16.1	14.5	14.8	15.0	15.2	15.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 3.3 / -34.3					+ 4.4 / -33.6				
1.5H	+ 6.1 / -28.6					+ 7.1 / -28.7				
2.0H	+ 7.8 / -20.5					+ 8.0 / -21.3				

CIE Pub.117, 395.1 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -3.2$)
Area: 0.002 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	97	93	90	96	92	89	86
1.00	102	97	94	101	96	93	100	96	93	89
1.25	105	101	98	104	100	97	102	99	96	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	102	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	110	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

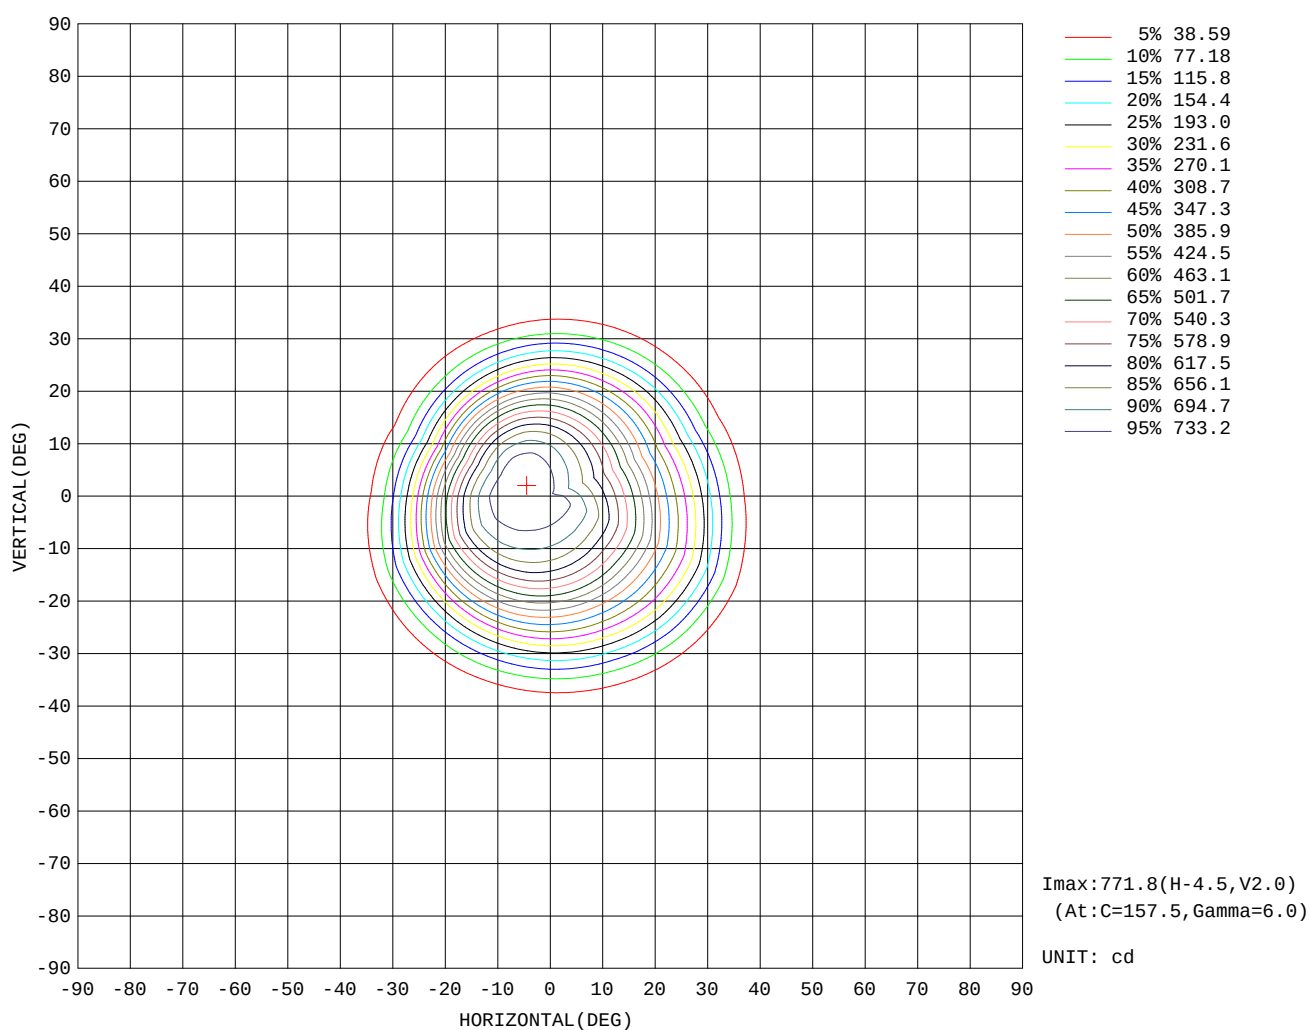

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

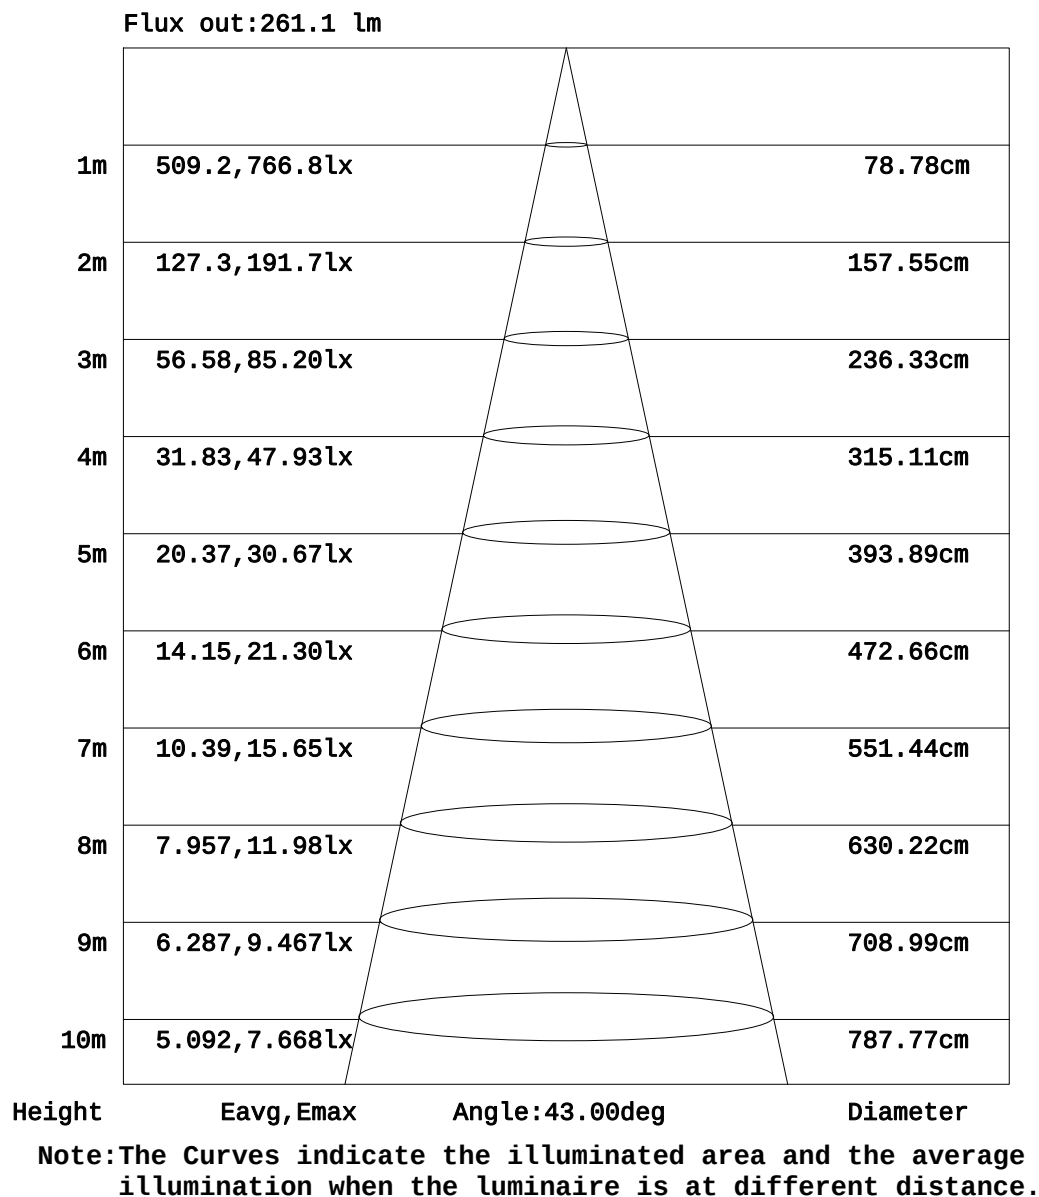

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

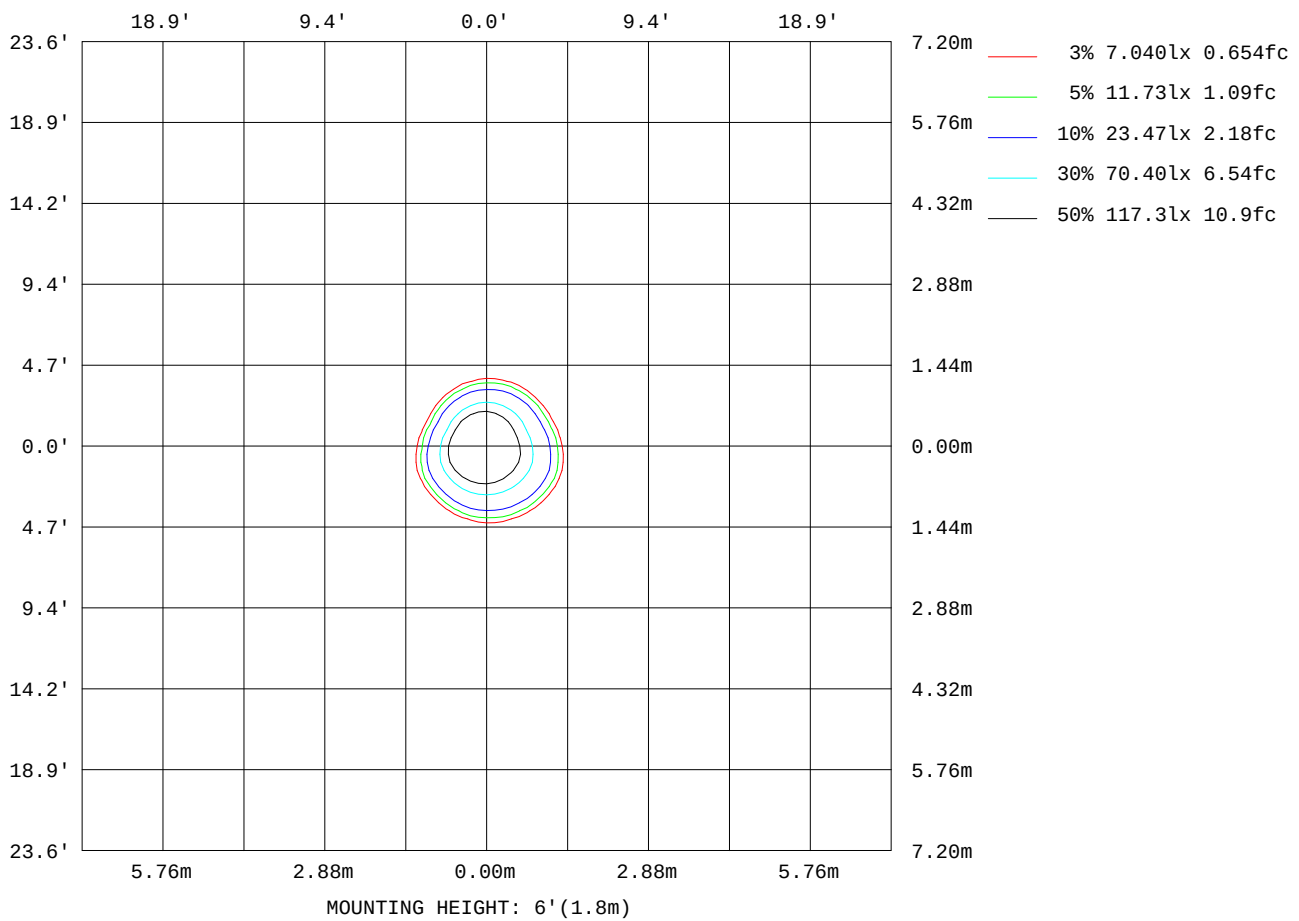

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.15V I:0.0514A P:5.0401W PF:0.4452 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:395.12x1 lm

NAME: DDW21-LM04E-530SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	109
L_0~180(75)av	172
L_0~180(85)av	35
L_90~270(65)av	89
L_90~270(75)av	203
L_90~270(85)av	28
L_45(65)av	90
L_45(75)av	203
L_45(85)av	31

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

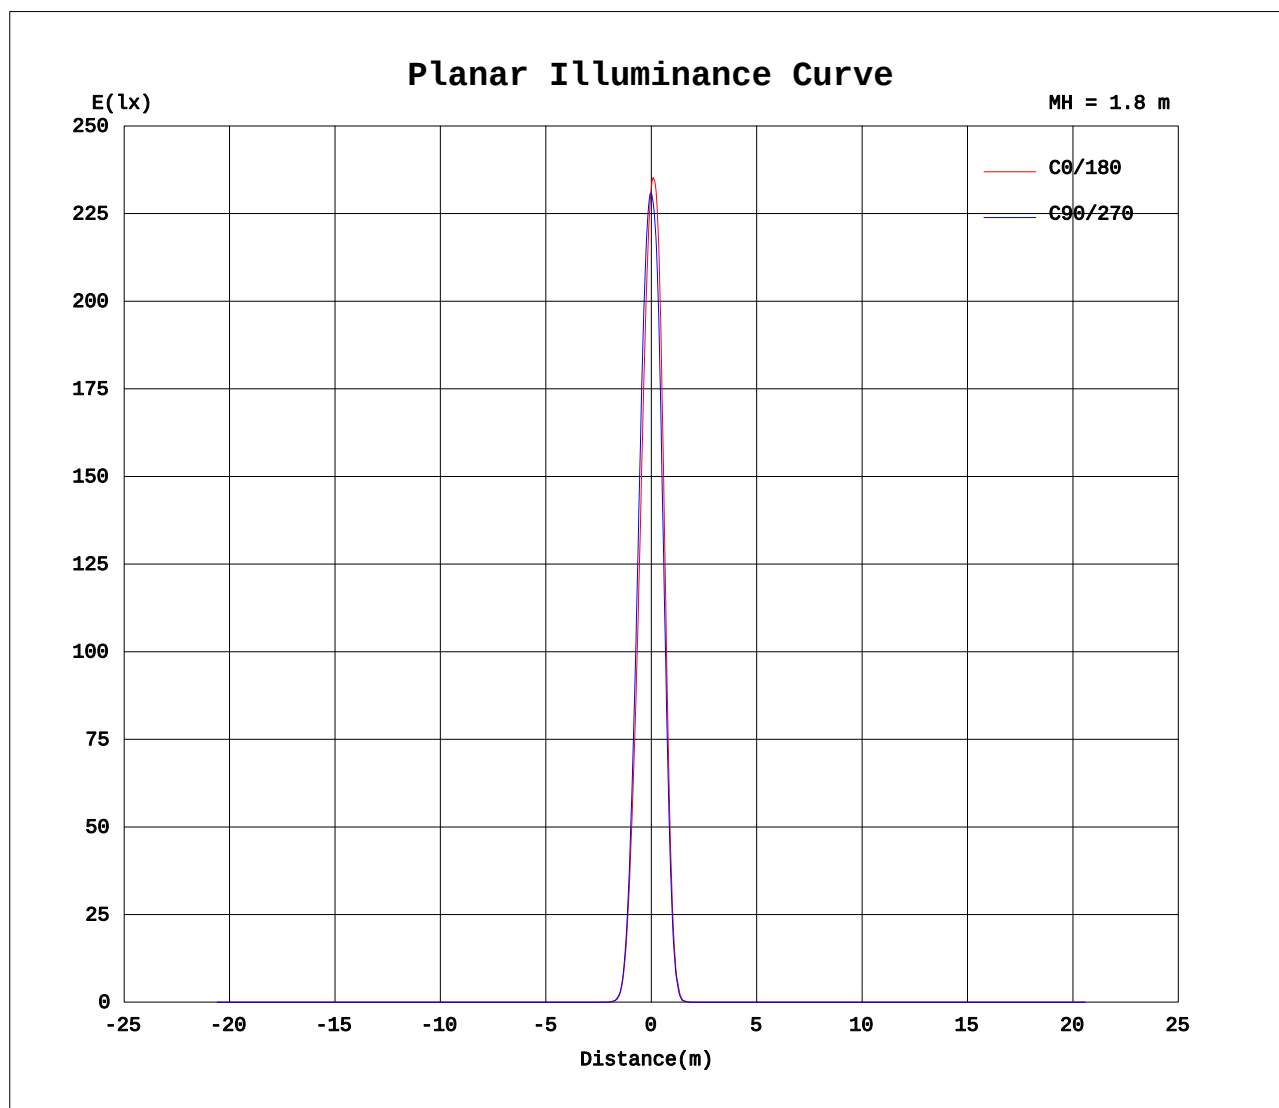

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	748	748	748	748	748	748	748	748	748	748	748	748	748	748	748	748			
5	700	713	717	726	738	750	761	770	764	759	757	749	735	719	705	694			
10	622	645	653	669	690	713	738	759	747	724	726	715	690	660	634	613			
15	517	548	558	579	603	632	664	694	658	604	608	597	574	546	520	498			
20	395	434	440	455	473	494	520	546	484	411	417	417	412	399	385	370			
25	282	324	326	326	334	340	346	353	278	205	213	224	237	242	248	245			
30	165	213	209	195	190	183	176	171	111	68.8	75.4	85.1	95.4	104	115	122			
35	64.7	98.8	92.9	79.8	73.3	65.8	60.4	56.3	32.1	15.7	17.9	22.7	26.4	29.8	34.3	39.8			
40	14.5	26.0	22.7	19.7	17.3	14.5	13.5	13.1	4.33	2.61	2.66	2.46	3.37	4.15	5.22	7.17			
45	2.31	4.21	4.03	3.98	3.47	2.35	2.19	2.00	0.51	0.19	0.23	0.27	0.52	0.88	1.13	1.39			
50	0.23	0.65	0.54	0.46	0.35	0.26	0.20	0.16	0.08	0.05	0.06	0.06	0.08	0.09	0.11	0.13			
55	0.08	0.12	0.11	0.10	0.09	0.07	0.06	0.05	0.03	0.05	0.05	0.05	0.06	0.07	0.07	0.08			
60	0.02	0.03	0.03	0.02	0.02	0.02	0.01	0.01	0.16	0.13	0.14	0.13	0.14	0.14	0.14	0.14			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.14	0.14	0.14	0.14	0.14	0.14	0.15			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.15	0.15	0.15	0.15	0.14			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.20	0.20	0.20	0.20	0.21	0.21	0.21			
80	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.20	0.02	0.02	0.02	0.02	0.02	0.02	0.02			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.01	0.00	0.01	0.01	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: