


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.14V I:0.0629A P:6.3773W PF:0.4609 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:330.319x1 lm


NAME: DDW21-LM07E-130SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 51.80 lm/W			
MODEL		Imax(cd)	3078	S/MH(C0/180)	0.27
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.30
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	330.32	η UP, DN(C0-180)	0.0, 49.5
NOMINAL FLUX(lm)	330.319	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 50.5
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	1.00

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

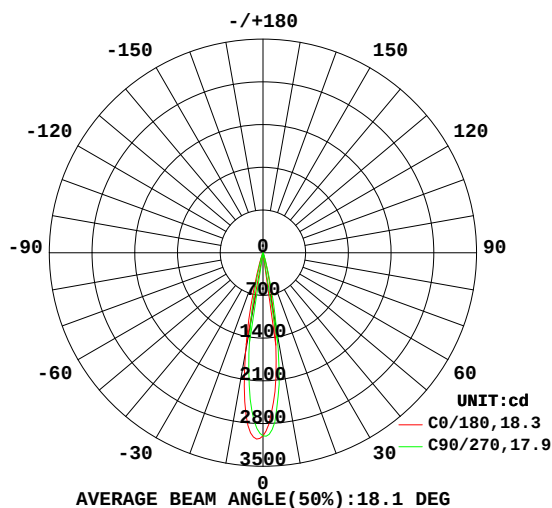

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

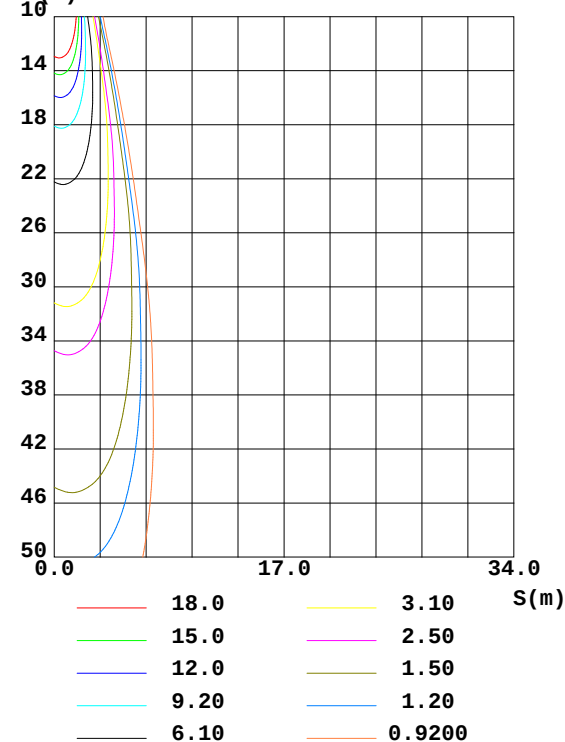

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	1657	1438	1168	958.8	977.5	1069	1308	1619	0- 10	199.7	199.7	60.4
20	108.0	92.04	64.20	50.46	51.75	52.00	65.77	91.27	10- 20	109.4	309.1	93.6
30	17.23	15.29	13.86	12.54	11.75	12.14	14.40	17.06	20- 30	14.21	323.3	97.9
40	5.116	4.755	3.992	3.510	3.647	4.021	4.735	5.490	30- 40	5.372	328.7	99.5
50	0.5907	0.4264	0.3071	0.3098	0.3048	0.3197	0.5193	0.5563	40- 50	1.326	330.0	99.9
60	0.0173	0.0096	0.0089	0.0080	0.1656	0.1685	0.1747	0.1821	50- 60	0.1384	330.1	99.9
70	0.0067	0.0071	0.0080	0.0076	0.1484	0.1518	0.1491	0.1492	60- 70	0.0784	330.2	100
80	0.0042	0.0038	0.0046	0.0051	0.1952	0.1904	0.1884	0.1878	70- 80	0.0930	330.3	100
90	0	0	0	0	0	0	0	0	80- 90	0.0226	330.3	100
100	0	0	0	0	0	0	0	0	90-100	0	330.3	100
110	0	0	0	0	0	0	0	0	100-110	0	330.3	100
120	0	0	0	0	0	0	0	0	110-120	0	330.3	100
130	0	0	0	0	0	0	0	0	120-130	0	330.3	100
140	0	0	0	0	0	0	0	0	130-140	0	330.3	100
150	0	0	0	0	0	0	0	0	140-150	0	330.3	100
160	0	0	0	0	0	0	0	0	150-160	0	330.3	100
170	0	0	0	0	0	0	0	0	160-170	0	330.3	100
180	0	0	0	0	0	0	0	0	170-180	0	330.3	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 329.64 lm

%lum = 99.8%

%lamp = 99.8%

Conical surface Flux(120deg): 330.13 lm


%lum = 99.9%

%lamp = 99.9%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

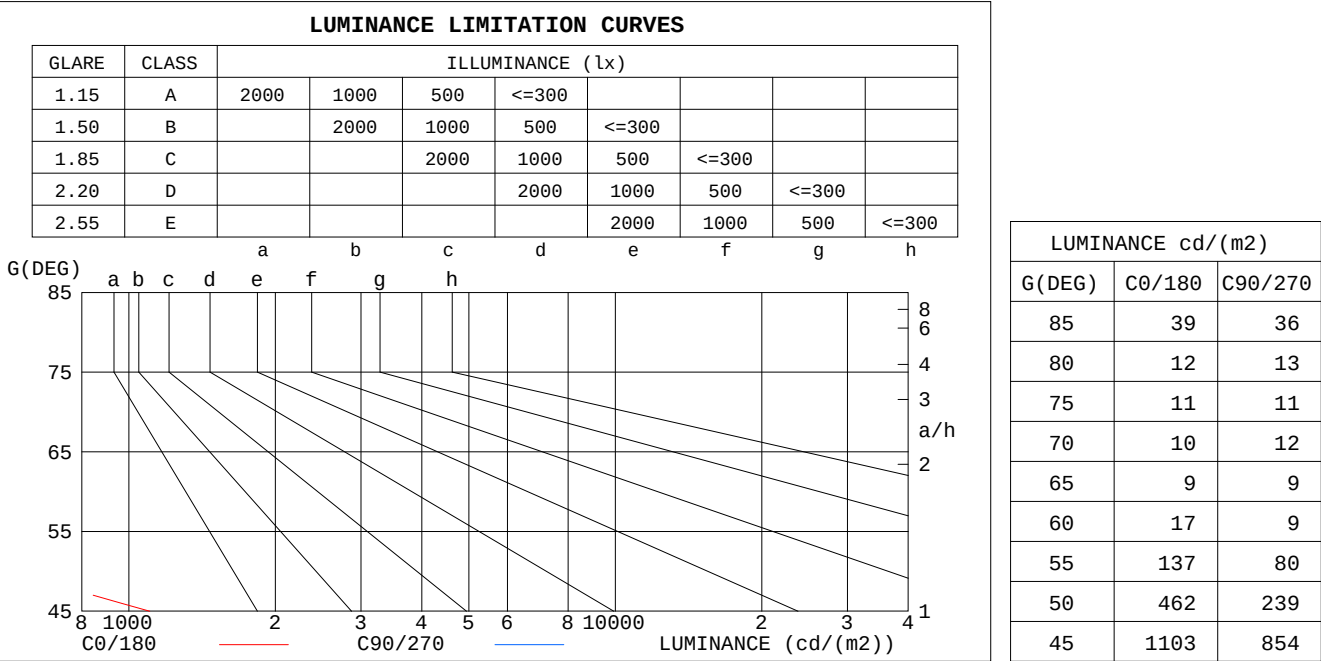


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.14	1.12	1.11	1.12	1.10	1.09	1.08	1.07	1.06	1.04	1.03	1.03	1.01	1.00	.00	.98
2.0	1.10	1.07	1.05	1.08	1.06	1.04	1.05	1.03	1.02	1.02	1.01	.00	.00	.99	.98	.96
3.0	1.06	1.03	1.01	1.05	1.02	1.00	1.03	1.01	.99	1.00	.99	.97	.98	.97	.96	.95
4.0	1.03	1.00	.98	1.02	.00	.97	1.01	.98	.96	.99	.97	.95	.97	.96	.94	.93
5.0	1.01	.98	.95	1.00	.97	.95	.99	.96	.94	.97	.95	.93	.96	.94	.93	.92
6.0	.99	.95	.93	.98	.95	.93	.97	.94	.92	.96	.93	.92	.95	.93	.91	.90
7.0	.97	.93	.91	.96	.93	.91	.95	.92	.90	.94	.92	.90	.93	.91	.90	.89
8.0	.95	.92	.89	.94	.91	.89	.94	.91	.89	.93	.90	.89	.92	.90	.88	.88
9.0	.93	.90	.88	.93	.90	.88	.92	.89	.88	.91	.89	.87	.91	.89	.87	.86
10.0	.92	.89	.87	.91	.88	.87	.91	.88	.86	.90	.88	.86	.90	.88	.86	.85

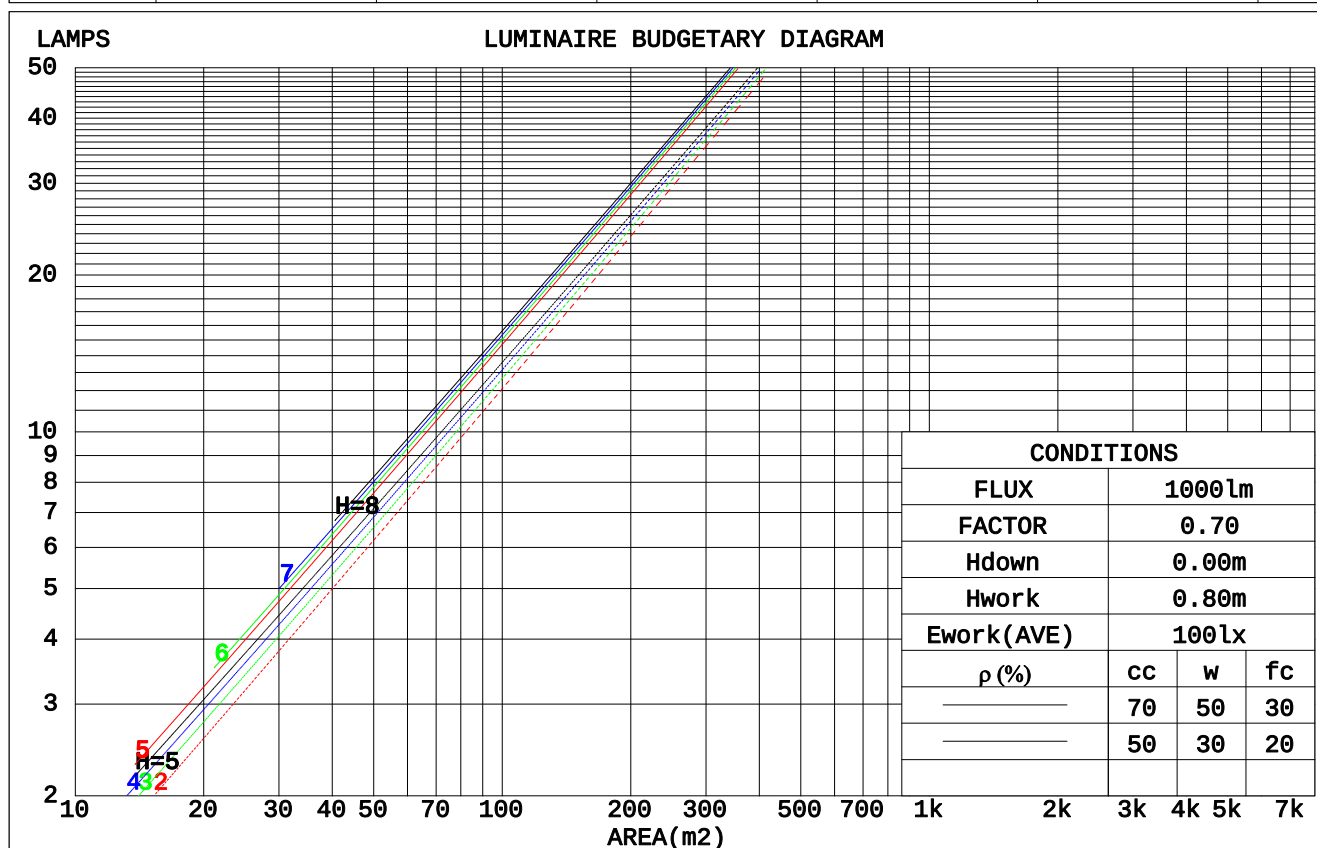

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

```

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

```

WEC AND CCEC

ρ _{CC}	80%			70%			50%			30%			10%			0	
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ _{FC}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.116	.066	.021	.110	.063	.020	.098	.056	.018	.086	.050	.016	.076	.044	.014		
2.0	.106	.058	.018	.100	.055	.017	.090	.050	.016	.081	.046	.014	.073	.041	.013		
3.0	.097	.052	.015	.093	.050	.015	.084	.046	.014	.077	.042	.013	.070	.039	.012		
4.0	.090	.047	.014	.086	.045	.013	.079	.042	.013	.073	.039	.012	.067	.036	.011		
5.0	.083	.042	.012	.080	.041	.012	.074	.039	.011	.069	.036	.011	.064	.034	.010		
6.0	.078	.039	.011	.075	.038	.011	.070	.036	.010	.066	.034	.010	.061	.032	.010		
7.0	.073	.036	.010	.071	.035	.010	.067	.034	.010	.063	.032	.009	.059	.031	.009		
8.0	.069	.034	.009	.067	.033	.009	.064	.032	.009	.060	.030	.009	.057	.029	.009		
9.0	.066	.032	.009	.064	.031	.009	.061	.030	.009	.058	.029	.008	.055	.028	.008		
10.0	.062	.030	.008	.061	.029	.008	.058	.028	.008	.055	.028	.008	.053	.027	.008		

ρ _{CC}	80%			70%			50%			30%			10%			0
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ _{FC}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.167	.158	.150	.143	.135	.129	.098	.093	.089	.056	.054	.052	.018	.017	.017	
2.0	.147	.133	.121	.126	.114	.104	.087	.079	.073	.050	.046	.043	.016	.015	.014	
3.0	.131	.113	.099	.112	.098	.086	.077	.068	.060	.045	.040	.035	.014	.013	.012	
4.0	.117	.097	.082	.101	.084	.071	.069	.059	.050	.040	.034	.030	.013	.011	.010	
5.0	.106	.085	.069	.091	.073	.060	.063	.051	.042	.036	.030	.025	.012	.010	.008	
6.0	.096	.074	.059	.083	.064	.051	.057	.045	.036	.033	.027	.021	.011	.009	.007	
7.0	.088	.066	.050	.076	.057	.044	.052	.040	.031	.030	.024	.019	.010	.008	.006	
8.0	.081	.059	.044	.070	.051	.038	.048	.036	.027	.028	.021	.016	.009	.007	.005	
9.0	.075	.053	.038	.064	.046	.033	.045	.032	.024	.026	.019	.014	.008	.006	.005	
10.0	.069	.048	.033	.060	.042	.029	.042	.029	.021	.024	.017	.012	.008	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	1.3	1.8	1.5	2.0	2.1	0.3	0.8	0.5	0.9	1.1
3H	1.2	1.7	1.4	1.8	2.0	0.2	0.6	0.4	0.8	1.0
4H	1.1	1.6	1.4	1.8	2.0	0.1	0.6	0.3	0.8	1.0
6H	1.0	1.5	1.3	1.7	1.9	0.0	0.4	0.3	0.7	0.9
8H	1.0	1.4	1.3	1.6	1.9	-0.0	0.4	0.3	0.6	0.9
12H	0.9	1.3	1.2	1.6	1.9	-0.1	0.3	0.2	0.6	0.8
4H 2H	1.1	1.6	1.4	1.8	2.0	0.1	0.6	0.3	0.8	1.0
3H	0.9	1.3	1.2	1.6	1.9	-0.1	0.3	0.2	0.6	0.8
4H	0.8	1.2	1.2	1.5	1.8	-0.2	0.2	0.2	0.5	0.8
6H	0.7	1.1	1.1	1.4	1.7	-0.3	0.1	0.1	0.4	0.7
8H	0.7	1.0	1.1	1.3	1.7	-0.3	-0.0	0.0	0.3	0.7
12H	0.6	0.9	1.0	1.3	1.7	-0.4	-0.1	0.0	0.3	0.6
8H 4H	0.7	1.0	1.1	1.3	1.7	-0.3	-0.0	0.0	0.3	0.7
6H	0.6	0.8	1.0	1.2	1.6	-0.5	-0.2	-0.0	0.2	0.6
8H	0.5	0.7	0.9	1.1	1.6	-0.5	-0.3	-0.1	0.1	0.6
12H	0.4	0.6	0.9	1.1	1.5	-0.6	-0.4	-0.1	0.1	0.5
12H 4H	0.6	0.9	1.0	1.3	1.7	-0.4	-0.1	0.0	0.3	0.6
6H	0.5	0.7	0.9	1.1	1.6	-0.5	-0.3	-0.1	0.1	0.6
8H	0.4	0.6	0.9	1.1	1.5	-0.6	-0.4	-0.1	0.1	0.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 3.4 / -22.0					+ 3.3 / -22.6				
1.5H	+ 5.9 / -16.7					+ 5.8 / -16.9				
2.0H	+ 7.3 / -17.7					+ 7.2 / -16.0				

CIE Pub.117, 330.3 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -3.8$)
Area: 0.002 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	98	93	90	96	92	89	86
1.00	102	97	94	101	96	93	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

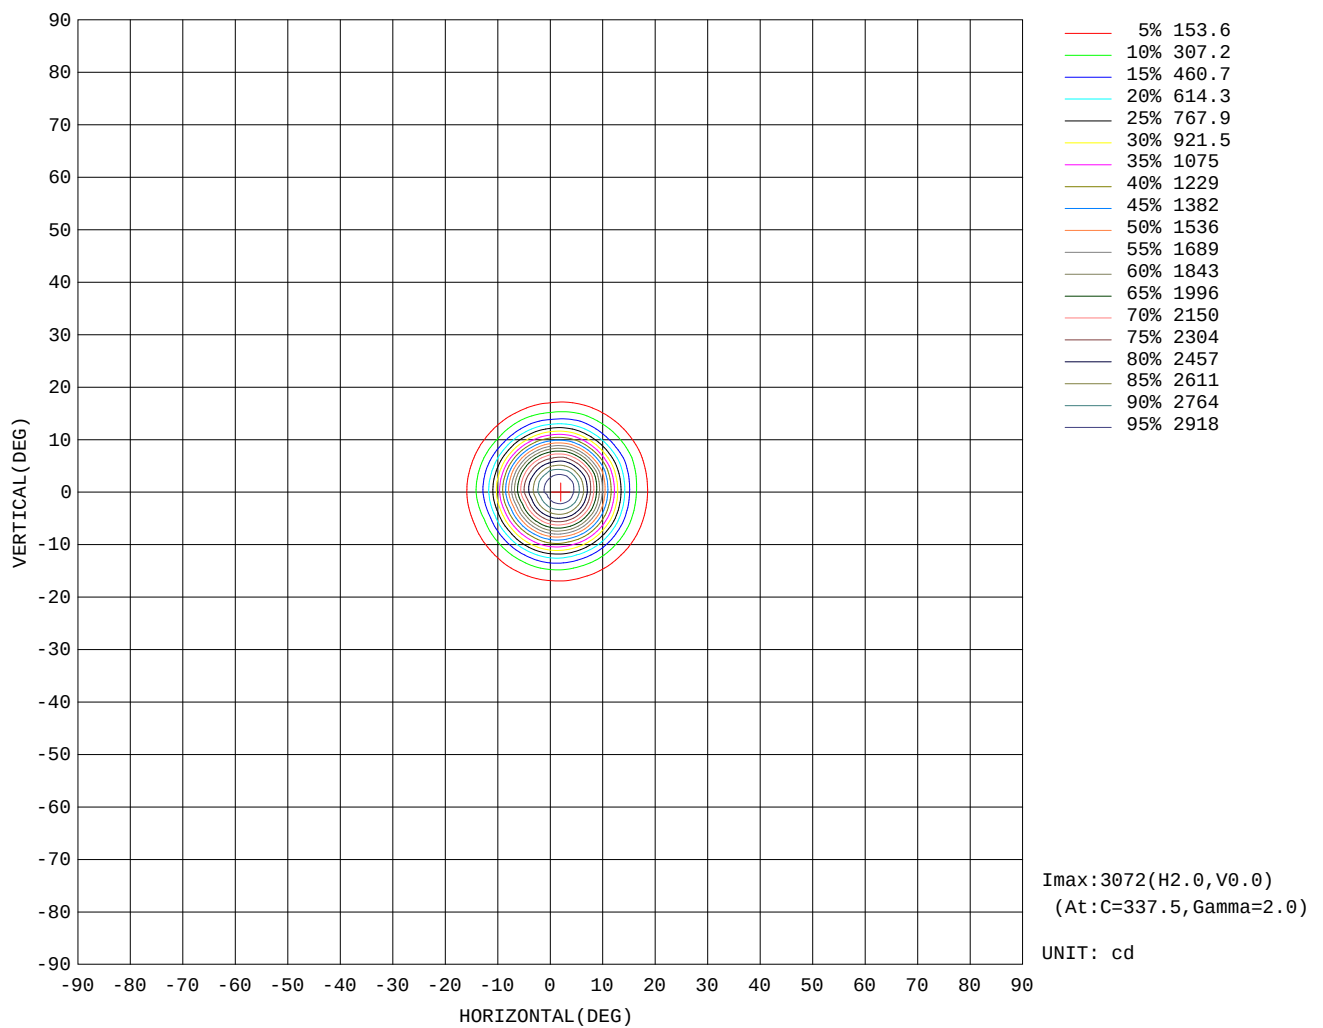

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

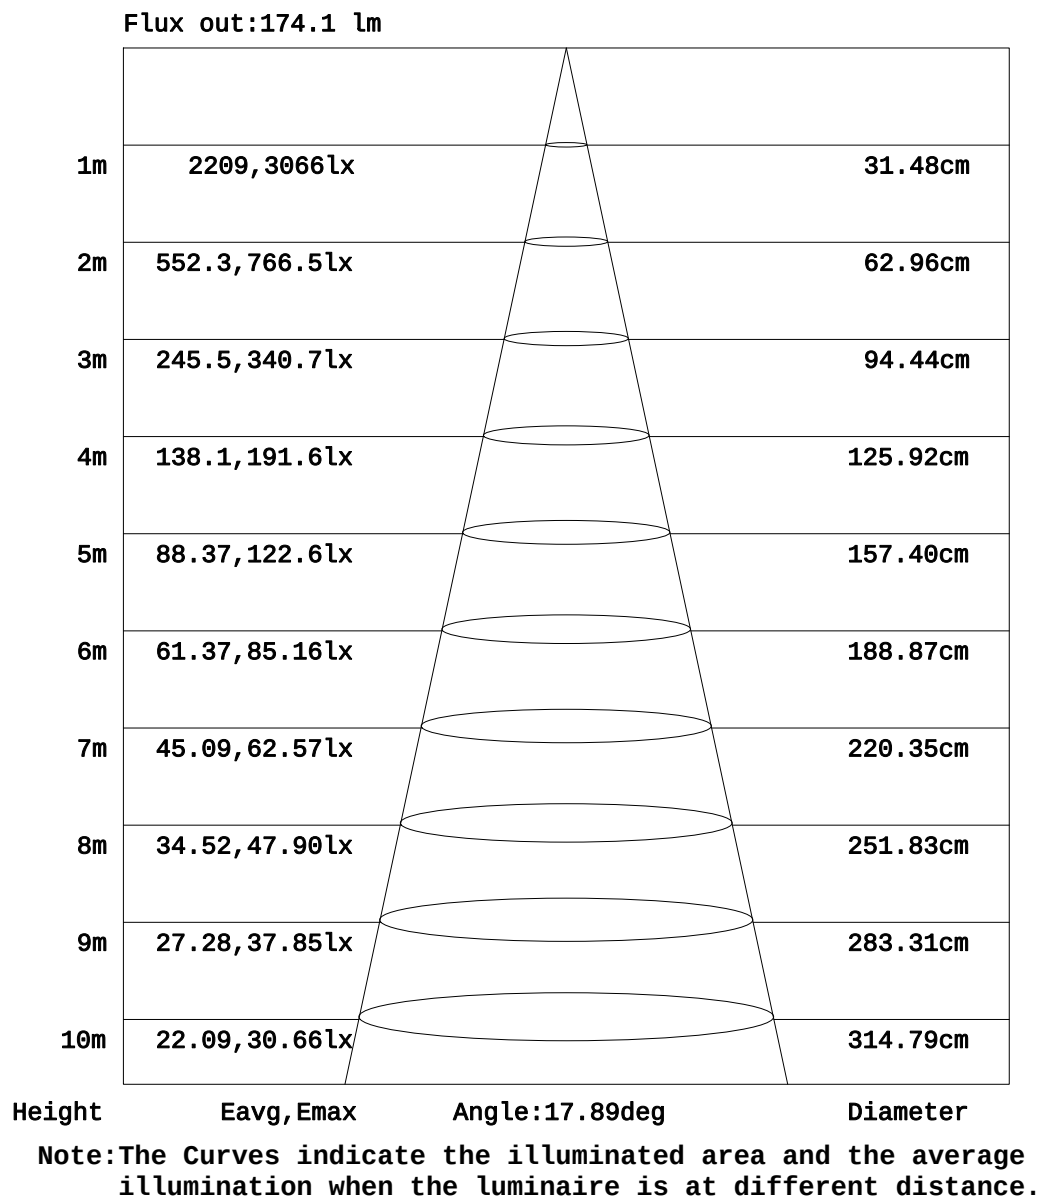

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

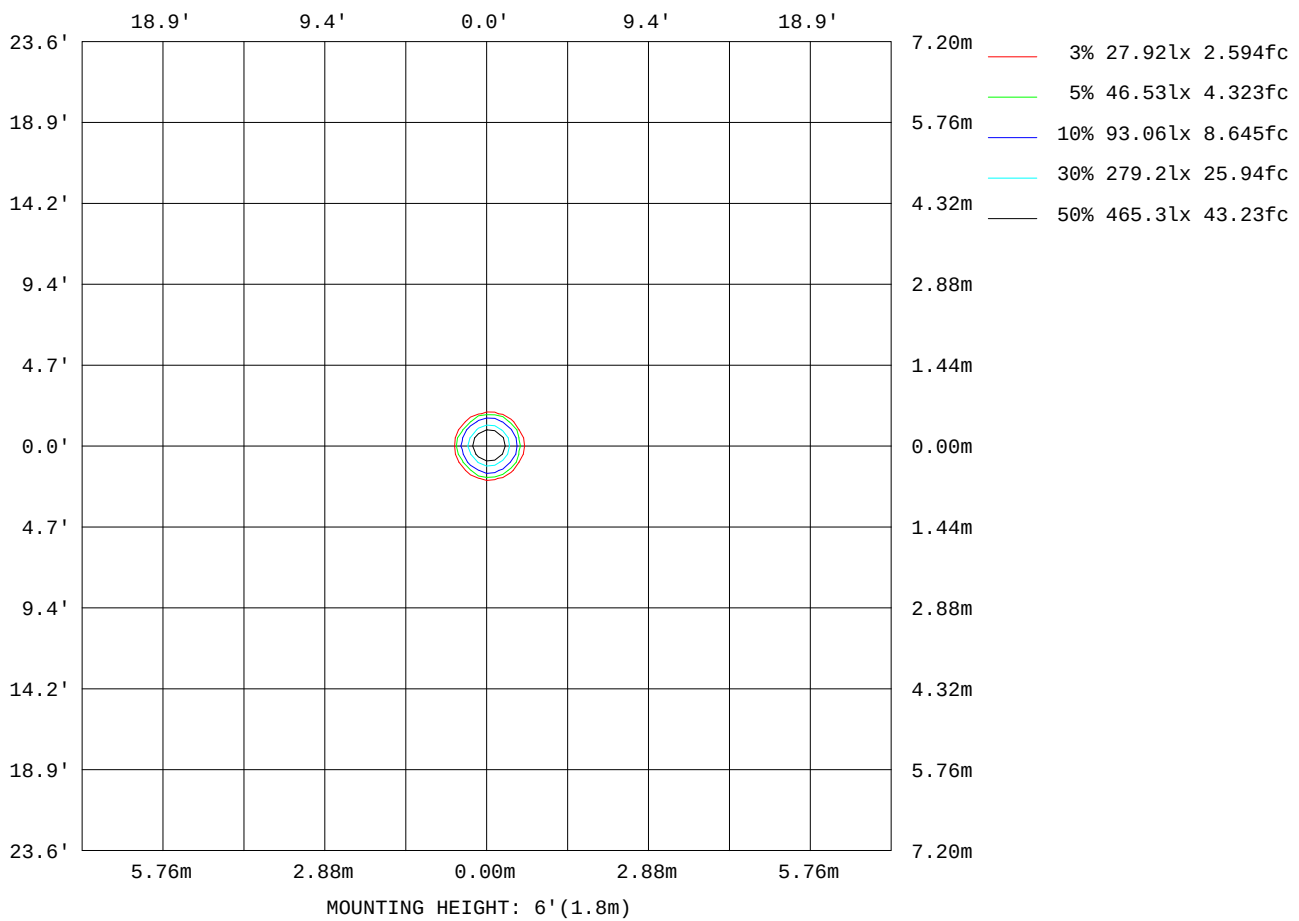

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.14V I:0.0629A P:6.3773W PF:0.4609 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:330.319x1 Lm		
NAME: DDW21-LM07E-130SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	101
L_0~180(75)av	172
L_0~180(85)av	28
L_90~270(65)av	101
L_90~270(75)av	174
L_90~270(85)av	30
L_45(65)av	102
L_45(75)av	175
L_45(85)av	28

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

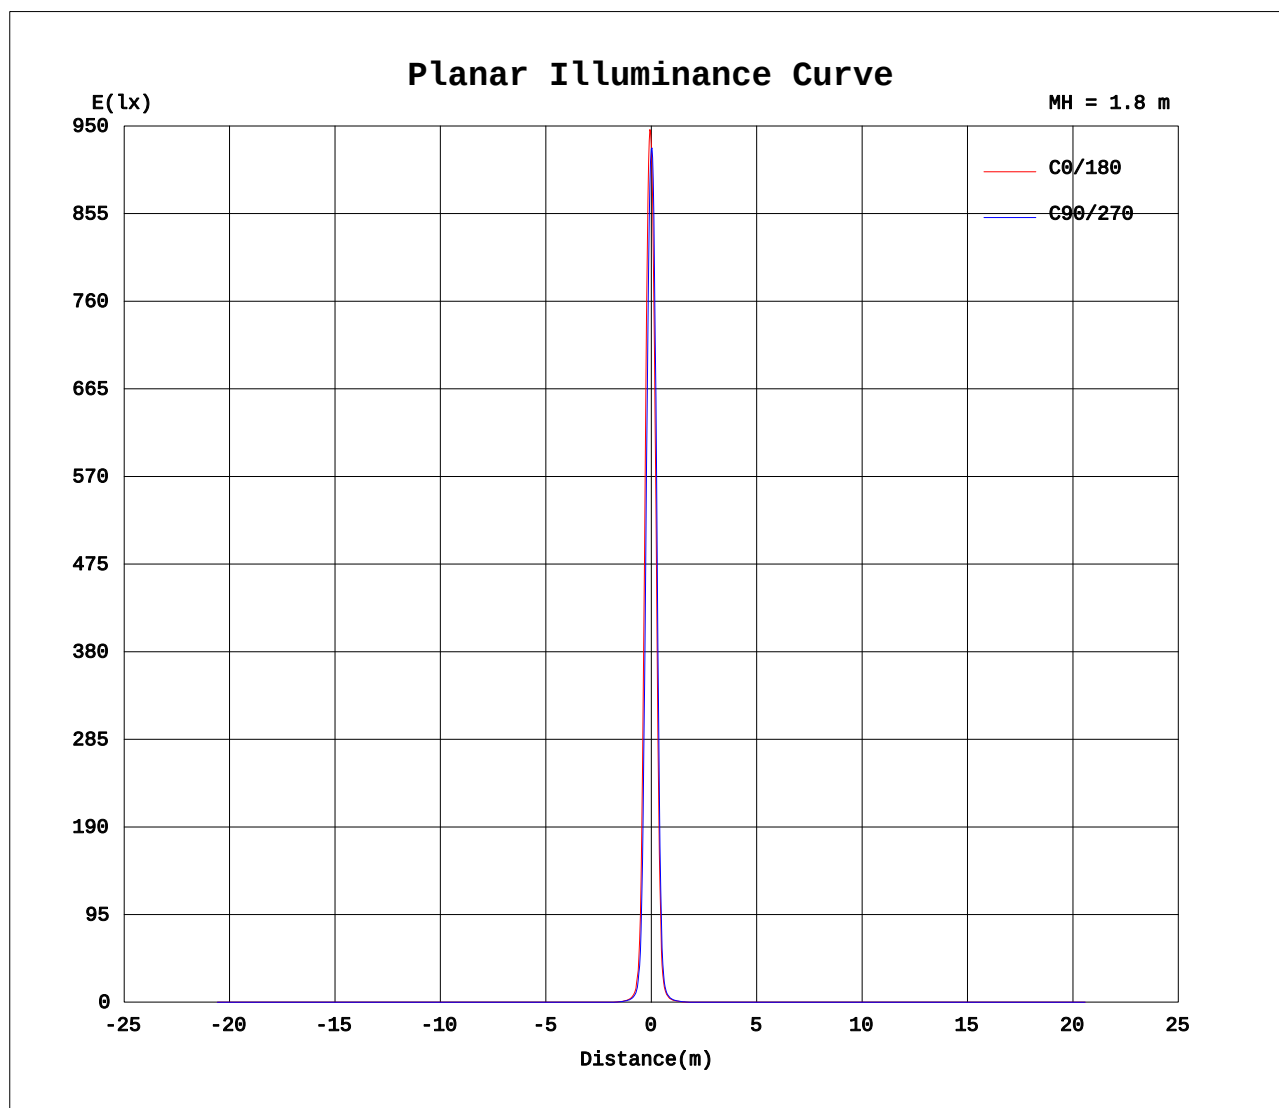

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000	3000			
5	2841	2778	2667	2539	2409	2304	2229	2196	2284	2329	2364	2463	2580	2713	2854	2900			
10	1657	1586	1438	1265	1168	1045	959	934	977	1006	1069	1162	1308	1495	1619	1736			
15	474	452	397	332	283	236	204	189	203	205	218	282	323	420	447	503			
20	108	103	92.0	79.3	64.2	57.5	50.5	48.0	51.7	51.5	52.0	56.4	65.8	79.4	91.3	101			
25	36.0	34.3	30.4	28.0	26.9	24.6	22.1	21.1	22.0	21.8	22.2	24.8	28.1	31.7	33.8	35.6			
30	17.2	16.6	15.3	14.5	13.9	13.3	12.5	12.1	11.7	11.7	12.1	12.9	14.4	15.9	17.1	17.6			
35	9.72	9.35	8.86	8.46	8.25	7.92	7.70	7.45	7.30	7.15	7.37	7.68	8.70	9.38	10.1	10.4			
40	5.12	4.91	4.75	4.39	3.99	3.67	3.51	3.45	3.65	3.73	4.02	4.31	4.73	5.09	5.49	5.62			
45	1.55	1.49	1.41	1.28	1.21	1.27	1.28	1.26	1.19	1.11	1.28	1.33	1.45	1.58	1.65	1.71			
50	0.59	0.59	0.43	0.37	0.31	0.30	0.31	0.31	0.30	0.30	0.32	0.39	0.52	0.48	0.56	0.59			
55	0.16	0.14	0.12	0.11	0.09	0.09	0.09	0.09	0.10	0.10	0.10	0.10	0.12	0.14	0.16	0.17			
60	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.17	0.17	0.17	0.17	0.18	0.18	0.18			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.17	0.16	0.16	0.16	0.16	0.16			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.18	0.18	0.17	0.17	0.17	0.17	0.17			
80	0.00	0.01	0.00	0.00	0.00	0.00	0.01	0.00	0.20	0.19	0.19	0.19	0.19	0.19	0.19	0.19			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: