


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.14V I:0.0617A P:6.2283W PF:0.4585 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:383.834x1 lm


NAME: DDW21-LM07E-230SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 61.63 lm/W
MODEL		Imax(cd)	2276	S/MH(C0/180)	0.33	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.38	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	383.83	η UP, DN(C0-180)	0.0, 48.3	
NOMINAL FLUX(lm)	383.834	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 51.7	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	1.00	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

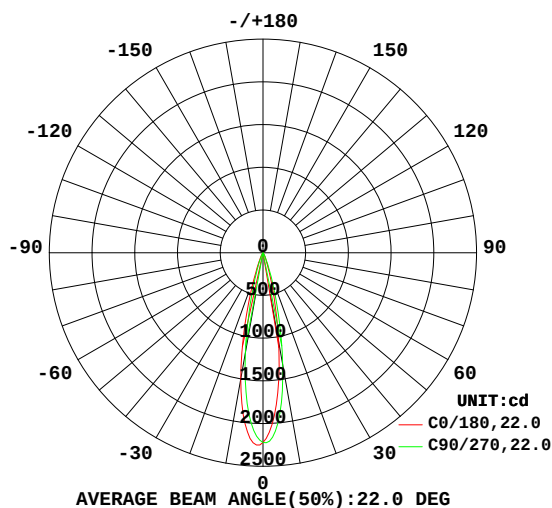

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

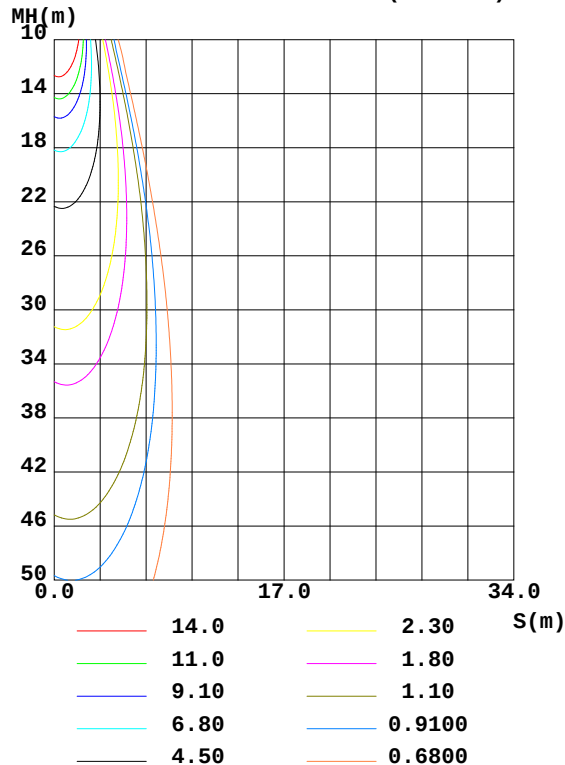

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	1500	1390	1196	1040	1059	1142	1332	1520	0- 10	163.8	163.8	42.7
20	256.5	211.6	172.7	151.0	156.2	177.7	227.8	295.8	10- 20	165.0	328.8	85.7
30	42.61	37.61	32.93	30.51	32.66	36.39	42.39	47.01	20- 30	41.23	370.0	96.4
40	6.846	5.642	4.618	3.811	4.473	5.385	7.236	8.162	30- 40	11.95	381.9	99.5
50	0.4794	0.4023	0.3662	0.3376	0.3853	0.4723	0.6397	0.6077	40- 50	1.548	383.5	99.9
60	0.0163	0.0141	0.0113	0.0089	0.010	0.0150	0.01708	0.01796	50- 60	0.1612	383.6	99.9
70	0.0075	0.0075	0.0085	0.0077	0.01564	0.01622	0.01606	0.01614	60- 70	0.0795	383.7	100
80	0.0046	0.0046	0.0051	0.0047	0.02014	0.01984	0.02025	0.02014	70- 80	0.0937	383.8	100
90	0	0	0	0	0	0	0	0	80- 90	0.0255	383.8	100
100	0	0	0	0	0	0	0	0	90-100	0	383.8	100
110	0	0	0	0	0	0	0	0	100-110	0	383.8	100
120	0	0	0	0	0	0	0	0	110-120	0	383.8	100
130	0	0	0	0	0	0	0	0	120-130	0	383.8	100
140	0	0	0	0	0	0	0	0	130-140	0	383.8	100
150	0	0	0	0	0	0	0	0	140-150	0	383.8	100
160	0	0	0	0	0	0	0	0	150-160	0	383.8	100
170	0	0	0	0	0	0	0	0	160-170	0	383.8	100
180	0	0	0	0	0	0	0	0	170-180	0	383.8	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 383.09 lm

%lum = 99.8%

%lamp = 99.8%

Conical surface Flux(120deg): 383.63 lm


%lum = 99.9%

%lamp = 99.9%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

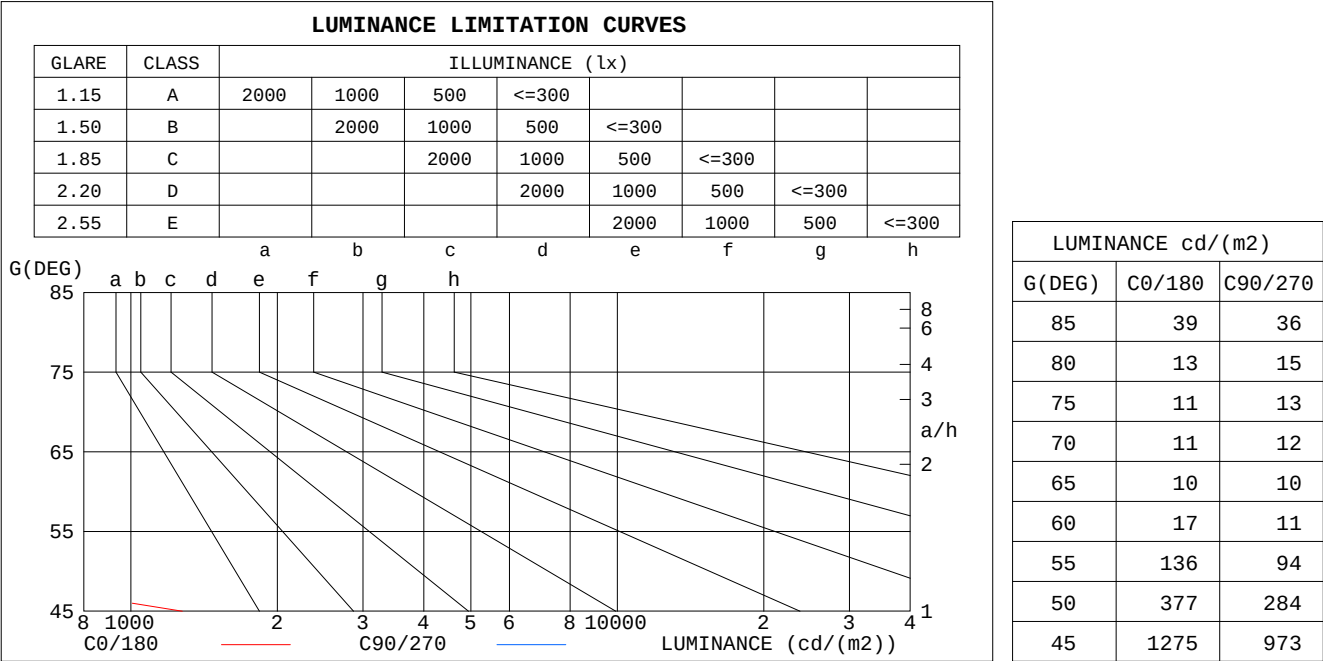


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.13	1.11	1.10	1.11	1.10	1.08	1.07	1.06	1.05	1.04	1.03	1.02	1.00	.99	.99	.97
2.0	1.08	1.06	1.03	1.07	1.04	1.02	1.04	1.02	.00	1.01	.99	.98	.98	.97	.96	.94
3.0	1.04	1.01	.98	1.03	.00	.97	1.01	.98	.96	.98	.96	.95	.96	.95	.93	.92
4.0	1.01	.97	.94	.00	.96	.94	.98	.95	.93	.96	.93	.92	.94	.92	.91	.89
5.0	.97	.94	.91	.97	.93	.90	.95	.92	.90	.93	.91	.89	.92	.90	.88	.87
6.0	.94	.91	.88	.94	.90	.88	.92	.89	.87	.91	.89	.86	.90	.88	.86	.85
7.0	.92	.88	.85	.91	.88	.85	.90	.87	.85	.89	.86	.84	.88	.86	.84	.83
8.0	.89	.86	.83	.89	.85	.83	.88	.85	.83	.87	.84	.82	.86	.84	.82	.81
9.0	.87	.83	.81	.87	.83	.81	.86	.83	.81	.85	.82	.80	.85	.82	.80	.79
10.0	.85	.81	.79	.85	.81	.79	.84	.81	.79	.83	.81	.79	.83	.80	.78	.78

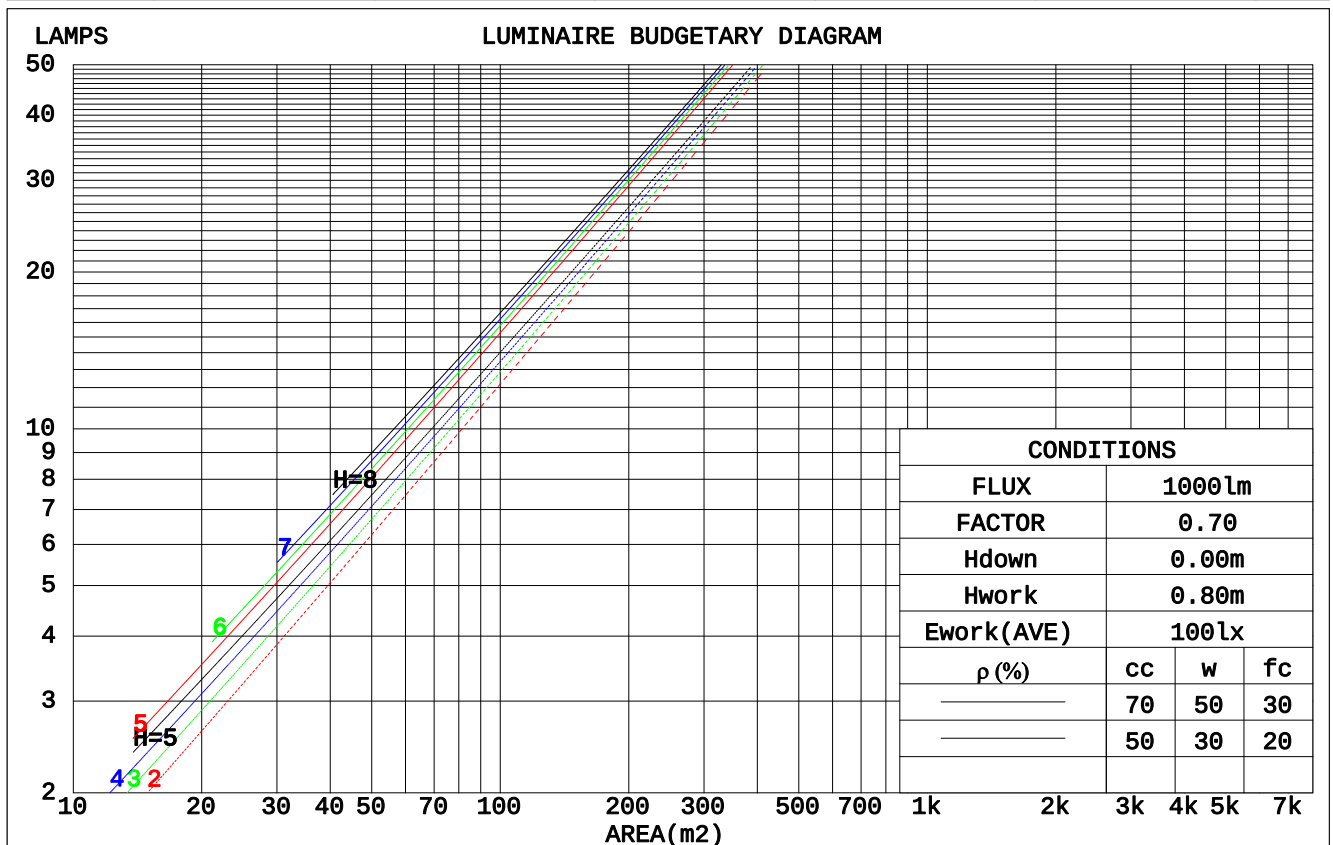

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρcc	80%			70%			50%			30%			10%			0	
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.129	.074	.023	.123	.070	.022	.110	.063	.020	.099	.057	.018	.089	.051	.017		
2.0	.119	.065	.020	.114	.063	.019	.104	.058	.018	.094	.053	.017	.086	.048	.015		
3.0	.110	.059	.018	.106	.057	.017	.098	.053	.016	.090	.049	.015	.083	.046	.014		
4.0	.103	.054	.016	.099	.052	.015	.092	.049	.015	.086	.046	.014	.080	.043	.013		
5.0	.097	.049	.014	.094	.048	.014	.088	.046	.013	.082	.043	.013	.077	.041	.012		
6.0	.091	.046	.013	.089	.045	.013	.083	.043	.012	.079	.041	.012	.074	.039	.012		
7.0	.087	.043	.012	.084	.042	.012	.080	.040	.012	.076	.039	.011	.072	.037	.011		
8.0	.082	.040	.011	.080	.040	.011	.076	.038	.011	.073	.037	.011	.069	.036	.010		
9.0	.079	.038	.011	.077	.037	.011	.073	.036	.010	.070	.035	.010	.067	.034	.010		
10.0	.075	.036	.010	.074	.036	.010	.071	.035	.010	.068	.034	.010	.065	.033	.009		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.168	.158	.149	.144	.135	.128	.098	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.149	.133	.119	.128	.114	.103	.088	.079	.072	.050	.046	.042	.016	.015	.014	
3.0	.134	.113	.097	.115	.098	.084	.079	.068	.059	.045	.040	.035	.015	.013	.011	
4.0	.121	.098	.080	.104	.084	.070	.071	.059	.049	.041	.034	.029	.013	.011	.010	
5.0	.110	.085	.067	.094	.074	.058	.065	.052	.041	.038	.030	.024	.012	.010	.008	
6.0	.101	.075	.057	.087	.065	.049	.060	.046	.035	.035	.027	.021	.011	.009	.007	
7.0	.093	.067	.049	.080	.058	.042	.055	.041	.030	.032	.024	.018	.010	.008	.006	
8.0	.086	.060	.042	.074	.052	.037	.051	.037	.026	.030	.022	.015	.010	.007	.005	
9.0	.081	.054	.036	.069	.047	.032	.048	.033	.023	.028	.020	.013	.009	.006	.004	
10.0	.076	.049	.032	.065	.043	.028	.045	.030	.020	.026	.018	.012	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	5.5	6.1	5.7	6.3	6.4	4.3	4.9	4.5	5.1	5.2
3H	5.4	5.9	5.6	6.1	6.3	4.2	4.8	4.4	4.9	5.1
4H	5.3	5.8	5.5	6.0	6.2	4.1	4.7	4.4	4.9	5.1
6H	5.2	5.7	5.5	5.9	6.2	4.0	4.5	4.3	4.8	5.0
8H	5.2	5.6	5.4	5.9	6.1	4.0	4.5	4.3	4.7	5.0
12H	5.1	5.6	5.4	5.8	6.1	4.0	4.4	4.3	4.7	4.9
4H 2H	5.3	5.8	5.5	6.0	6.2	4.1	4.7	4.4	4.9	5.1
3H	5.1	5.6	5.4	5.8	6.1	4.0	4.4	4.3	4.7	4.9
4H	5.0	5.5	5.4	5.7	6.0	3.9	4.3	4.2	4.6	4.9
6H	4.9	5.3	5.3	5.6	6.0	3.8	4.1	4.1	4.5	4.8
8H	4.9	5.2	5.2	5.6	5.9	3.7	4.1	4.1	4.4	4.8
12H	4.8	5.1	5.2	5.5	5.9	3.6	4.0	4.0	4.3	4.7
8H 4H	4.9	5.2	5.2	5.6	5.9	3.7	4.1	4.1	4.4	4.8
6H	4.7	5.0	5.2	5.4	5.8	3.6	3.9	4.0	4.3	4.7
8H	4.7	4.9	5.1	5.4	5.8	3.5	3.8	4.0	4.2	4.6
12H	4.6	4.8	5.1	5.3	5.8	3.5	3.7	3.9	4.1	4.6
12H 4H	4.8	5.1	5.2	5.5	5.9	3.6	4.0	4.0	4.3	4.7
6H	4.7	4.9	5.1	5.4	5.8	3.5	3.8	4.0	4.2	4.6
8H	4.6	4.8	5.1	5.3	5.8	3.5	3.7	3.9	4.1	4.6
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.7 / -25.0					+ 4.2 / -24.3				
1.5H	+ 7.3 / -19.7					+ 6.9 / -18.7				
2.0H	+ 8.2 / -17.3					+ 7.6 / -16.1				

CIE Pub.117, 383.8 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -3.3$)
Area: 0.002 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	98	93	90	96	92	89	86
1.00	102	97	94	101	97	93	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

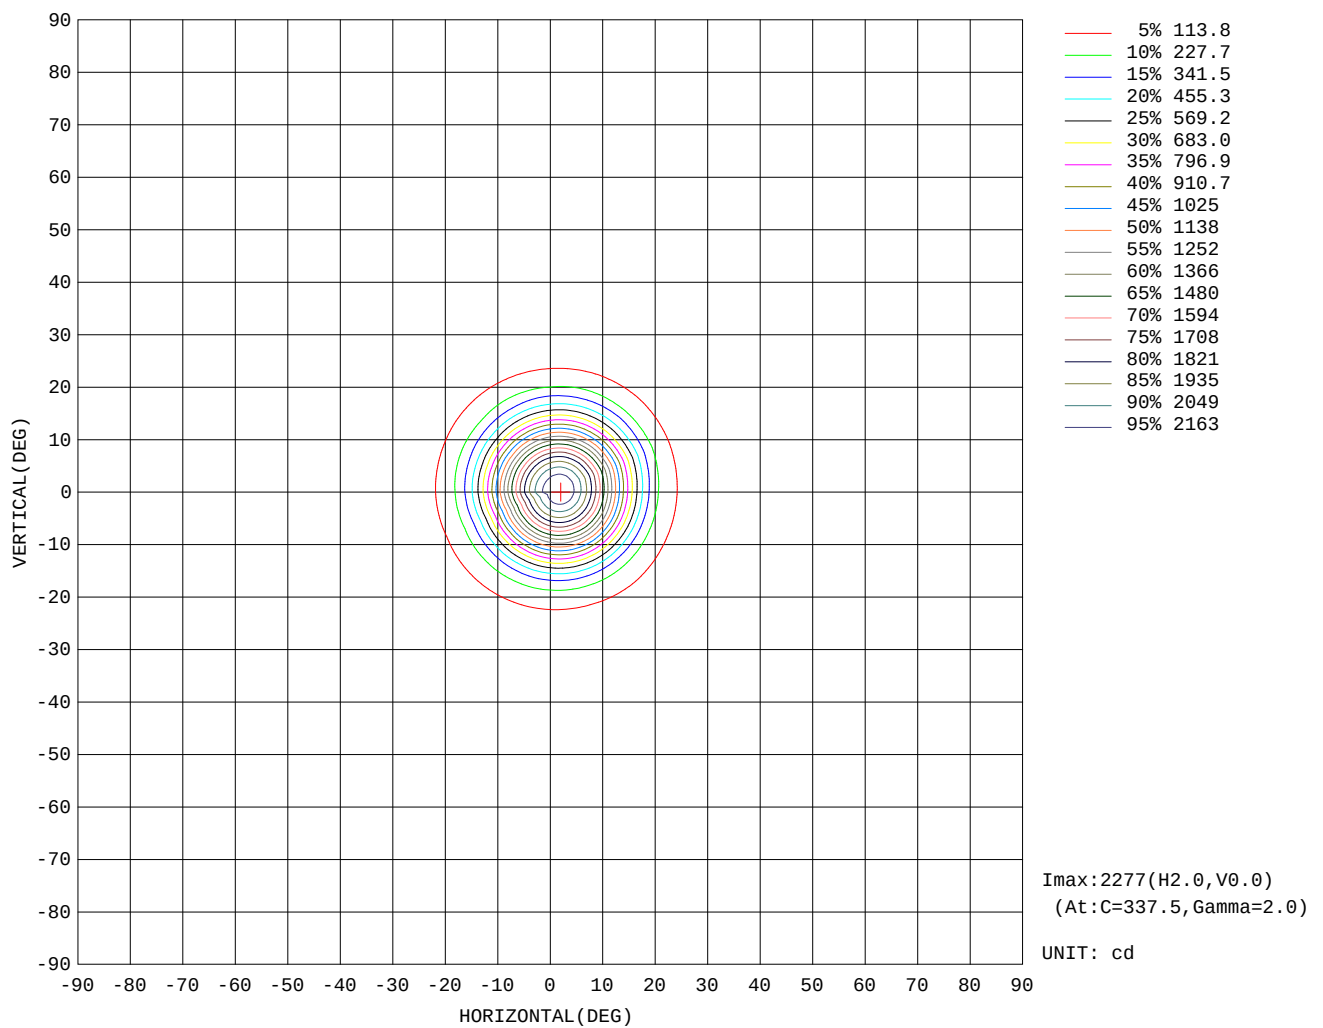

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

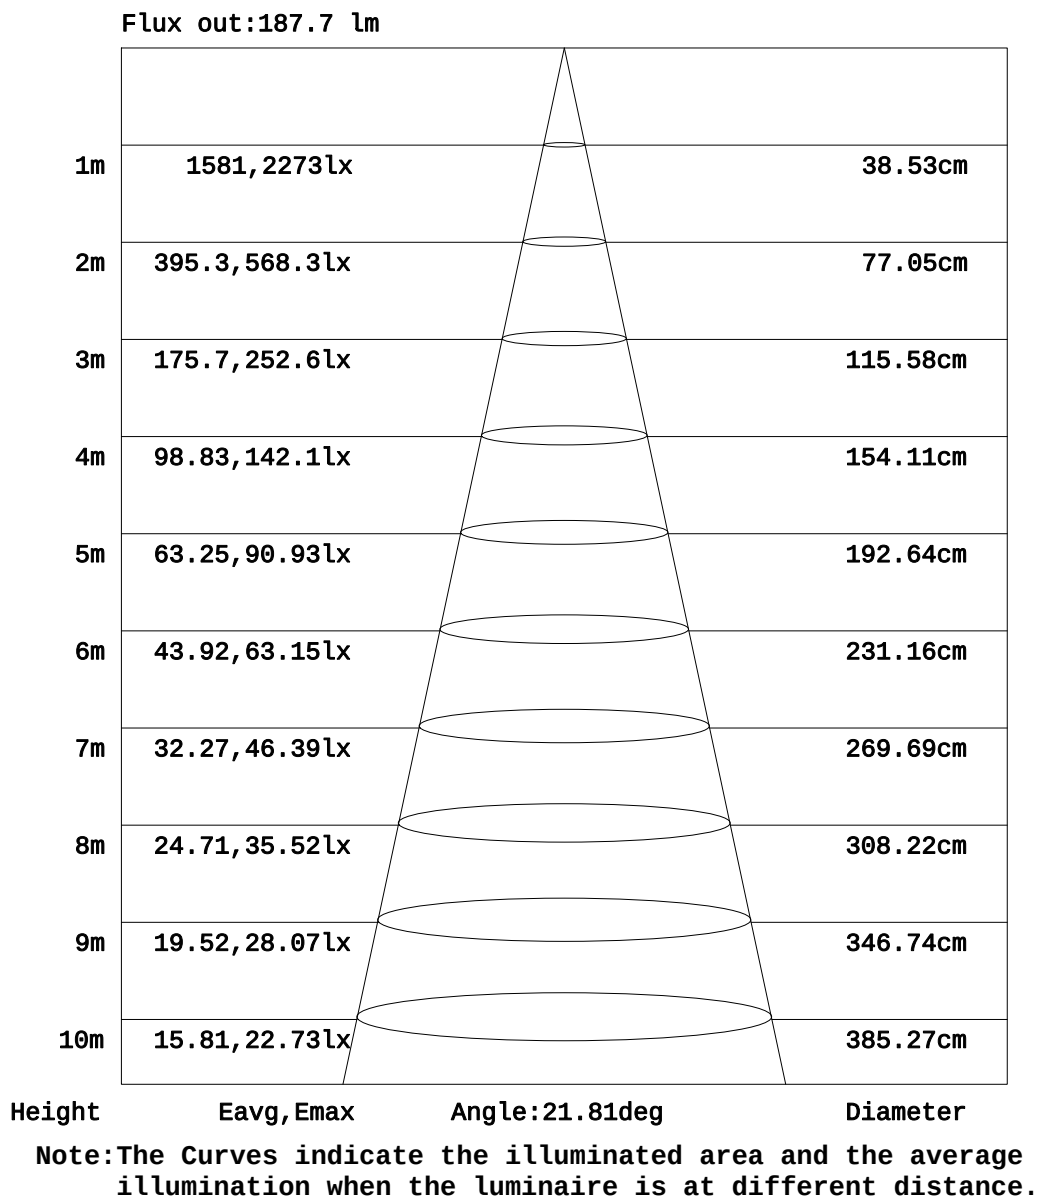

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

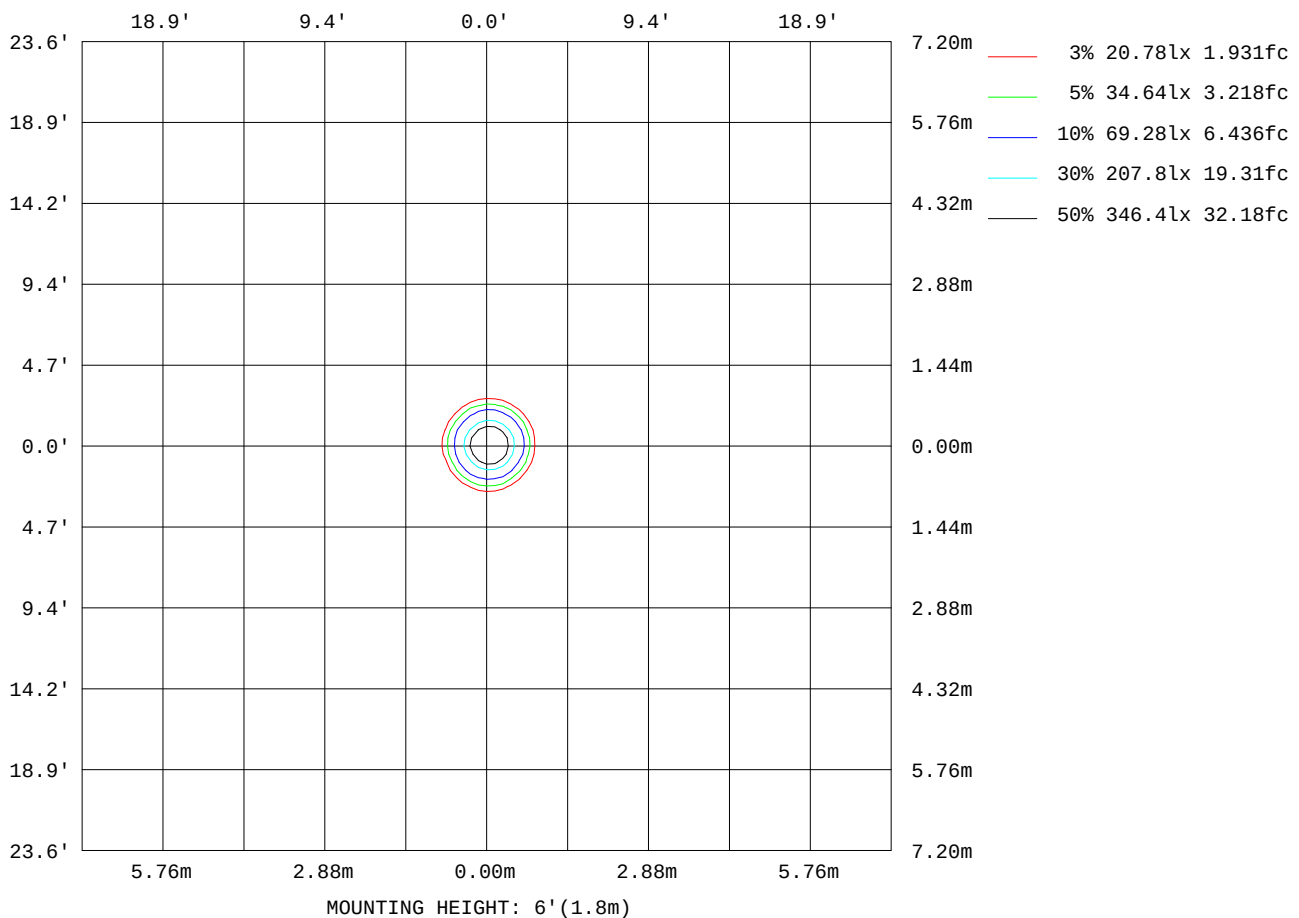

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.14V I:0.0617A P:6.2283W PF:0.4585 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:383.834x1 Lm		
NAME: DDW21-LM07E-230SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	104
L_0~180(75)av	173
L_0~180(85)av	29
L_90~270(65)av	106
L_90~270(75)av	179
L_90~270(85)av	30
L_45(65)av	106
L_45(75)av	180
L_45(85)av	28

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

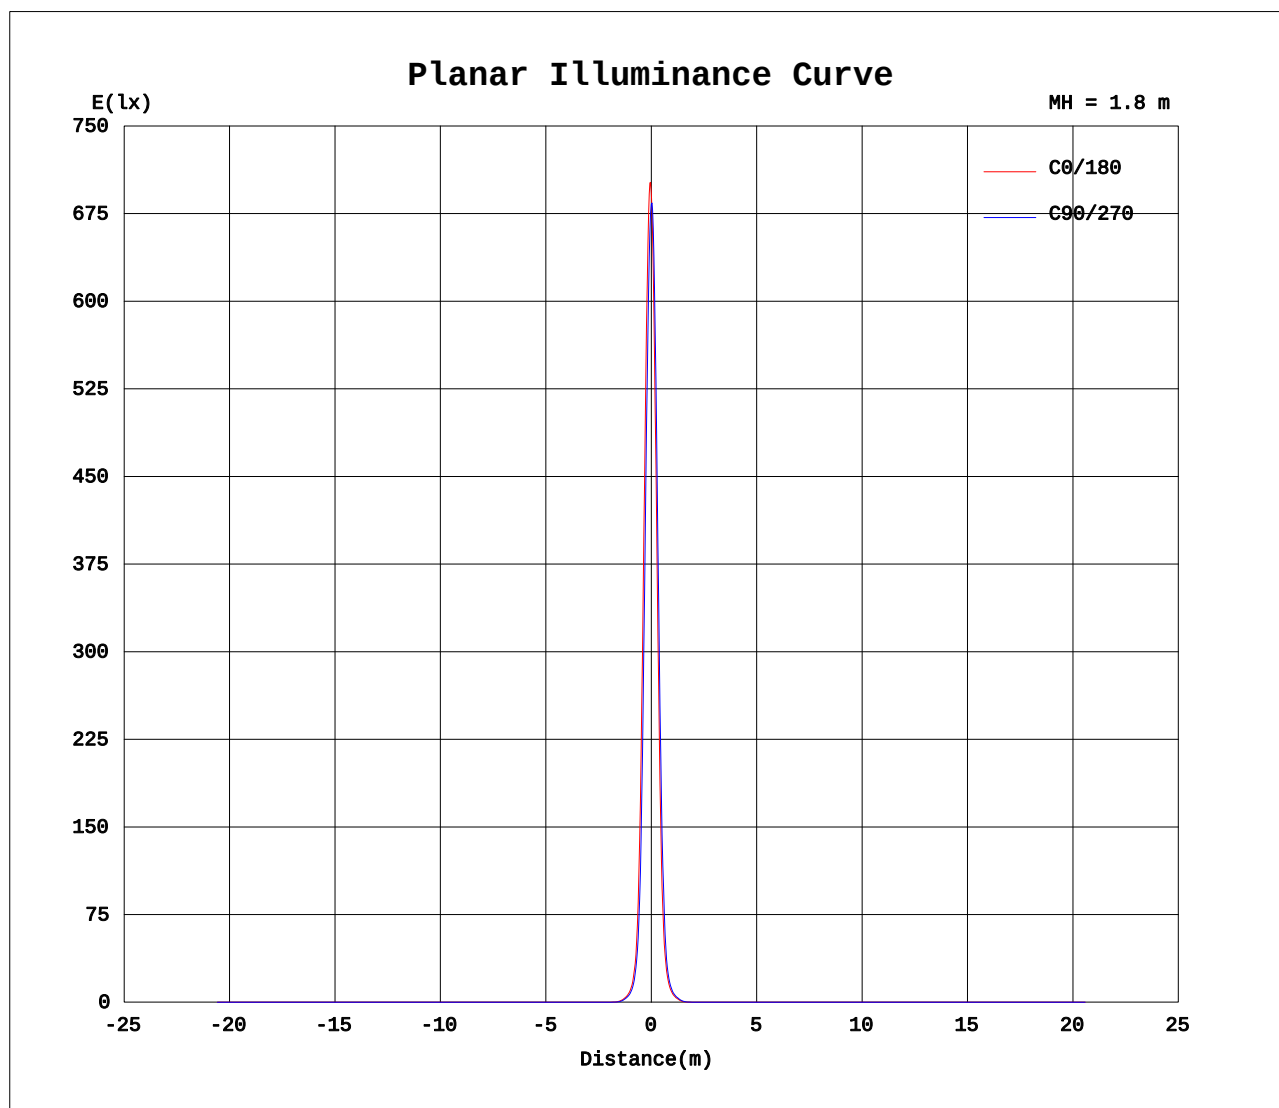

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220	2220			
5	2105	2076	2025	1962	1893	1825	1775	1745	1788	1813	1861	1927	2003	2078	2134	2159			
10	1500	1462	1390	1295	1196	1105	1040	1005	1059	1087	1142	1228	1332	1436	1520	1571			
15	752	708	645	573	504	450	415	399	438	458	499	561	634	712	778	819			
20	257	233	212	190	173	160	151	145	156	164	178	200	228	270	296	302			
25	97.3	91.1	81.1	75.3	70.0	66.4	63.6	62.0	67.0	70.1	75.2	81.6	88.5	96.6	102	103			
30	42.6	40.3	37.6	35.1	32.9	31.3	30.5	30.2	32.7	34.2	36.4	39.4	42.4	45.1	47.0	46.9			
35	21.0	19.4	18.2	17.1	15.9	15.1	14.7	14.8	16.6	17.4	18.7	20.7	22.2	23.2	23.8	23.8			
40	6.85	6.15	5.64	5.19	4.62	4.08	3.81	3.83	4.47	4.73	5.38	6.40	7.24	7.82	8.16	8.18			
45	1.78	1.63	1.51	1.47	1.38	1.31	1.30	1.35	1.47	1.49	1.59	1.79	1.93	1.98	2.03	2.03			
50	0.48	0.43	0.40	0.39	0.37	0.34	0.34	0.34	0.39	0.42	0.47	0.56	0.64	0.69	0.61	0.58			
55	0.15	0.14	0.13	0.12	0.11	0.10	0.09	0.09	0.11	0.12	0.14	0.16	0.18	0.19	0.19	0.18			
60	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.17	0.17	0.17	0.18	0.18	0.18			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.18	0.18	0.18	0.18	0.18	0.18	0.18			
80	0.00	0.01	0.00	0.00	0.01	0.01	0.00	0.00	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: