


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.13V I:0.0621A P:6.2860W PF:0.4595 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:438.264x1 lm


NAME: DDW21-LM07E-330SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 69.72 lm/W
MODEL		Imax(cd)	1238	S/MH(C0/180)	0.60	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.46	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	438.26	η UP, DN(C0-180)	0.0, 56.5	
NOMINAL FLUX(lm)	438.264	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 43.5	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

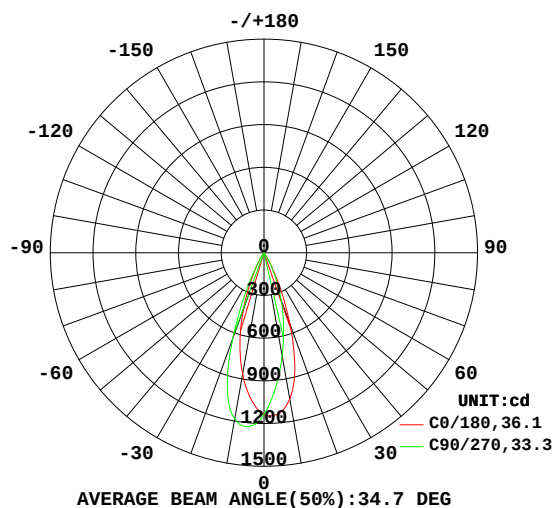

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

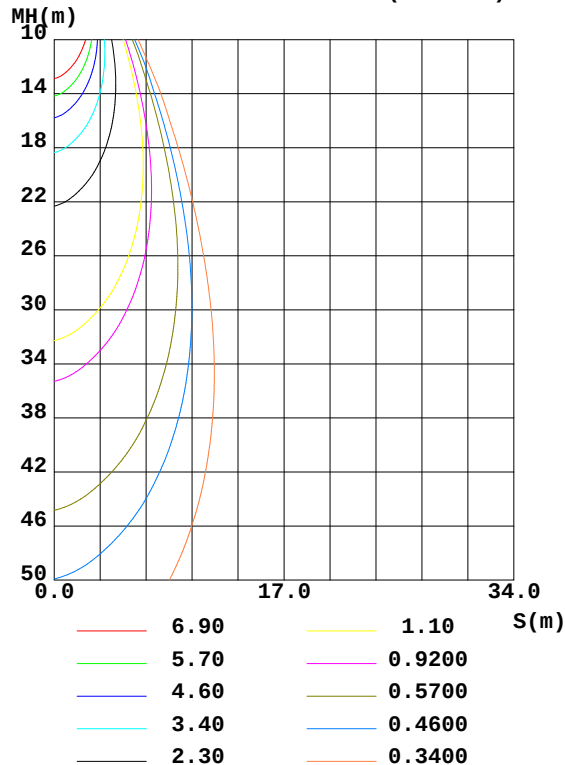

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	866.3	1022	1186	1186	1043	863.9	736.1	743.8	0- 10	99.53	99.53	22.7
20	425.9	501.0	646.7	645.7	534.4	430.1	351.7	361.8	10- 20	203.4	303.0	69.1
30	87.49	84.82	103.7	98.56	88.81	93.87	80.22	81.21	20- 30	113.6	416.5	95
40	5.876	5.079	6.343	5.913	5.506	6.734	5.475	5.550	30- 40	20.00	436.5	99.6
50	0.3902	0.3203	0.3666	0.3342	0.3171	0.3675	0.3423	0.3832	40- 50	1.398	437.9	99.9
60	0.0162	0.0138	0.0138	0.0114	0.1659	0.1634	0.1738	0.1737	50- 60	0.1351	438.1	100
70	0.0079	0.0091	0.0085	0.0094	0.1588	0.1602	0.1868	0.1933	60- 70	0.0845	438.1	100
80	0.0050	0.0050	0.0060	0.0055	0.1934	0.1847	0.1601	0.1647	70- 80	0.0943	438.2	100
90	0	0	0	0	0	0	0	0	80- 90	0.0201	438.3	100
100	0	0	0	0	0	0	0	0	90-100	0	438.3	100
110	0	0	0	0	0	0	0	0	100-110	0	438.3	100
120	0	0	0	0	0	0	0	0	110-120	0	438.3	100
130	0	0	0	0	0	0	0	0	120-130	0	438.3	100
140	0	0	0	0	0	0	0	0	130-140	0	438.3	100
150	0	0	0	0	0	0	0	0	140-150	0	438.3	100
160	0	0	0	0	0	0	0	0	150-160	0	438.3	100
170	0	0	0	0	0	0	0	0	160-170	0	438.3	100
180	0	0	0	0	0	0	0	0	170-180	0	438.3	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 437.66 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 438.07 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:


LUMINANCE LIMITATION CURVES

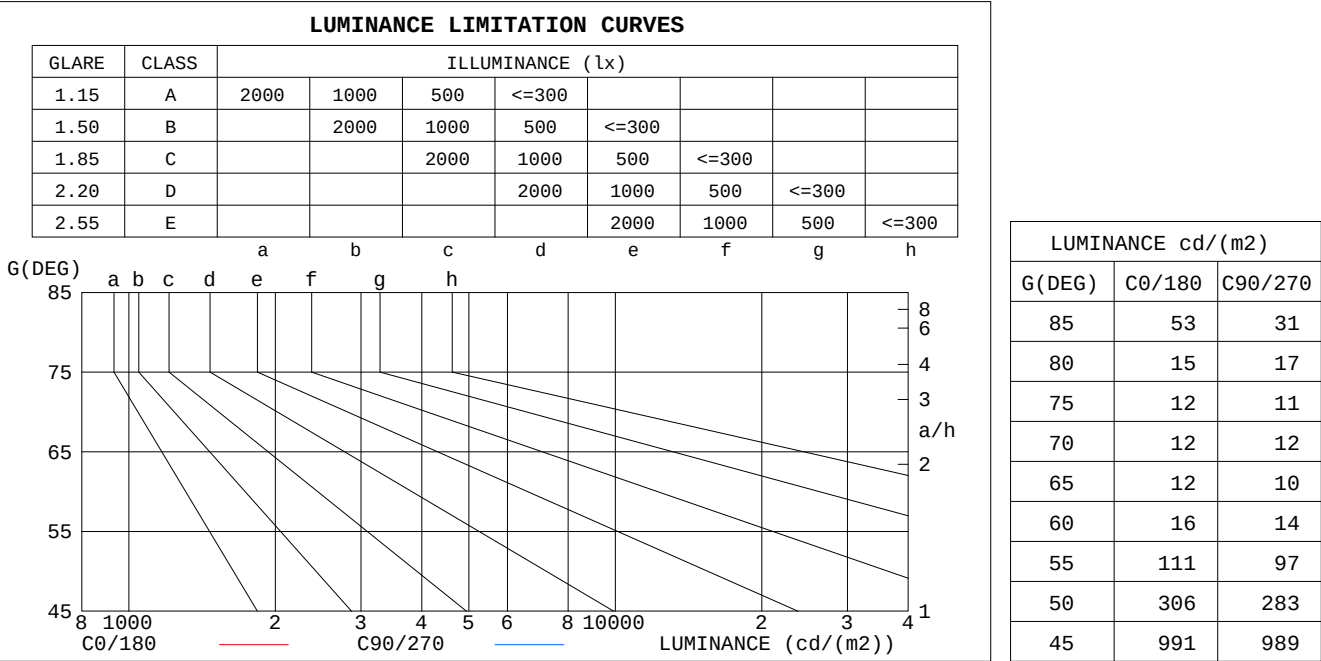

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Temperature:25.3DEG	Humidity:65.0%
Operators:Oliver	Test Distance:2.467m [K=1.0000]
Test Date:2024-09-20	Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.10	1.09	1.10	1.08	1.07	1.06	1.05	1.04	1.03	1.01	1.00	.99	.98	.98	.96
2.0	1.07	1.03	1.01	1.05	1.02	.00	1.02	.99	.97	.99	.97	.95	.96	.95	.93	.92
3.0	1.01	.98	.94	1.00	.97	.94	.98	.95	.92	.95	.93	.91	.93	.91	.89	.88
4.0	.97	.93	.89	.96	.92	.89	.94	.90	.88	.92	.89	.87	.90	.88	.86	.85
5.0	.93	.88	.85	.92	.88	.84	.90	.87	.84	.89	.85	.83	.87	.84	.82	.81
6.0	.89	.84	.81	.88	.84	.81	.87	.83	.80	.85	.82	.80	.84	.81	.79	.78
7.0	.85	.81	.77	.85	.80	.77	.84	.80	.77	.82	.79	.76	.81	.78	.76	.75
8.0	.82	.77	.74	.82	.77	.74	.81	.77	.74	.80	.76	.74	.79	.76	.73	.72
9.0	.79	.74	.71	.79	.74	.71	.78	.74	.71	.77	.73	.71	.76	.73	.71	.70
10.0	.76	.72	.69	.76	.72	.69	.75	.71	.69	.74	.71	.68	.74	.71	.68	.67

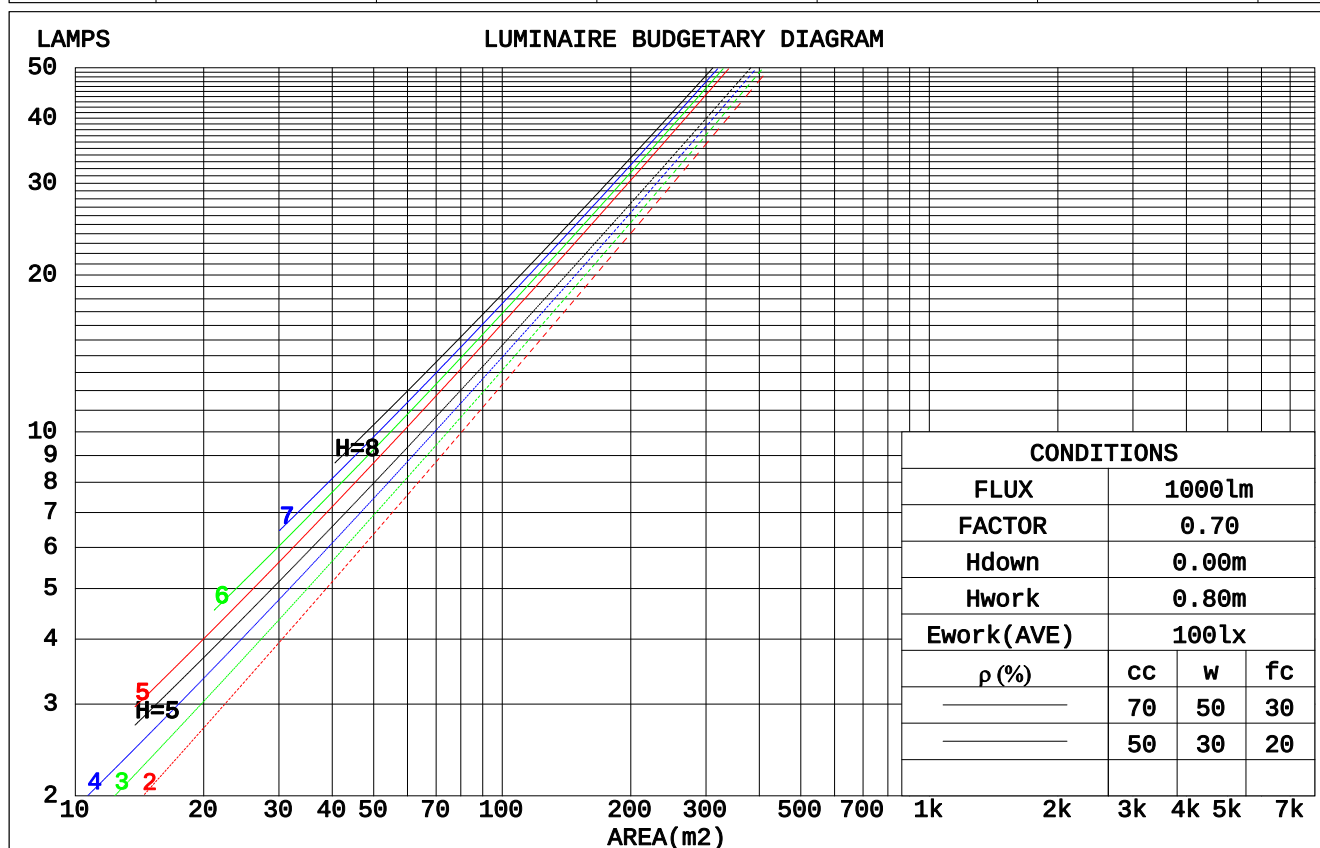

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.146	.083	.026	.140	.080	.025	.127	.073	.023	.116	.067	.021	.105	.061	.020	
2.0	.137	.075	.023	.131	.072	.022	.121	.067	.021	.112	.063	.020	.103	.058	.018	
3.0	.128	.068	.020	.124	.066	.020	.115	.062	.019	.107	.059	.018	.100	.055	.017	
4.0	.121	.063	.019	.117	.061	.018	.110	.058	.017	.103	.055	.017	.097	.053	.016	
5.0	.115	.059	.017	.112	.057	.017	.105	.055	.016	.100	.053	.016	.094	.050	.015	
6.0	.109	.055	.016	.107	.054	.015	.101	.052	.015	.096	.050	.015	.091	.048	.014	
7.0	.104	.052	.015	.102	.051	.014	.097	.049	.014	.093	.048	.014	.089	.046	.014	
8.0	.100	.049	.014	.098	.048	.014	.094	.047	.013	.090	.045	.013	.086	.044	.013	
9.0	.096	.046	.013	.094	.046	.013	.090	.045	.013	.087	.043	.012	.083	.042	.012	
10.0	.092	.044	.012	.091	.044	.012	.087	.043	.012	.084	.042	.012	.081	.041	.012	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.147	.145	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.016	
2.0	.152	.133	.117	.130	.114	.101	.089	.079	.070	.051	.046	.041	.016	.015	.013	
3.0	.137	.113	.094	.118	.098	.082	.081	.068	.057	.047	.040	.034	.015	.013	.011	
4.0	.125	.098	.077	.108	.085	.067	.074	.059	.047	.043	.035	.028	.014	.011	.009	
5.0	.115	.086	.064	.099	.074	.056	.068	.052	.040	.040	.031	.023	.013	.010	.008	
6.0	.107	.076	.054	.092	.066	.047	.063	.046	.033	.037	.027	.020	.012	.009	.007	
7.0	.100	.068	.046	.086	.059	.040	.059	.041	.028	.034	.024	.017	.011	.008	.006	
8.0	.094	.062	.040	.081	.053	.035	.056	.038	.025	.032	.022	.015	.010	.007	.005	
9.0	.088	.056	.034	.076	.049	.030	.053	.034	.021	.031	.020	.013	.010	.007	.004	
10.0	.084	.052	.030	.072	.045	.026	.050	.031	.019	.029	.019	.011	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	7.6	8.4	7.8	8.5	8.7	8.7	9.4	8.9	9.6	9.7
3H	7.5	8.1	7.7	8.3	8.5	8.5	9.2	8.8	9.4	9.6
4H	7.4	8.0	7.7	8.2	8.5	8.4	9.1	8.7	9.3	9.5
6H	7.3	7.9	7.6	8.1	8.4	8.4	9.0	8.6	9.2	9.4
8H	7.3	7.8	7.6	8.1	8.3	8.3	8.9	8.6	9.1	9.4
12H	7.2	7.8	7.5	8.0	8.3	8.3	8.8	8.6	9.1	9.4
4H 2H	7.4	8.0	7.7	8.2	8.5	8.4	9.1	8.7	9.3	9.5
3H	7.2	7.8	7.5	8.0	8.3	8.3	8.8	8.6	9.1	9.4
4H	7.1	7.6	7.5	7.9	8.2	8.2	8.7	8.5	9.0	9.3
6H	7.0	7.5	7.4	7.8	8.1	8.1	8.5	8.4	8.9	9.2
8H	7.0	7.4	7.4	7.7	8.1	8.0	8.4	8.4	8.8	9.2
12H	6.9	7.3	7.3	7.7	8.1	8.0	8.4	8.4	8.7	9.1
8H 4H	7.0	7.4	7.4	7.7	8.1	8.0	8.4	8.4	8.8	9.2
6H	6.9	7.2	7.3	7.6	8.0	7.9	8.3	8.3	8.6	9.1
8H	6.8	7.1	7.2	7.5	8.0	7.9	8.2	8.3	8.6	9.0
12H	6.7	7.0	7.2	7.4	7.9	7.8	8.1	8.3	8.5	9.0
12H 4H	6.9	7.3	7.3	7.7	8.1	8.0	8.4	8.4	8.7	9.1
6H	6.8	7.1	7.2	7.5	8.0	7.9	8.2	8.3	8.6	9.0
8H	6.7	7.0	7.2	7.4	7.9	7.8	8.1	8.3	8.5	9.0
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.4 / -25.7					+ 4.8 / -27.2				
1.5H	+ 7.2 / -21.2					+ 7.5 / -22.5				
2.0H	+ 8.3 / -14.3					+ 8.0 / -15.8				

CIE Pub.117, 438.3 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.9$)
Area: 0.002 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	96	92	89	86
1.00	102	97	94	101	97	94	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	105	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

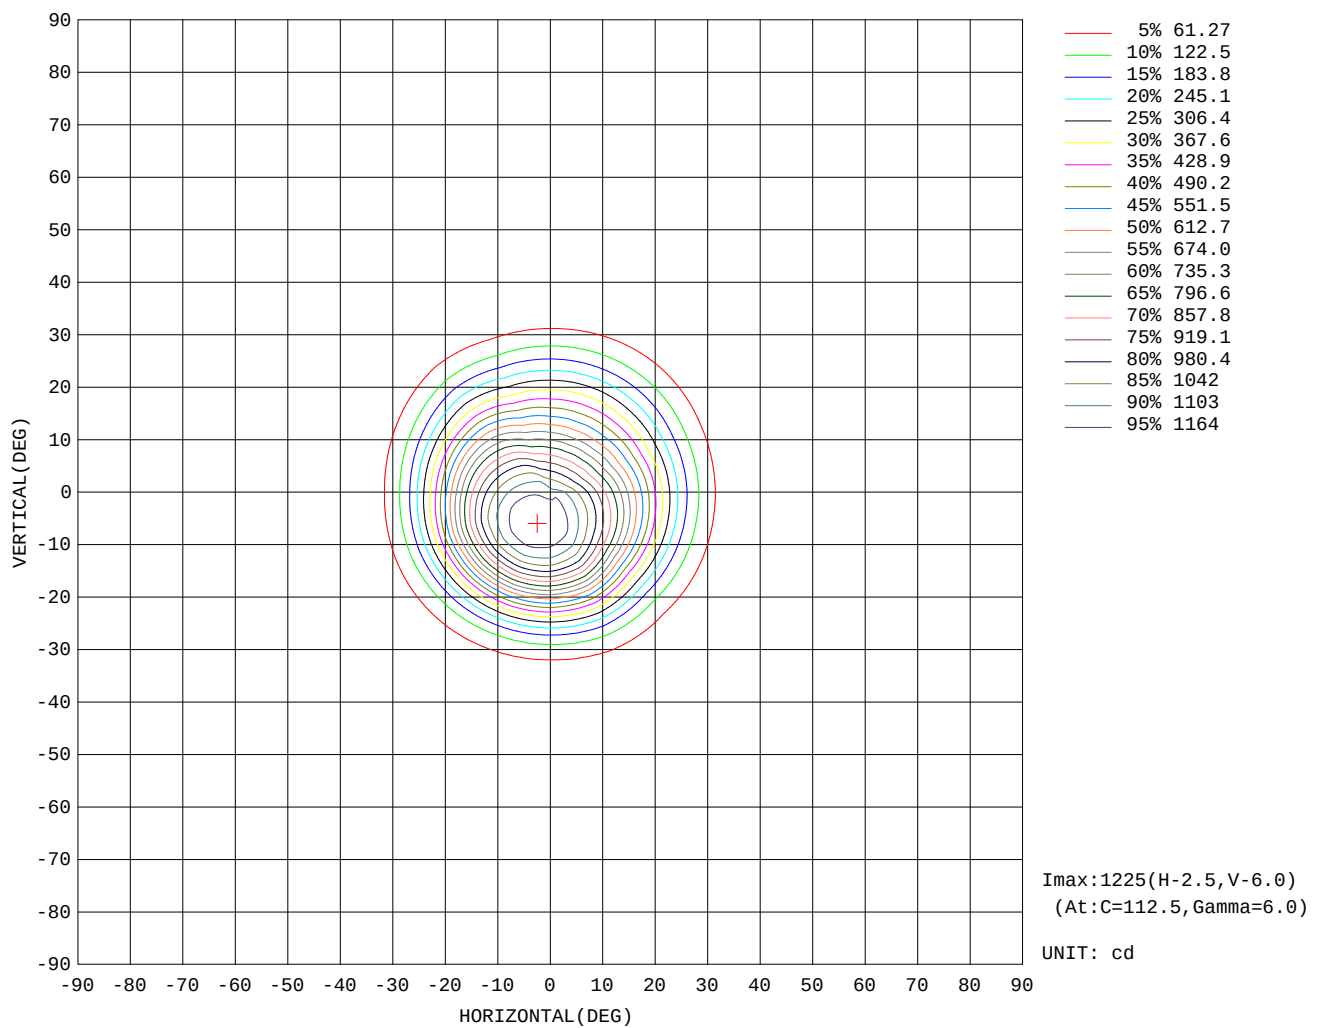

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


AAI Figure

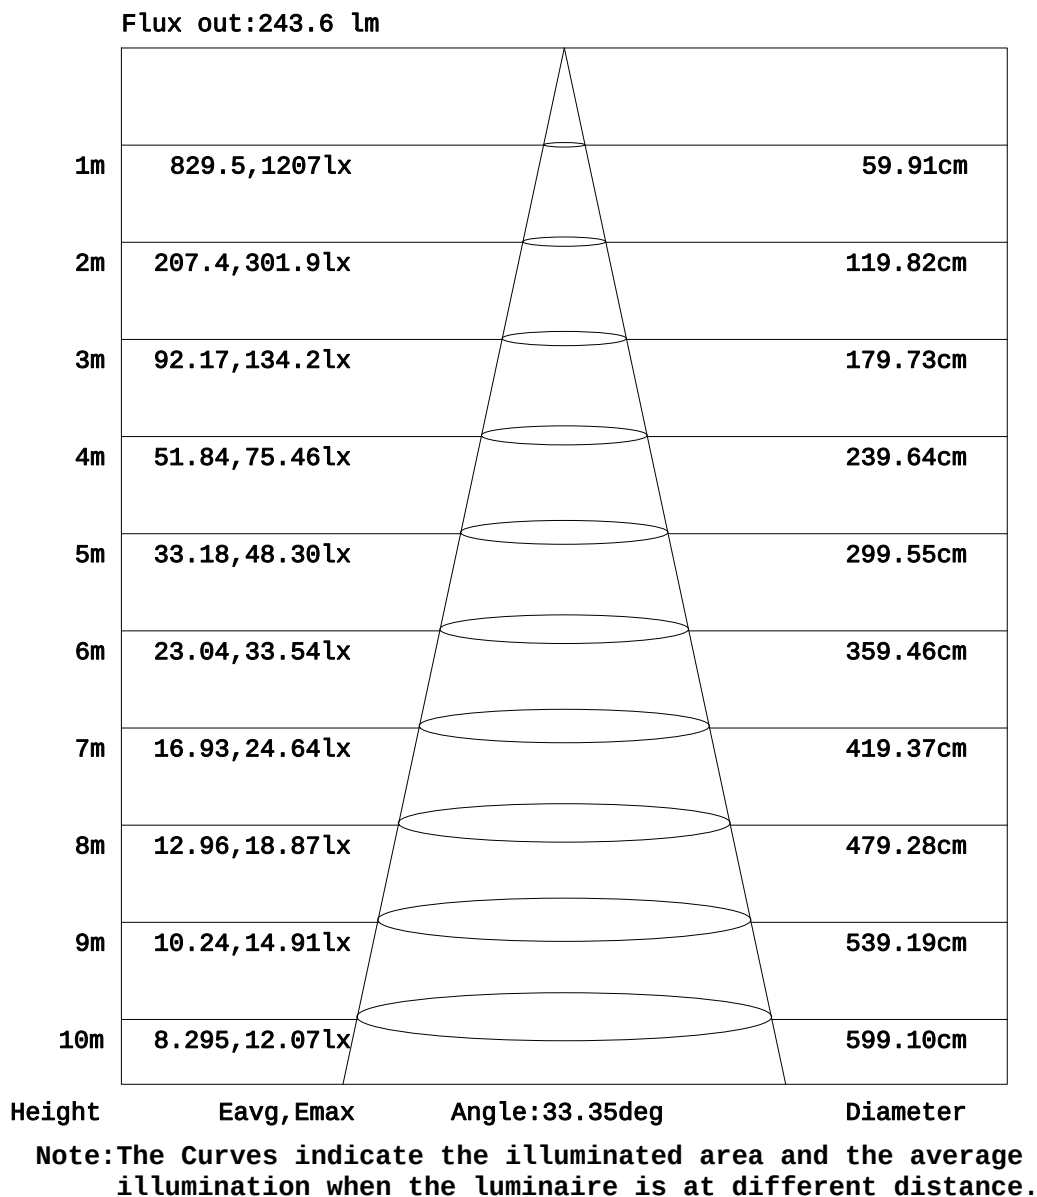

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

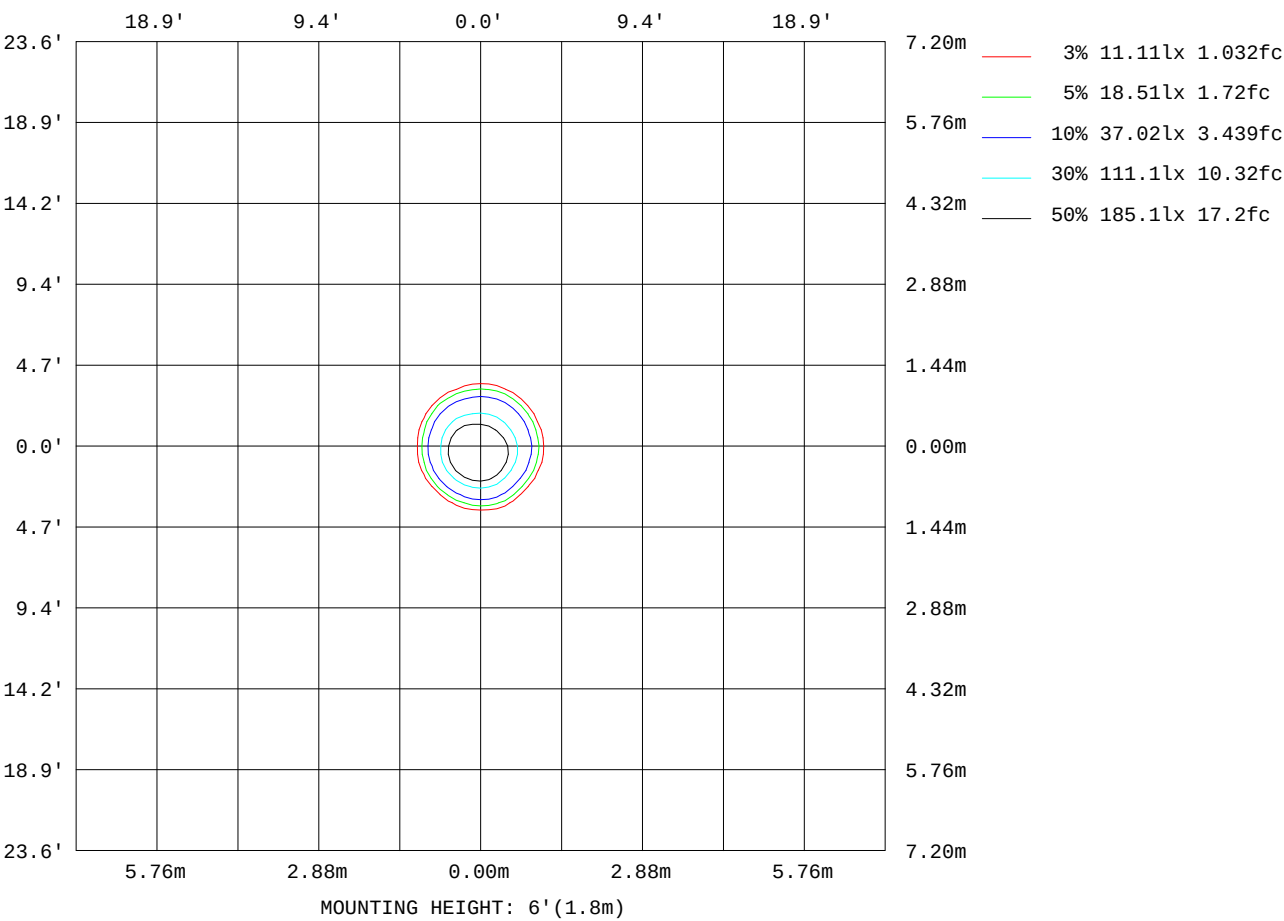

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.13V I:0.0621A P:6.2860W PF:0.4595 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:438.264x1 Lm		
NAME: DDW21-LM07E-330SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	103
L_0~180(75)av	176
L_0~180(85)av	37
L_90~270(65)av	95
L_90~270(75)av	160
L_90~270(85)av	26
L_45(65)av	103
L_45(75)av	169
L_45(85)av	33

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

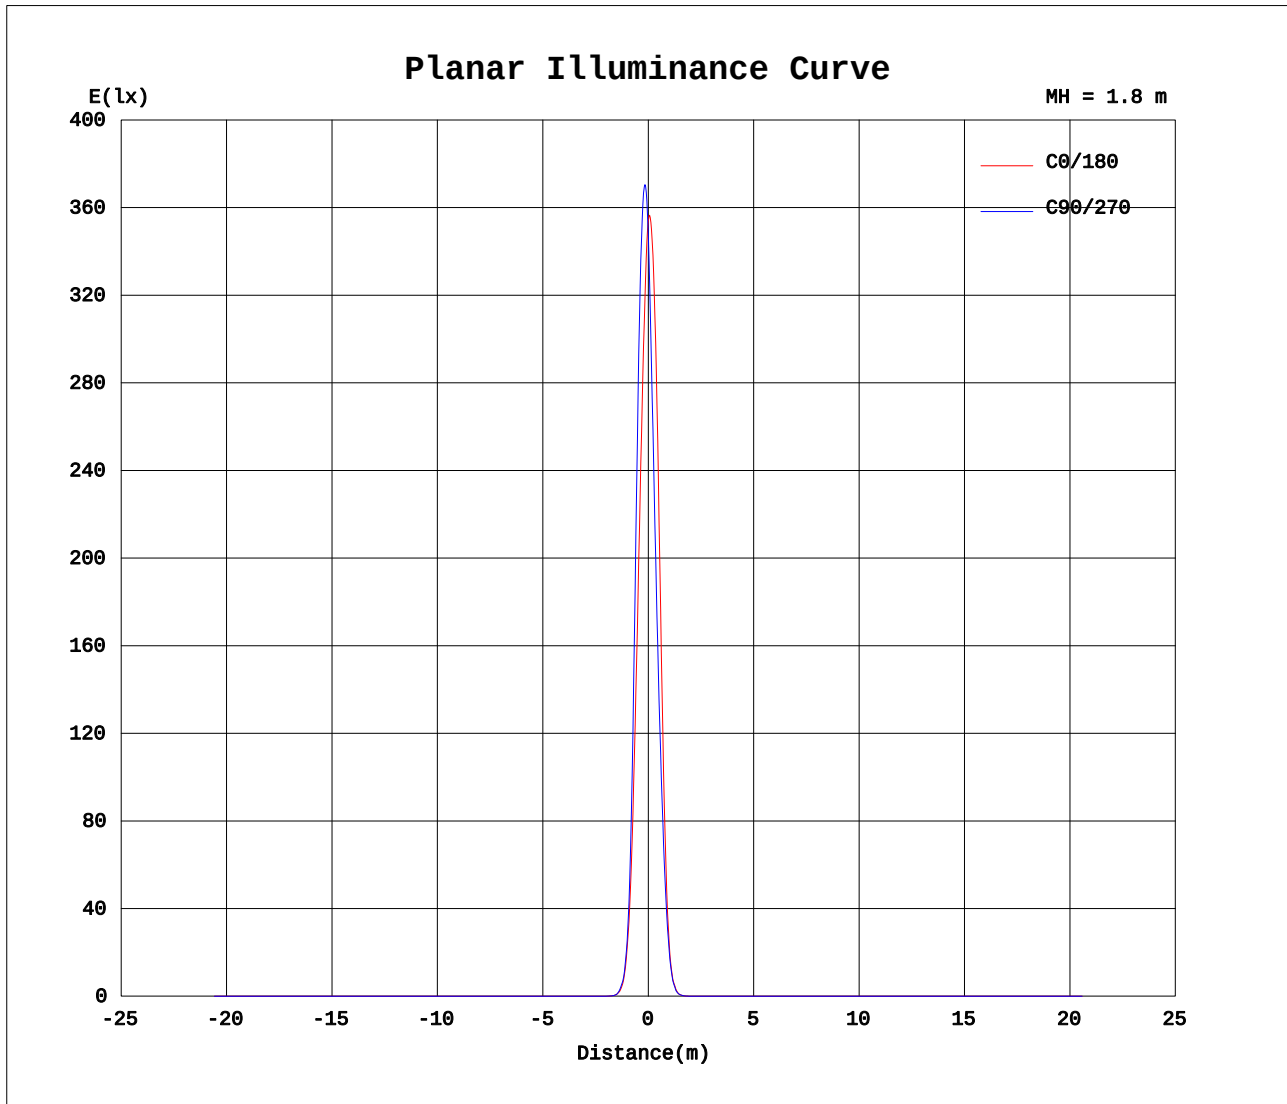

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136	1136			
5	1035	1082	1130	1196	1225	1233	1221	1188	1136	1084	1032	974	949	943	955	984			
10	866	945	1022	1137	1186	1201	1186	1135	1043	954	864	769	736	727	744	788			
15	655	729	804	945	996	1014	997	946	839	745	656	562	533	530	544	581			
20	426	465	501	615	647	654	646	613	534	481	430	362	352	354	362	379			
25	218	226	233	293	296	294	293	288	260	243	233	197	195	195	198	200			
30	87.5	87.0	84.8	106	104	98.4	98.6	99.2	88.8	90.8	93.9	78.1	80.2	81.5	81.2	79.3			
35	25.2	25.2	25.0	32.2	32.0	31.3	30.3	29.2	27.4	28.1	29.5	23.9	24.4	25.1	24.9	24.5			
40	5.88	5.43	5.08	6.67	6.34	5.96	5.91	5.93	5.51	6.09	6.73	5.49	5.47	5.50	5.55	5.42			
45	1.39	1.26	1.16	1.47	1.41	1.37	1.35	1.34	1.19	1.31	1.50	1.12	1.12	1.18	1.26	1.28			
50	0.39	0.35	0.32	0.38	0.37	0.35	0.33	0.34	0.32	0.34	0.37	0.32	0.34	0.36	0.38	0.39			
55	0.13	0.11	0.10	0.12	0.11	0.10	0.10	0.10	0.10	0.11	0.12	0.10	0.11	0.12	0.12	0.12			
60	0.02	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.17	0.16	0.16	0.17	0.17	0.17	0.17	0.17			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.17	0.17	0.15	0.15	0.15	0.15	0.15			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.18	0.19	0.19	0.19	0.19			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.18	0.18	0.18	0.16	0.16	0.16	0.16	0.15			
80	0.01	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.19	0.19	0.18	0.16	0.16	0.16	0.16	0.17			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: