


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.14V I:0.0619A P:6.2766W PF:0.4608 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:467.804x1 lm


NAME: DDW21-LM07E-530SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 74.53 lm/W			
MODEL		Imax(cd)	988.4	S/MH(C0/180)	0.49
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.70
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	467.80	η UP, DN(C0-180)	0.0, 54.1
NOMINAL FLUX(lm)	467.804	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 45.9
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.65

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

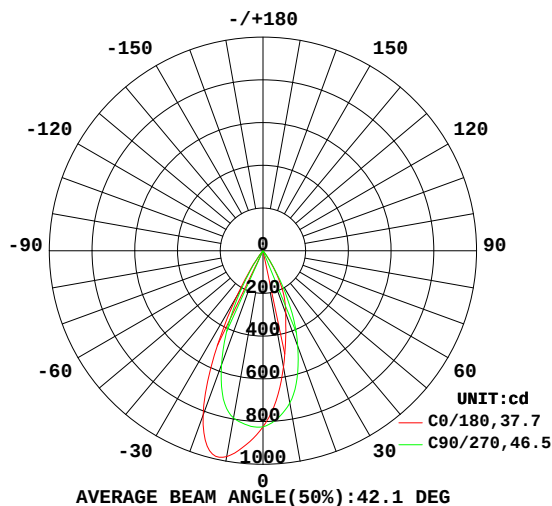

C0 PLANE ISOLUX DIAGRAM (UNIT: lx)

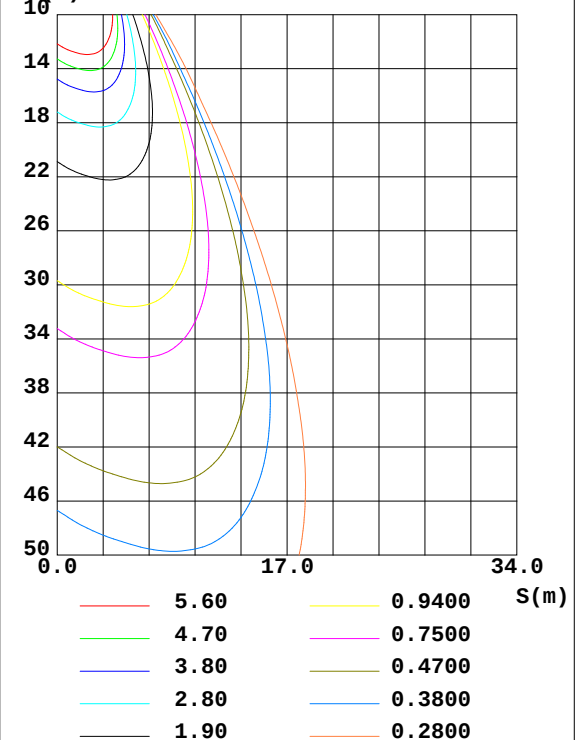

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	978.3	925.1	794.4	632.9	552.9	596.2	723.4	898.6	0- 10	75.65	75.65	16.2
20	820.8	718.2	569.3	385.3	311.6	349.4	476.9	678.9	10- 20	186.0	261.7	55.9
30	245.3	200.7	191.4	148.2	131.9	148.3	160.3	200.9	20- 30	161.7	423.4	90.5
40	11.83	12.12	12.59	11.74	8.509	11.04	8.323	9.888	30- 40	42.08	465.5	99.5
50	0.1378	0.1239	0.1840	0.2280	0.2489	0.2503	0.1788	0.1446	40- 50	2.059	467.5	99.9
60	0.0101	0.0084	0.0110	0.0101	0.1583	0.1554	0.1667	0.1683	50- 60	0.0802	467.6	100
70	0.0071	0.0080	0.0093	0.0080	0.1572	0.1601	0.2253	0.2197	60- 70	0.0793	467.7	100
80	0.0038	0.0038	0.0051	0.0059	0.2081	0.2007	0.1676	0.1675	70- 80	0.0970	467.8	100
90	0	0	0	0	0	0	0	0	80- 90	0.0188	467.8	100
100	0	0	0	0	0	0	0	0	90-100	0	467.8	100
110	0	0	0	0	0	0	0	0	100-110	0	467.8	100
120	0	0	0	0	0	0	0	0	110-120	0	467.8	100
130	0	0	0	0	0	0	0	0	120-130	0	467.8	100
140	0	0	0	0	0	0	0	0	130-140	0	467.8	100
150	0	0	0	0	0	0	0	0	140-150	0	467.8	100
160	0	0	0	0	0	0	0	0	150-160	0	467.8	100
170	0	0	0	0	0	0	0	0	160-170	0	467.8	100
180	0	0	0	0	0	0	0	0	170-180	0	467.8	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 467.25 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 467.61 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:


LUMINANCE LIMITATION CURVES

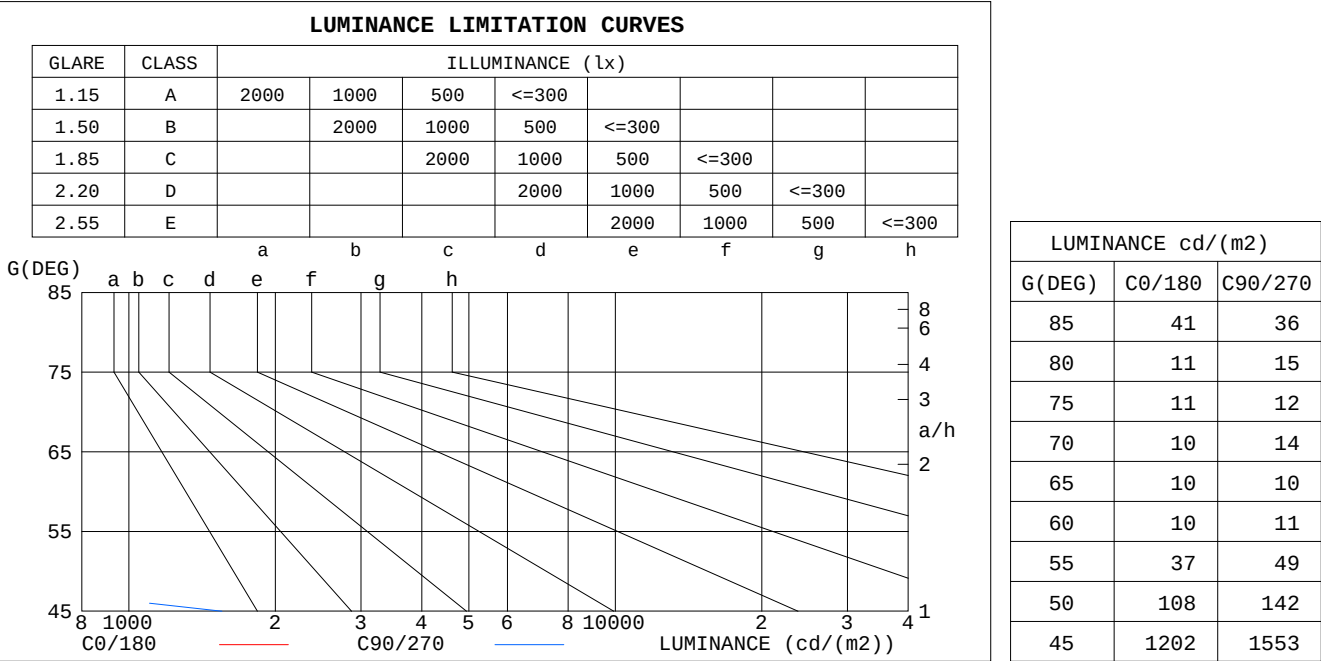

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Temperature:25.3DEG	Humidity:65.0%
Operators:Oliver	Test Distance:2.467m [K=1.0000]
Test Date:2024-09-20	Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97	.95
2.0	1.05	1.02	.99	1.04	1.01	.98	1.01	.98	.96	.98	.96	.94	.95	.93	.92	.90
3.0	.00	.95	.92	.98	.94	.91	.96	.93	.90	.94	.91	.89	.91	.89	.87	.86
4.0	.95	.90	.86	.93	.89	.86	.91	.88	.85	.89	.86	.84	.88	.85	.83	.82
5.0	.90	.85	.81	.89	.84	.81	.87	.83	.80	.86	.82	.79	.84	.81	.79	.78
6.0	.85	.80	.77	.85	.80	.77	.83	.79	.76	.82	.78	.76	.81	.78	.75	.74
7.0	.81	.76	.73	.81	.76	.73	.80	.75	.72	.79	.75	.72	.78	.74	.72	.70
8.0	.78	.73	.69	.77	.72	.69	.76	.72	.69	.75	.71	.69	.74	.71	.68	.67
9.0	.74	.69	.66	.74	.69	.66	.73	.69	.66	.72	.68	.65	.71	.68	.65	.64
10.0	.71	.66	.63	.71	.66	.63	.70	.66	.63	.69	.65	.63	.69	.65	.62	.61

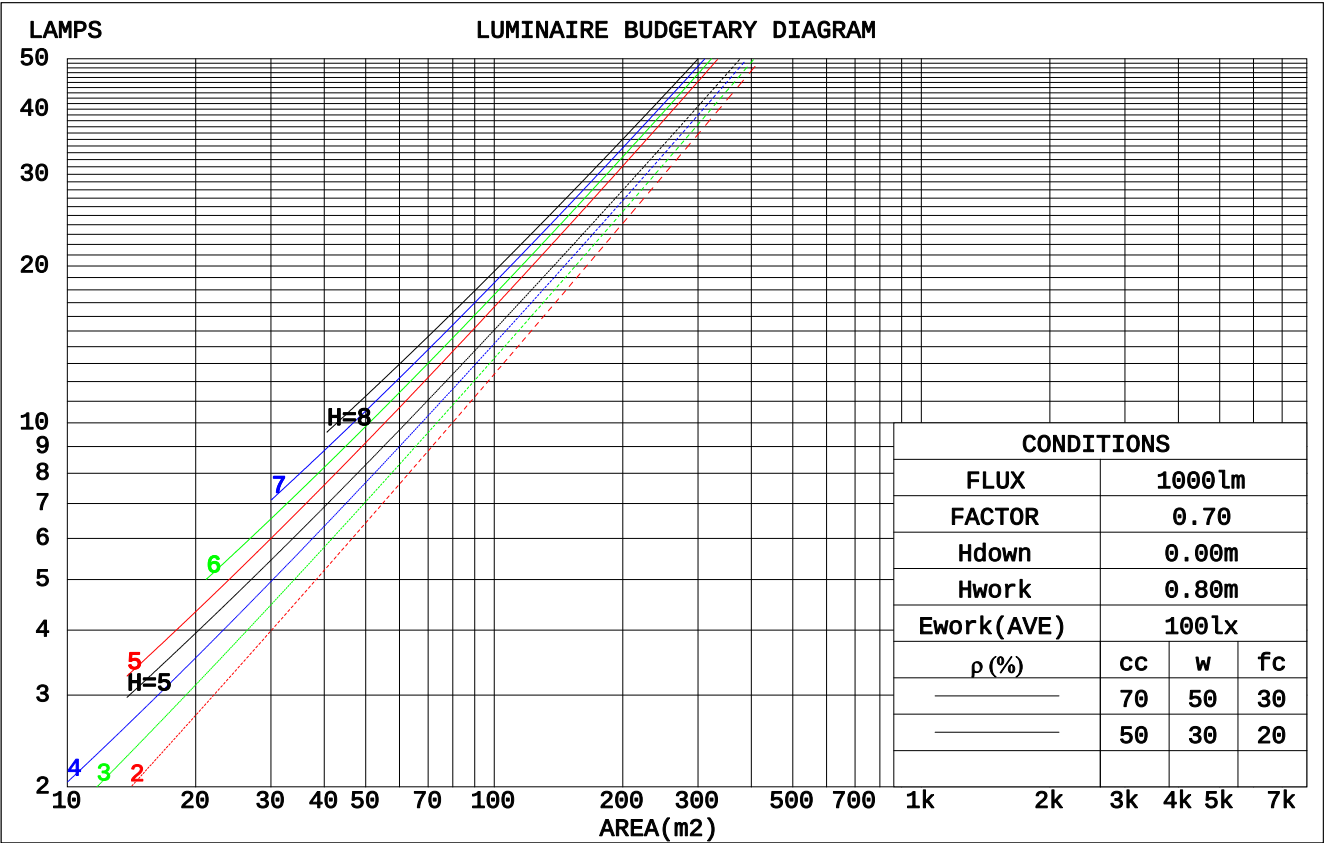

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0	
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.156	.089	.028	.150	.085	.027	.137	.079	.025	.126	.073	.023	.115	.067	.022		
2.0	.148	.081	.025	.142	.078	.024	.132	.073	.023	.122	.068	.021	.113	.064	.020		
3.0	.139	.074	.022	.135	.072	.022	.126	.068	.021	.118	.065	.020	.110	.061	.019		
4.0	.132	.069	.020	.128	.067	.020	.121	.064	.019	.114	.061	.018	.107	.058	.018		
5.0	.126	.064	.019	.123	.063	.018	.116	.060	.018	.110	.058	.017	.104	.056	.017		
6.0	.120	.060	.017	.117	.059	.017	.112	.057	.017	.106	.055	.016	.101	.053	.016		
7.0	.115	.057	.016	.112	.056	.016	.107	.054	.016	.103	.053	.015	.098	.051	.015		
8.0	.110	.054	.015	.108	.053	.015	.104	.052	.015	.100	.050	.015	.096	.049	.014		
9.0	.106	.051	.014	.104	.051	.014	.100	.049	.014	.096	.048	.014	.093	.047	.014		
10.0	.102	.049	.014	.100	.048	.014	.097	.047	.013	.093	.046	.013	.090	.045	.013		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.145	.135	.126	.099	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.153	.133	.115	.131	.114	.100	.090	.079	.070	.052	.046	.041	.017	.015	.013	
3.0	.139	.113	.093	.119	.098	.080	.082	.068	.056	.047	.040	.033	.015	.013	.011	
4.0	.128	.098	.076	.110	.085	.066	.076	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.119	.086	.063	.102	.075	.055	.070	.052	.039	.041	.031	.023	.013	.010	.008	
6.0	.111	.077	.053	.095	.067	.046	.066	.047	.032	.038	.027	.019	.012	.009	.006	
7.0	.104	.069	.045	.089	.060	.039	.062	.042	.028	.036	.025	.016	.012	.008	.005	
8.0	.098	.063	.038	.084	.054	.033	.058	.038	.024	.034	.022	.014	.011	.007	.005	
9.0	.093	.057	.033	.080	.050	.029	.055	.035	.021	.032	.021	.012	.010	.007	.004	
10.0	.088	.053	.029	.076	.046	.025	.053	.032	.018	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	14.6	15.4	14.8	15.5	15.7	14.1	14.9	14.4	15.1	15.3
3H	14.4	15.2	14.7	15.4	15.6	14.0	14.7	14.2	14.9	15.1
4H	14.3	15.0	14.6	15.3	15.5	13.9	14.6	14.2	14.8	15.0
6H	14.3	14.9	14.5	15.1	15.4	13.8	14.5	14.1	14.7	14.9
8H	14.2	14.8	14.5	15.1	15.3	13.8	14.4	14.1	14.6	14.9
12H	14.2	14.8	14.5	15.0	15.3	13.7	14.3	14.0	14.6	14.9
4H 2H	14.3	15.0	14.6	15.3	15.5	13.9	14.6	14.2	14.8	15.0
3H	14.2	14.8	14.5	15.0	15.3	13.7	14.3	14.0	14.6	14.9
4H	14.1	14.6	14.4	14.9	15.2	13.6	14.2	14.0	14.5	14.8
6H	14.0	14.5	14.3	14.8	15.1	13.5	14.0	13.9	14.3	14.7
8H	13.9	14.4	14.3	14.7	15.1	13.5	13.9	13.9	14.3	14.6
12H	13.9	14.3	14.3	14.6	15.0	13.4	13.8	13.8	14.2	14.6
8H 4H	13.9	14.4	14.3	14.7	15.1	13.5	13.9	13.9	14.3	14.6
6H	13.8	14.2	14.2	14.6	15.0	13.4	13.7	13.8	14.1	14.5
8H	13.8	14.1	14.2	14.5	14.9	13.3	13.6	13.8	14.0	14.5
12H	13.7	14.0	14.2	14.4	14.9	13.2	13.5	13.7	14.0	14.4
12H 4H	13.9	14.3	14.3	14.6	15.0	13.4	13.8	13.8	14.2	14.6
6H	13.8	14.1	14.2	14.5	14.9	13.3	13.6	13.8	14.0	14.5
8H	13.7	14.0	14.2	14.4	14.9	13.2	13.5	13.7	14.0	14.4
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.6 / -34.5					+ 4.5 / -33.0				
1.5H	+ 8.4 / -32.6					+ 7.3 / -31.0				
2.0H	+ 9.8 / -15.8					+ 9.9 / -16.9				

CIE Pub.117, 467.8 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.6$)
Area: 0.002 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	98	93	90	96	92	89	86
1.00	102	97	94	101	97	93	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

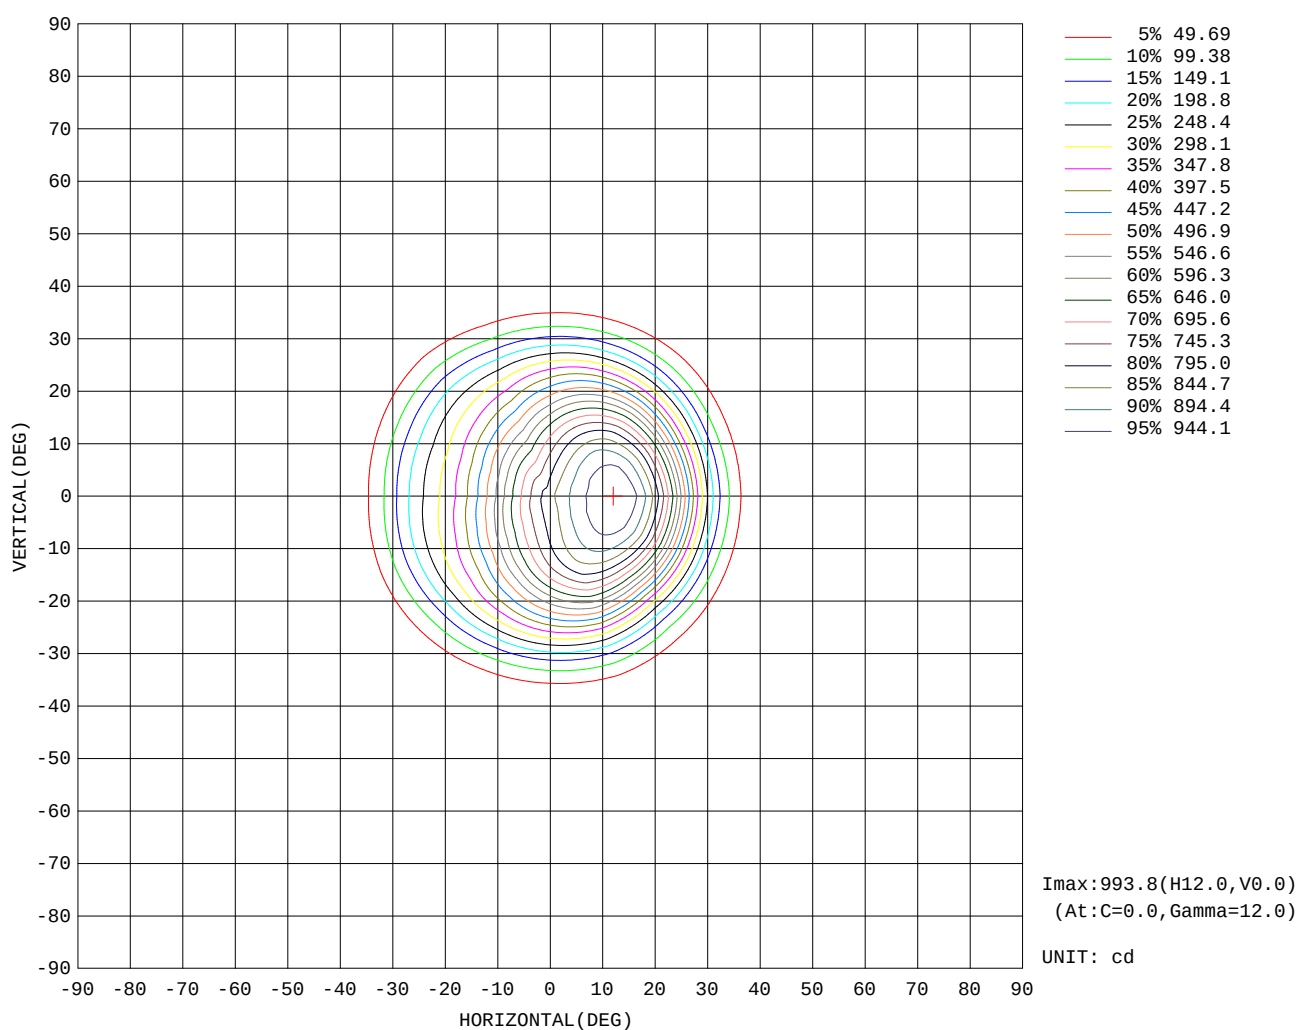

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


AAI Figure

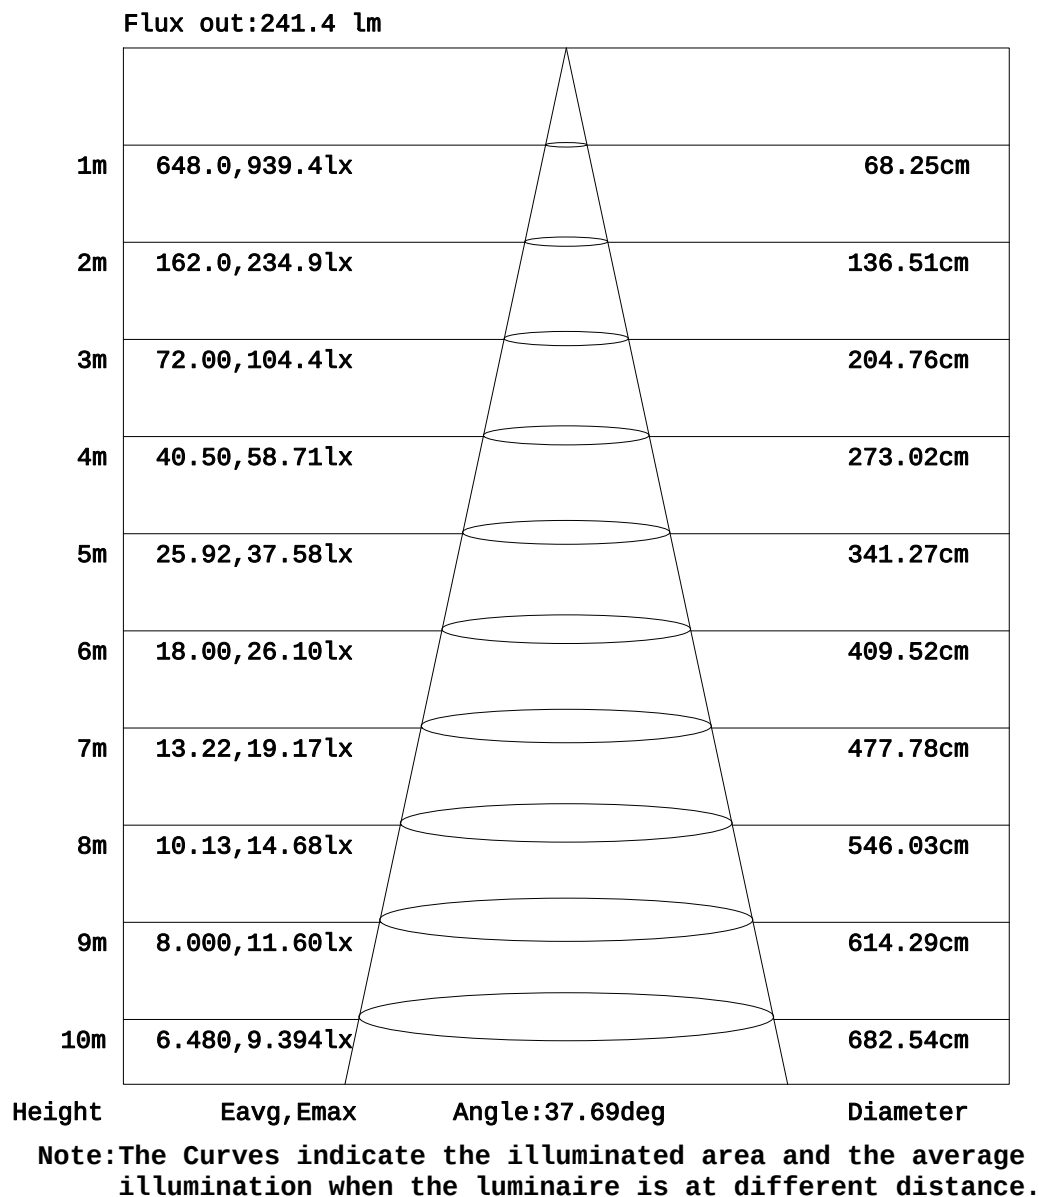

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

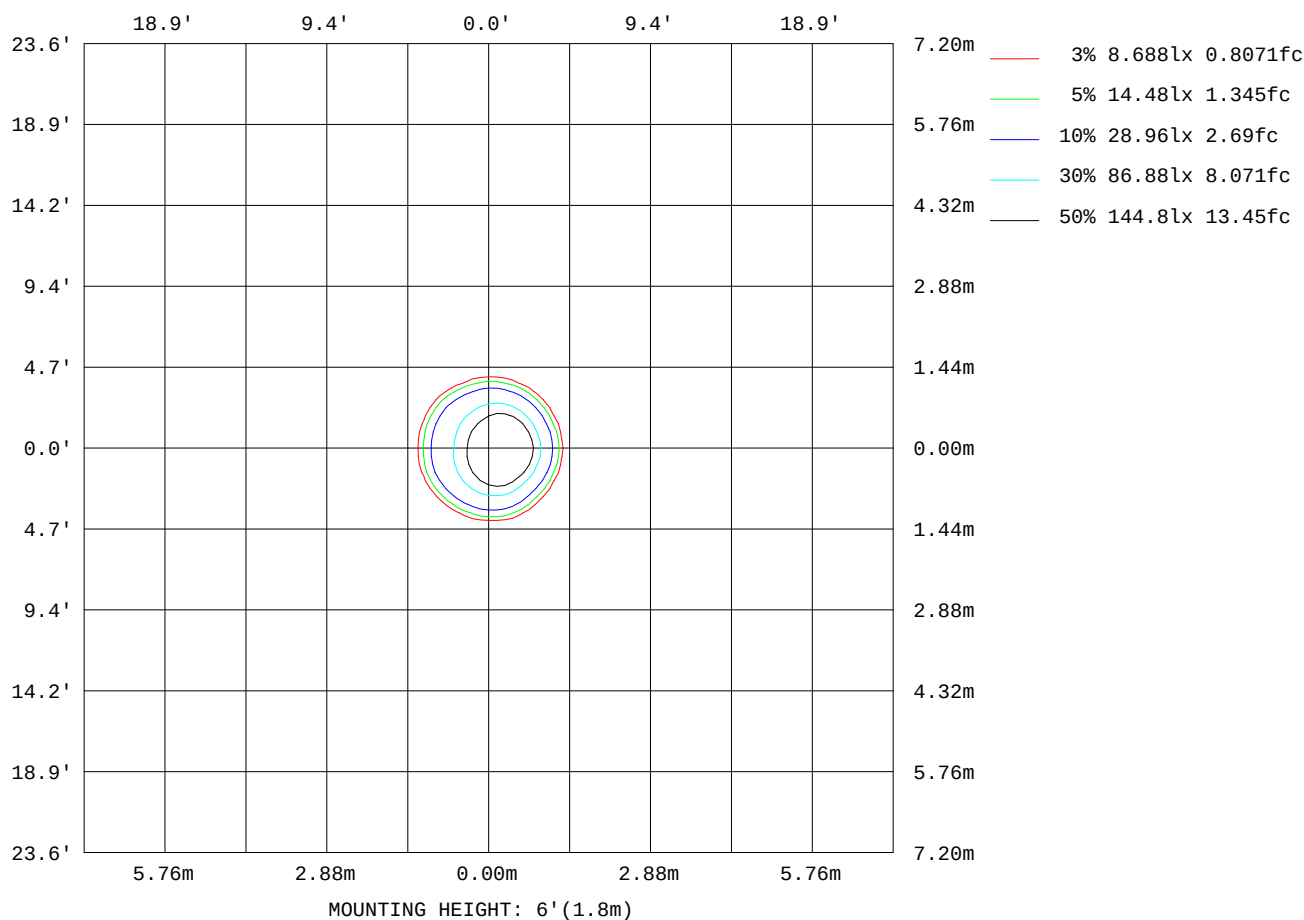

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.14V I:0.0619A P:6.2766W PF:0.4608 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:467.804x1 Lm		
NAME: DDW21-LM07E-530SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	104
L_0~180(75)av	185
L_0~180(85)av	26
L_90~270(65)av	96
L_90~270(75)av	168
L_90~270(85)av	33
L_45(65)av	101
L_45(75)av	173
L_45(85)av	27

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

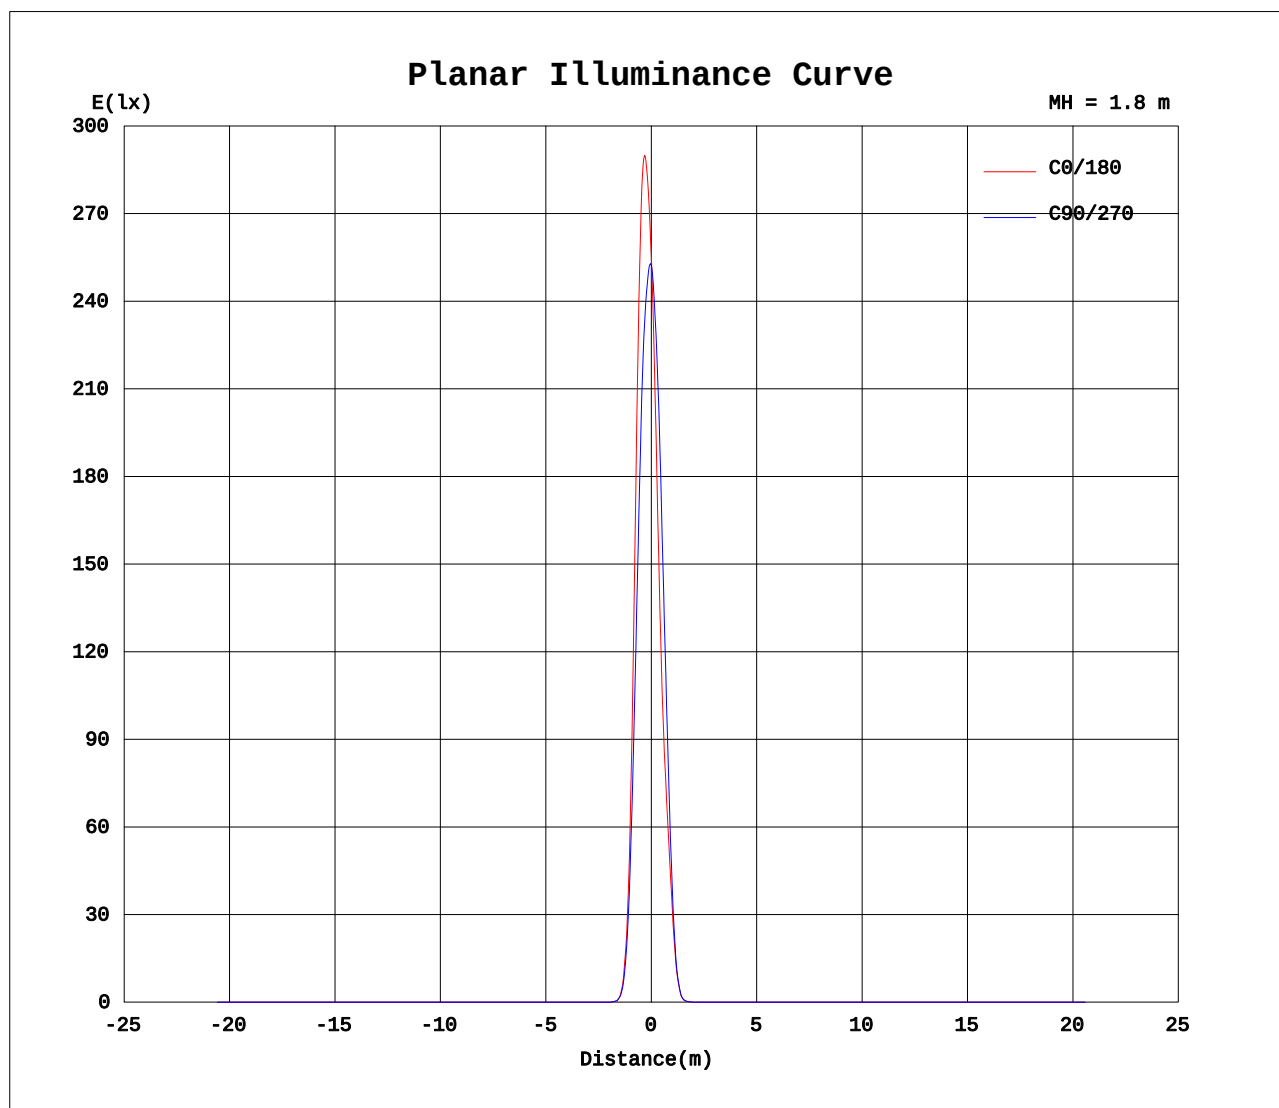

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	824	824	824	824	824	824	824	824	824	824	824	824	824	824	824	824			
5	912	908	888	861	820	779	744	721	705	710	727	747	788	832	872	899			
10	978	966	925	875	794	707	633	584	553	561	596	641	723	815	899	953			
15	969	946	887	830	718	601	507	447	413	423	463	517	617	735	847	923			
20	821	792	718	678	569	465	385	337	312	317	349	393	477	578	679	756			
25	539	510	450	449	385	319	274	252	233	234	255	274	323	378	435	482			
30	245	228	201	219	191	164	148	145	132	136	148	143	160	179	201	216			
35	78.6	67.3	65.2	71.3	60.8	52.2	49.9	50.1	44.2	48.3	53.1	44.5	48.4	54.9	61.4	64.4			
40	11.8	12.6	12.1	13.6	12.6	11.7	11.7	11.8	8.51	10.4	11.0	8.20	8.32	9.25	9.89	9.58			
45	1.69	1.54	1.42	1.71	2.21	2.23	2.14	2.24	1.33	2.36	2.63	1.84	1.79	1.56	1.17	1.26			
50	0.14	0.13	0.12	0.18	0.18	0.21	0.23	0.24	0.25	0.25	0.25	0.20	0.18	0.16	0.14	0.13			
55	0.04	0.04	0.04	0.05	0.06	0.06	0.07	0.08	0.08	0.09	0.09	0.06	0.06	0.05	0.05	0.04			
60	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.17	0.17	0.17	0.17	0.17			
65	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.17	0.17	0.17	0.15	0.15	0.15	0.15	0.15			
70	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.16	0.16	0.16	0.22	0.23	0.22	0.22	0.22			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.19	0.19	0.19	0.17	0.17	0.16	0.16	0.15			
80	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.00	0.21	0.20	0.20	0.17	0.17	0.17	0.17	0.17			
85	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.01	0.01	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: