


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.08V I:0.0942A P:19.439W PF:0.9377 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:1202.23x1 lm


NAME: DDW41-LM18E-130SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 61.85 lm/W
MODEL		Imax(cd)	12401	S/MH(C0/180)	0.27	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.30	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	1202.2	η UP, DN(C0-180)	0.0, 48.8	
NOMINAL FLUX(lm)	1202.23	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 51.2	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	1.00	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

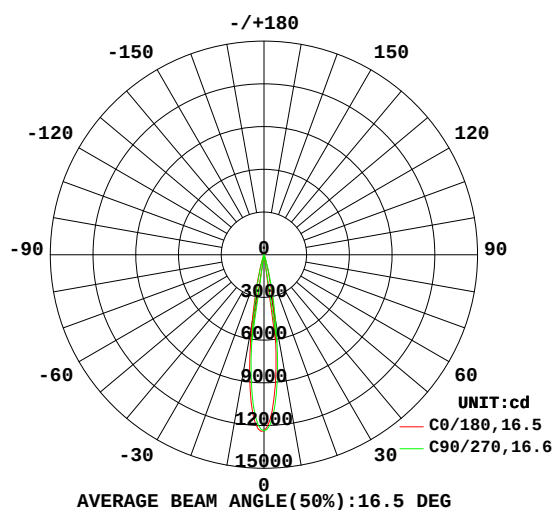

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

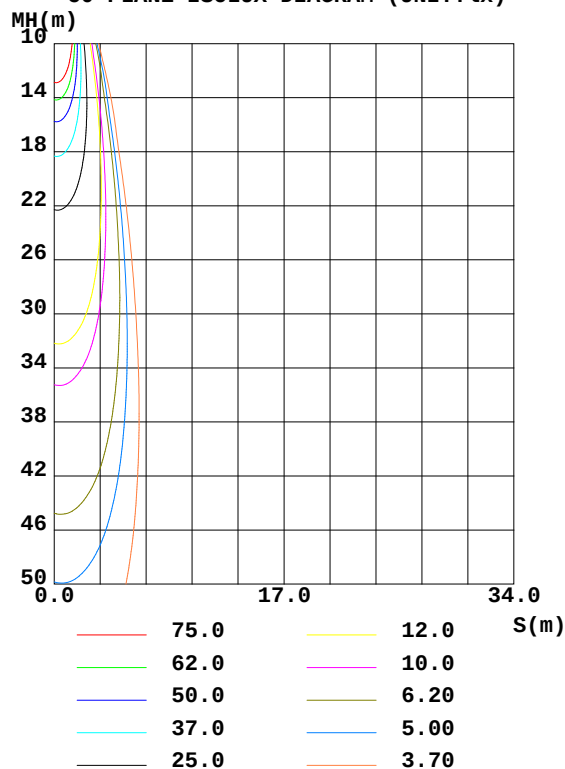

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	487.4	454.6	413.8	381.2	386.5	422.4	467.2	486.2	0- 10	750.0	750.0	62.4
20	24.57	21.97	20.12	18.68	20.35	26.52	30.99	30.15	10- 20	383.9	1134	94.3
30	5.334	4.543	4.727	4.273	4.944	4.742	5.393	4.927	20- 30	45.11	1179	98.1
40	1.569	1.382	1.391	1.213	1.326	1.431	1.601	1.481	30- 40	18.75	1198	99.6
50	0.1305	0.1155	0.1039	0.0954	0.0938	0.1000	0.1098	0.1202	40- 50	3.858	1202	100
60	0.0039	0.0040	0.0031	0.0024	0.0174	0.0179	0.0183	0.0190	50- 60	0.3701	1202	100
70	0.0013	0.0014	0.0013	0.0013	0.0179	0.0179	0.0180	0.0178	60- 70	0.0919	1202	100
80	0.0009	0.0010	0.0009	0.0011	0.0240	0.0237	0.0241	0.0242	70- 80	0.1039	1202	100
90	0	0	0	0	0	0	0	0	80- 90	0.0289	1202	100
100	0	0	0	0	0	0	0	0	90-100	0	1202	100
110	0	0	0	0	0	0	0	0	100-110	0	1202	100
120	0	0	0	0	0	0	0	0	110-120	0	1202	100
130	0	0	0	0	0	0	0	0	120-130	0	1202	100
140	0	0	0	0	0	0	0	0	130-140	0	1202	100
150	0	0	0	0	0	0	0	0	140-150	0	1202	100
160	0	0	0	0	0	0	0	0	150-160	0	1202	100
170	0	0	0	0	0	0	0	0	160-170	0	1202	100
180	0	0	0	0	0	0	0	0	170-180	0	1202	100
DEG	LUMINOUS INTENSITY:×10cd									UNIT: lm		

Conical surface Flux(90deg): 1200.7 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 1202 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

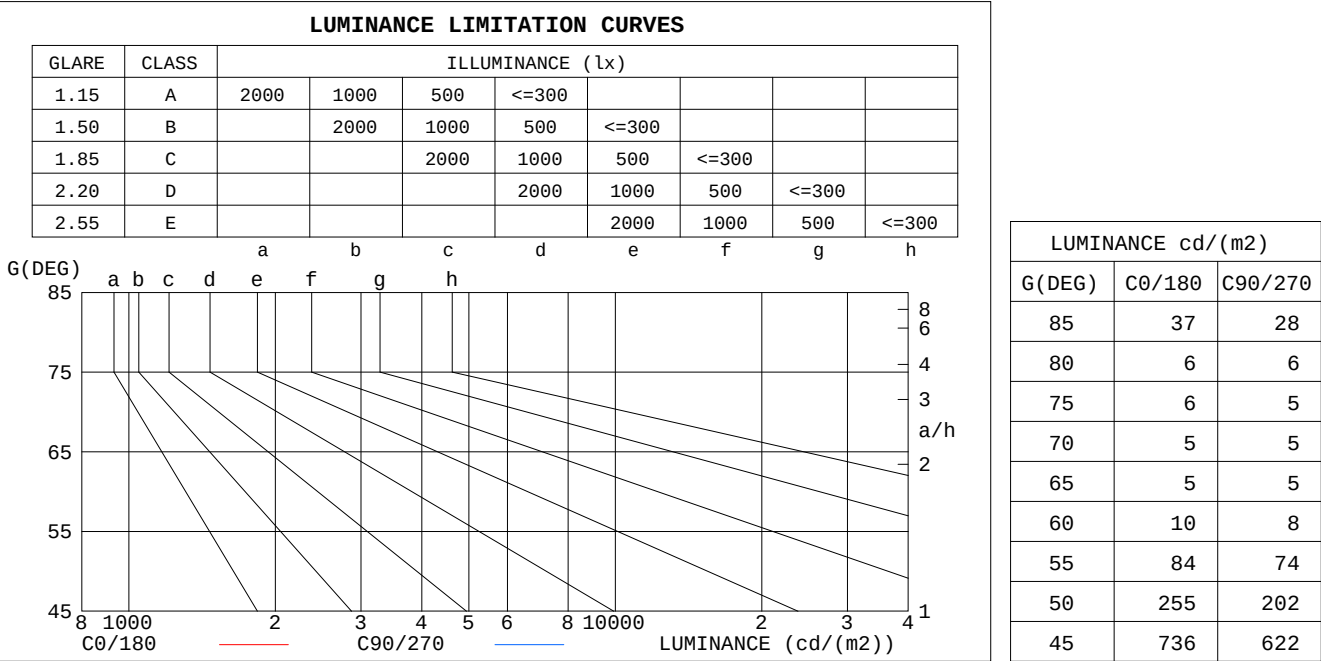

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.14	1.12	1.11	1.12	1.11	1.09	1.08	1.07	1.06	1.04	1.04	1.03	1.01	1.00	.00	.98
2.0	1.10	1.08	1.05	1.08	1.06	1.04	1.05	1.04	1.02	1.03	1.01	.00	.00	.99	.98	.97
3.0	1.07	1.04	1.01	1.05	1.03	1.01	1.03	1.01	.99	1.01	.99	.98	.99	.97	.96	.95
4.0	1.04	1.01	.98	1.03	.00	.98	1.01	.99	.97	.99	.97	.96	.97	.96	.95	.94
5.0	1.01	.98	.96	1.00	.98	.95	.99	.96	.95	.98	.95	.94	.96	.94	.93	.92
6.0	.99	.96	.94	.98	.95	.93	.97	.95	.93	.96	.94	.92	.95	.93	.92	.91
7.0	.97	.94	.92	.97	.94	.92	.96	.93	.91	.95	.92	.91	.94	.92	.90	.90
8.0	.95	.92	.90	.95	.92	.90	.94	.92	.90	.93	.91	.89	.93	.91	.89	.88
9.0	.94	.91	.89	.93	.91	.89	.93	.90	.88	.92	.90	.88	.92	.89	.88	.87
10.0	.92	.89	.87	.92	.89	.87	.92	.89	.87	.91	.89	.87	.90	.88	.87	.86

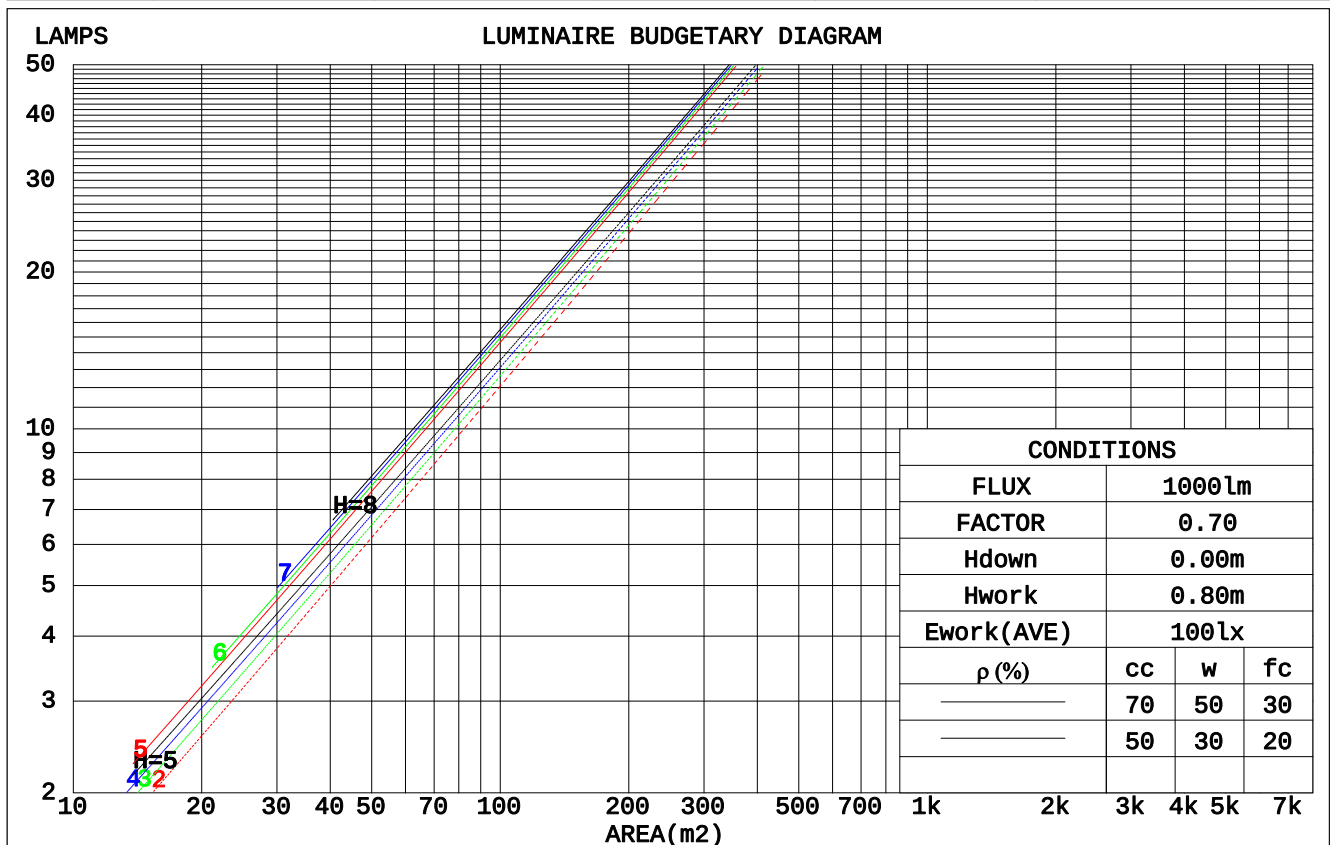

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.115	.065	.021	.108	.062	.020	.096	.055	.018	.085	.049	.016	.074	.043	.014	
2.0	.104	.057	.018	.099	.054	.017	.089	.049	.015	.080	.045	.014	.071	.040	.013	
3.0	.095	.051	.015	.091	.049	.015	.083	.045	.014	.075	.041	.013	.068	.038	.012	
4.0	.088	.046	.013	.084	.044	.013	.077	.041	.012	.071	.038	.012	.065	.035	.011	
5.0	.082	.042	.012	.079	.040	.012	.073	.038	.011	.068	.036	.011	.062	.033	.010	
6.0	.076	.038	.011	.074	.037	.011	.069	.035	.010	.064	.033	.010	.060	.032	.009	
7.0	.072	.035	.010	.069	.035	.010	.065	.033	.010	.061	.031	.009	.058	.030	.009	
8.0	.068	.033	.009	.066	.032	.009	.062	.031	.009	.059	.030	.009	.056	.029	.008	
9.0	.064	.031	.009	.062	.030	.009	.059	.029	.008	.056	.028	.008	.054	.027	.008	
10.0	.061	.029	.008	.059	.029	.008	.057	.028	.008	.054	.027	.008	.052	.026	.007	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.167	.158	.150	.143	.135	.129	.098	.093	.089	.056	.054	.052	.018	.017	.017	
2.0	.147	.133	.121	.126	.114	.104	.086	.079	.073	.050	.046	.043	.016	.015	.014	
3.0	.131	.113	.099	.112	.098	.086	.077	.068	.060	.044	.040	.035	.014	.013	.012	
4.0	.117	.097	.082	.100	.084	.072	.069	.059	.050	.040	.034	.030	.013	.011	.010	
5.0	.106	.085	.069	.091	.073	.060	.062	.051	.043	.036	.030	.025	.012	.010	.008	
6.0	.096	.074	.059	.082	.064	.051	.057	.045	.036	.033	.026	.022	.011	.009	.007	
7.0	.087	.066	.051	.075	.057	.044	.052	.040	.031	.030	.024	.019	.010	.008	.006	
8.0	.080	.059	.044	.069	.051	.038	.048	.036	.027	.028	.021	.016	.009	.007	.005	
9.0	.074	.053	.038	.064	.046	.033	.044	.032	.024	.026	.019	.014	.008	.006	.005	
10.0	.069	.048	.034	.059	.041	.029	.041	.029	.021	.024	.017	.012	.008	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	0.1	0.5	0.2	0.7	0.8	-0.5	0.0	-0.3	0.1	0.3
3H	-0.1	0.4	0.1	0.6	0.7	-0.6	-0.2	-0.4	0.0	0.2
4H	-0.2	0.3	0.1	0.5	0.7	-0.7	-0.2	-0.4	-0.0	0.2
6H	-0.2	0.2	0.0	0.4	0.6	-0.8	-0.3	-0.5	-0.1	0.1
8H	-0.3	0.1	0.0	0.4	0.6	-0.8	-0.4	-0.5	-0.2	0.1
12H	-0.3	0.1	-0.0	0.3	0.6	-0.9	-0.5	-0.6	-0.2	0.1
4H 2H	-0.2	0.3	0.1	0.5	0.7	-0.7	-0.2	-0.4	-0.0	0.2
3H	-0.3	0.1	-0.0	0.3	0.6	-0.9	-0.5	-0.6	-0.2	0.1
4H	-0.4	-0.0	-0.1	0.2	0.5	-1.0	-0.6	-0.6	-0.3	-0.0
6H	-0.5	-0.2	-0.2	0.1	0.5	-1.1	-0.7	-0.7	-0.4	-0.1
8H	-0.6	-0.3	-0.2	0.1	0.4	-1.1	-0.8	-0.7	-0.5	-0.1
12H	-0.6	-0.4	-0.2	0.0	0.4	-1.2	-0.9	-0.8	-0.5	-0.1
8H 4H	-0.6	-0.3	-0.2	0.1	0.4	-1.1	-0.8	-0.7	-0.5	-0.1
6H	-0.7	-0.4	-0.3	-0.1	0.4	-1.2	-1.0	-0.8	-0.6	-0.2
8H	-0.8	-0.5	-0.3	-0.1	0.3	-1.3	-1.1	-0.9	-0.7	-0.2
12H	-0.8	-0.6	-0.4	-0.2	0.3	-1.4	-1.2	-0.9	-0.7	-0.3
12H 4H	-0.6	-0.4	-0.2	0.0	0.4	-1.2	-0.9	-0.8	-0.5	-0.1
6H	-0.8	-0.5	-0.3	-0.1	0.3	-1.3	-1.1	-0.9	-0.7	-0.2
8H	-0.8	-0.6	-0.4	-0.2	0.3	-1.4	-1.2	-0.9	-0.7	-0.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 3.8 / -23.0					+ 3.6 / -22.8				
1.5H	+ 6.4 / -17.4					+ 6.2 / -16.9				
2.0H	+ 7.4 / -18.1					+ 7.3 / -17.9				

CIE Pub.117, 1202 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 0.6$)
Area: 0.008 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	89	86
1.00	102	97	94	101	97	94	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	105	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

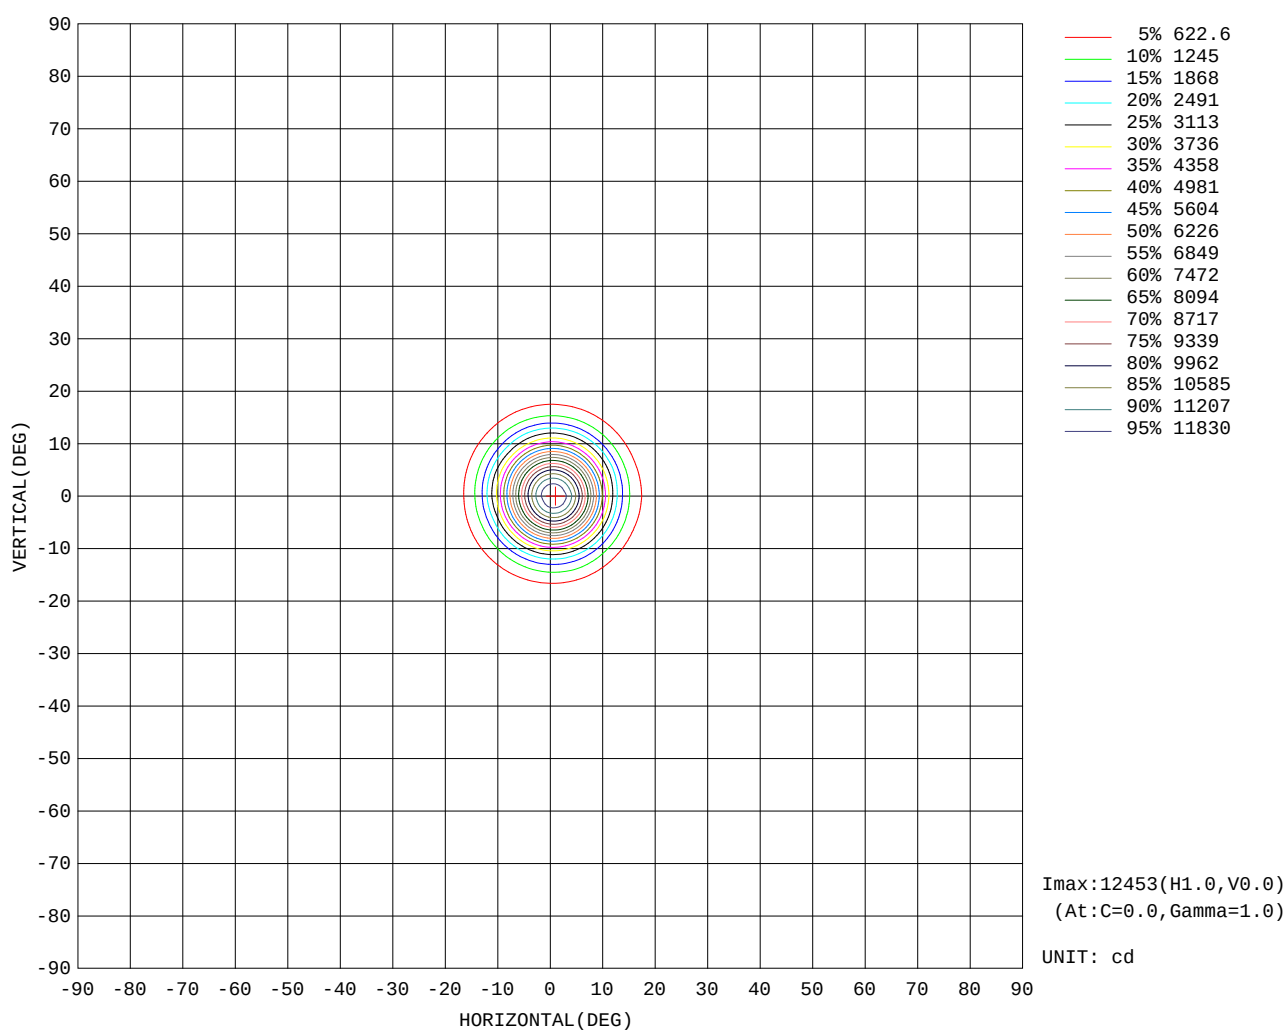

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


AAI Figure

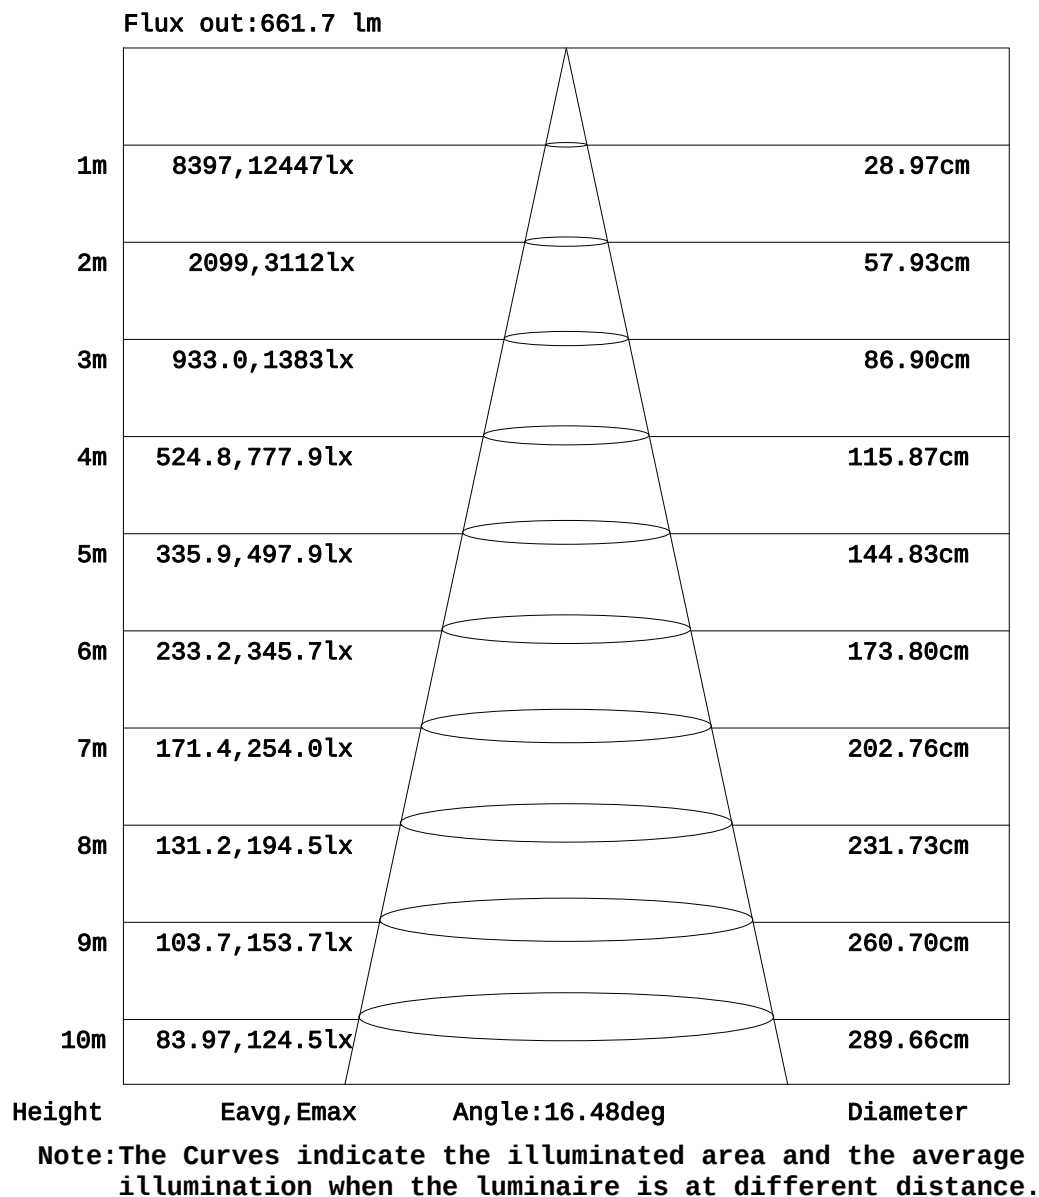

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

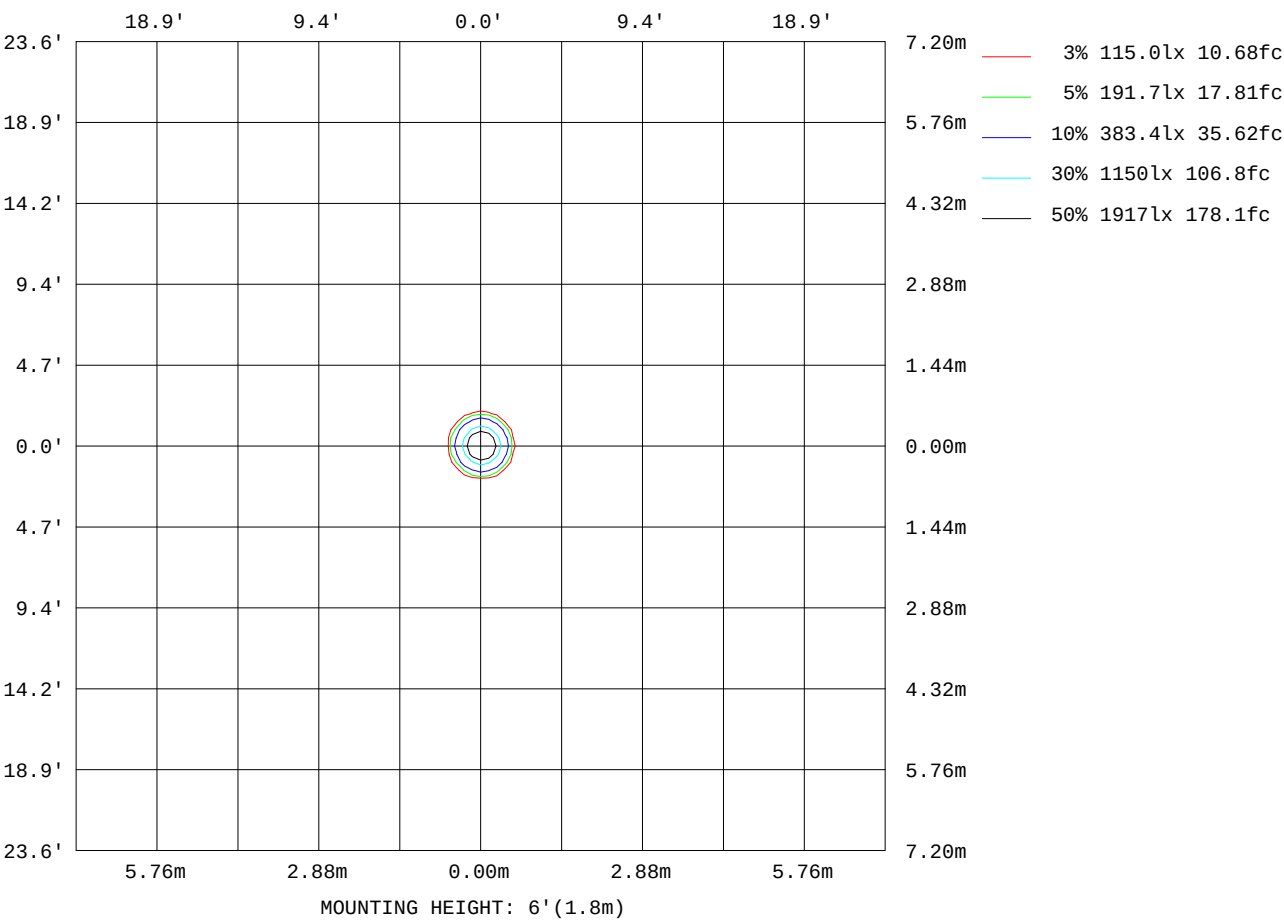

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.08V I:0.0942A P:19.439W PF:0.9377 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:1202.23x1 Lm		
NAME: DDW41-LM18E-130SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	29
L_0~180(75)av	50
L_0~180(85)av	25
L_90~270(65)av	29
L_90~270(75)av	50
L_90~270(85)av	20
L_45(65)av	29
L_45(75)av	50
L_45(85)av	19

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

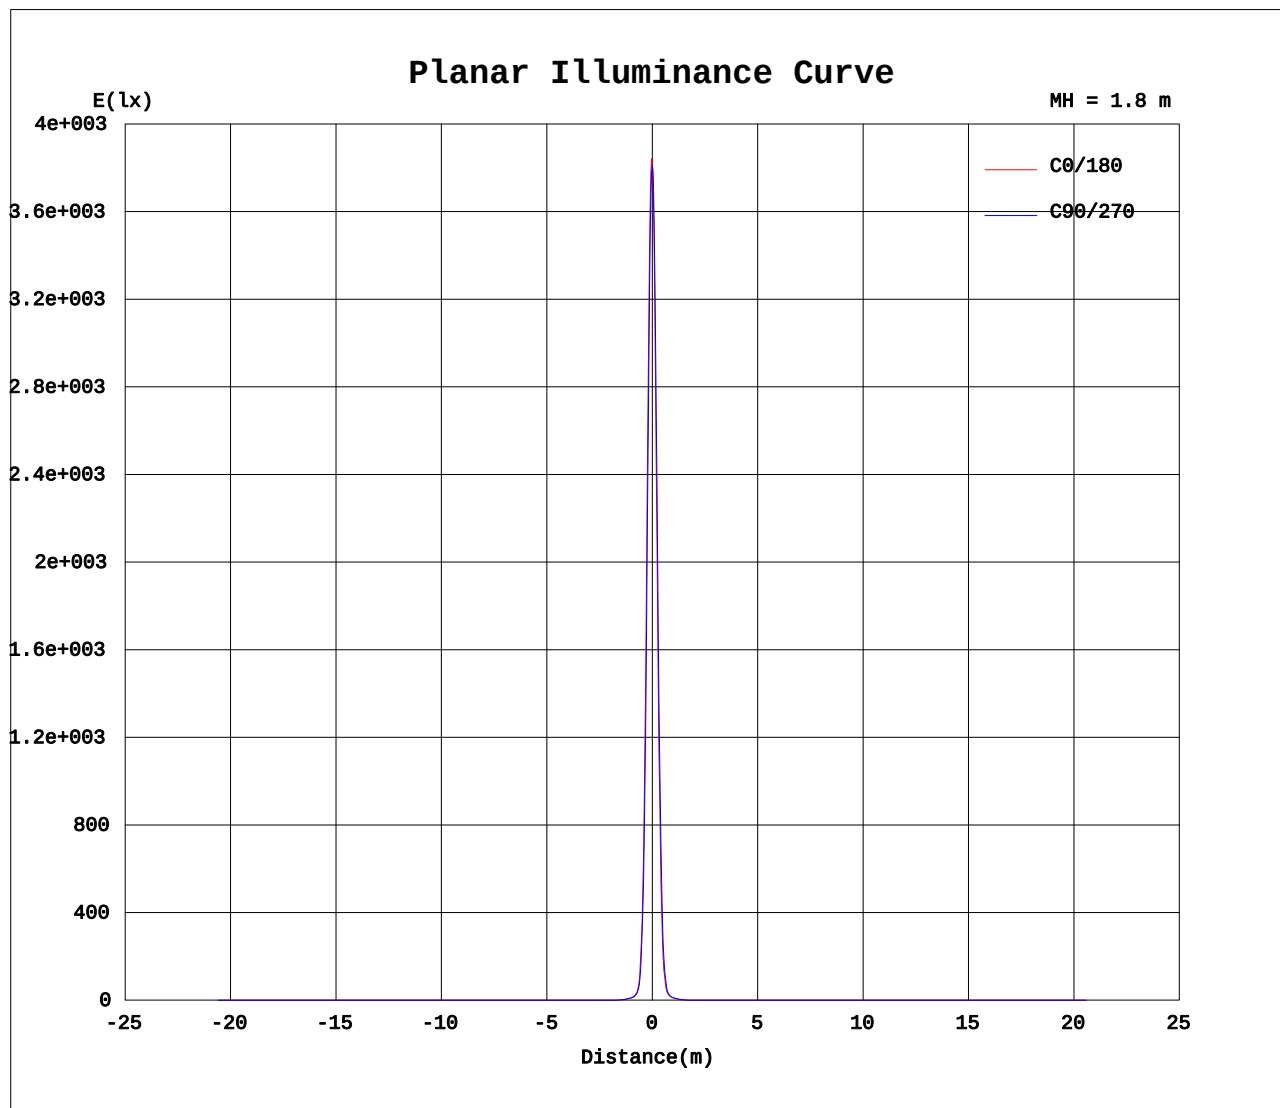

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: ×10cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237	1237			
5	1043	1034	1019	998	972	948	929	918	917	929	947	969	993	1013	1028	1039			
10	487	473	455	434	414	393	381	381	386	402	422	445	467	480	486	490			
15	128	122	116	117	110	105	102	102	100	108	117	128	135	139	137	133			
20	24.6	23.2	22.0	21.2	20.1	19.1	18.7	19.2	20.3	21.8	26.5	29.3	31.0	31.1	30.2	29.2			
25	9.64	8.87	8.30	8.20	7.82	7.51	7.31	7.79	8.15	8.42	8.57	9.10	9.37	9.31	9.03	9.33			
30	5.33	5.07	4.54	4.81	4.73	4.55	4.27	4.72	4.94	4.93	4.74	5.24	5.39	5.28	4.93	5.35			
35	3.24	3.04	2.66	2.90	2.90	2.79	2.56	2.82	2.98	2.97	2.82	3.20	3.30	3.20	2.93	3.23			
40	1.57	1.51	1.38	1.41	1.39	1.33	1.21	1.30	1.33	1.40	1.43	1.54	1.60	1.58	1.48	1.58			
45	0.41	0.41	0.37	0.35	0.35	0.33	0.33	0.33	0.32	0.34	0.36	0.38	0.40	0.40	0.39	0.42			
50	0.13	0.12	0.12	0.11	0.10	0.10	0.10	0.09	0.09	0.10	0.10	0.10	0.11	0.12	0.12	0.12			
55	0.04	0.04	0.04	0.04	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.04			
60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02			
65	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02			
70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02			
75	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02			
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02			
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: