


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.08V I:0.0929A P:19.115W PF:0.9346 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:1601.99x1 lm


NAME: DDW41-LM18E-330SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 83.81 lm/W
MODEL		Imax(cd)	6039	S/MH(C0/180)	0.48	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.50	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	1602.0	η UP, DN(C0-180)	0.0, 46.5	
NOMINAL FLUX(lm)	1601.99	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 53.5	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.50	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

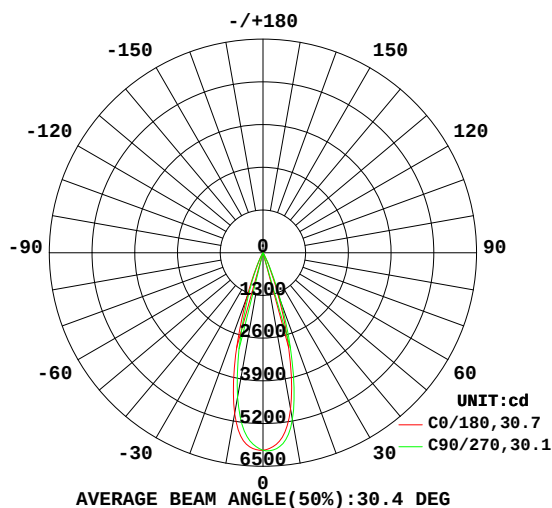

C0 PLANE ISOLUX DIAGRAM (UNIT: lx)

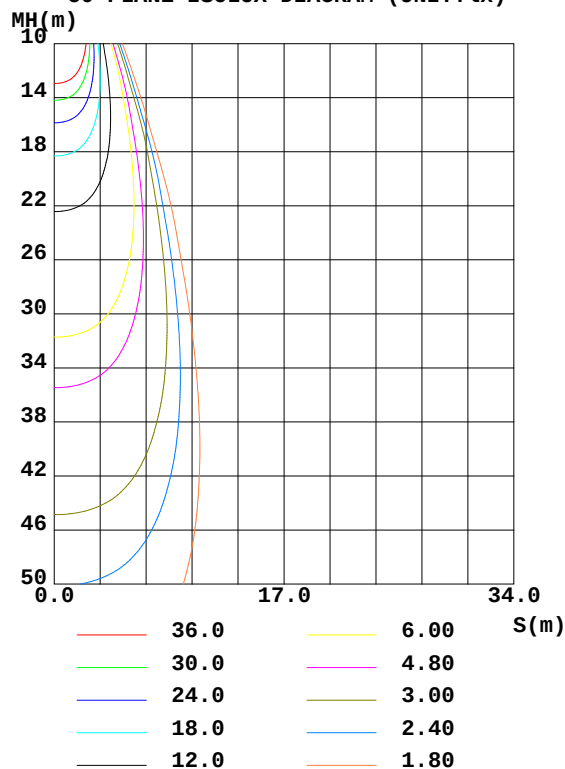

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	4972	4641	4463	4542	4829	5012	5153	5217	0- 10	523.5	523.5	32.7
20	1416	1226	1153	1160	1335	1490	1618	1671	10- 20	824.6	1348	84.2
30	110.6	106.7	103.9	83.77	84.31	99.82	124.4	127.7	20- 30	227.0	1575	98.3
40	9.818	8.854	8.502	6.854	7.860	9.073	10.08	11.36	30- 40	24.59	1600	99.9
50	0.3221	0.2886	0.2727	0.2630	0.2801	0.2972	0.3233	0.3659	40- 50	1.878	1602	100
60	0.0250	0.0328	0.0203	0.0182	0.1734	0.1752	0.1785	0.1831	50- 60	0.1181	1602	100
70	0.0143	0.0147	0.0152	0.0144	0.1737	0.1740	0.1762	0.1764	60- 70	0.0947	1602	100
80	0.0113	0.0109	0.0114	0.0114	0.2331	0.2318	0.2361	0.2352	70- 80	0.1077	1602	100
90	0	0	0	0	0	0	0	0	80- 90	0.0353	1602	100
100	0	0	0	0	0	0	0	0	90-100	0	1602	100
110	0	0	0	0	0	0	0	0	100-110	0	1602	100
120	0	0	0	0	0	0	0	0	110-120	0	1602	100
130	0	0	0	0	0	0	0	0	120-130	0	1602	100
140	0	0	0	0	0	0	0	0	130-140	0	1602	100
150	0	0	0	0	0	0	0	0	140-150	0	1602	100
160	0	0	0	0	0	0	0	0	150-160	0	1602	100
170	0	0	0	0	0	0	0	0	160-170	0	1602	100
180	0	0	0	0	0	0	0	0	170-180	0	1602	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 1601.3 lm

%lum = 100.0%

%lamp = 100.0%

Conical surface Flux(120deg): 1601.8 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

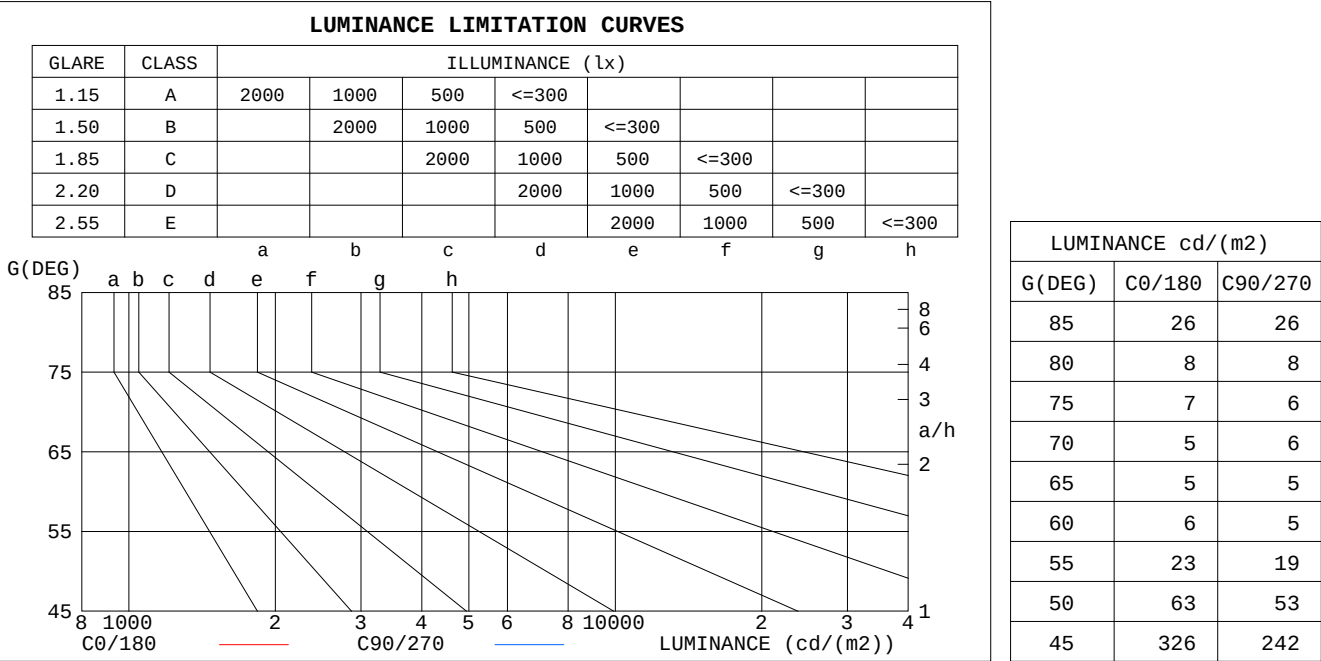


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.11	1.09	1.11	1.09	1.08	1.07	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97
2.0	1.08	1.05	1.03	1.06	1.04	1.01	1.03	1.01	.99	1.00	.99	.97	.98	.96	.95	.94
3.0	1.03	.00	.97	1.02	.99	.96	.00	.97	.95	.97	.95	.94	.95	.94	.92	.91
4.0	.00	.96	.93	.99	.95	.92	.97	.94	.91	.95	.92	.90	.93	.91	.89	.88
5.0	.96	.92	.89	.95	.92	.89	.94	.90	.88	.92	.89	.87	.91	.88	.87	.85
6.0	.93	.89	.86	.92	.88	.86	.91	.88	.85	.90	.87	.85	.88	.86	.84	.83
7.0	.90	.86	.83	.89	.86	.83	.88	.85	.82	.87	.84	.82	.86	.84	.82	.81
8.0	.87	.83	.80	.87	.83	.80	.86	.82	.80	.85	.82	.80	.84	.81	.79	.78
9.0	.85	.81	.78	.84	.81	.78	.84	.80	.78	.83	.80	.77	.82	.79	.77	.76
10.0	.82	.78	.76	.82	.78	.76	.81	.78	.76	.81	.78	.75	.80	.77	.75	.74

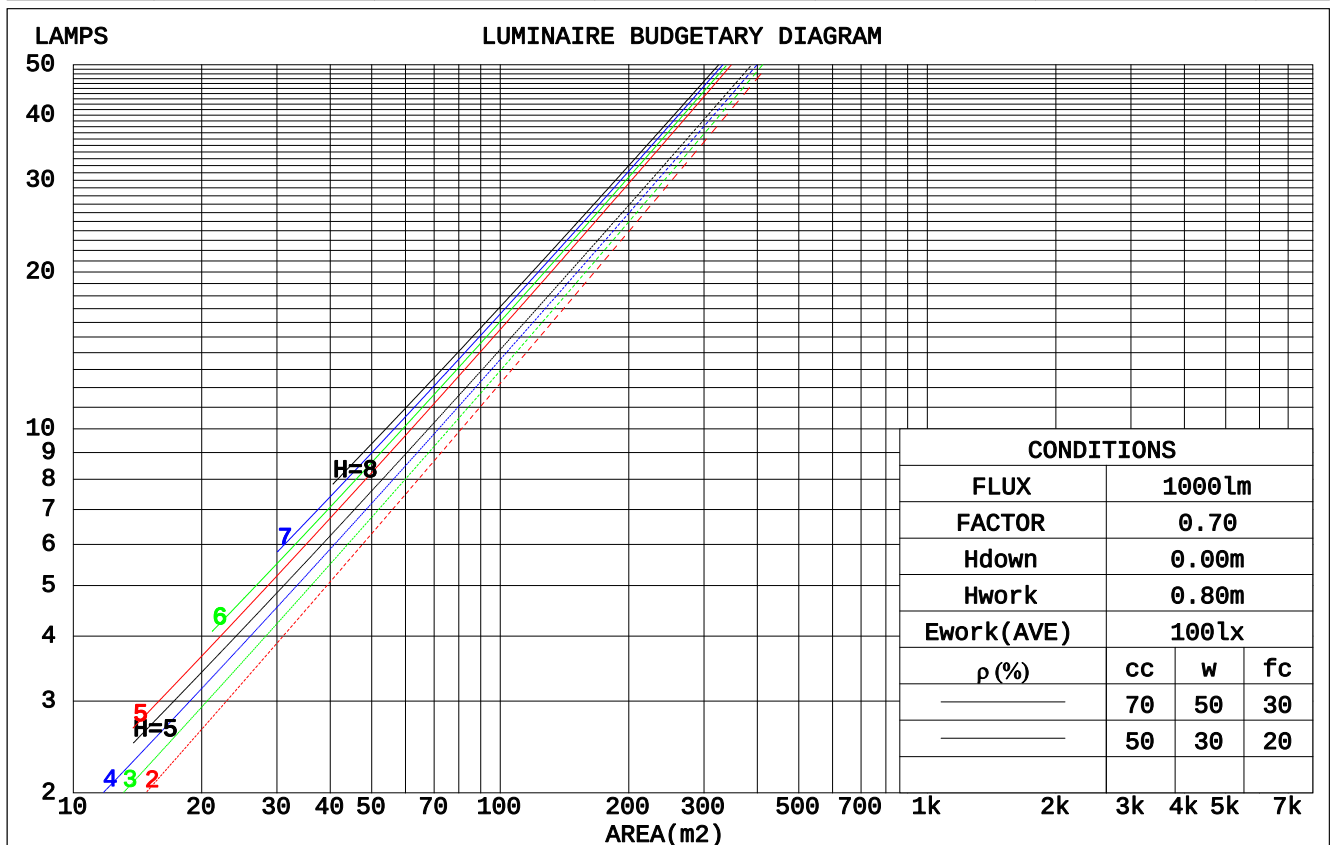

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{CC}	80%			70%			50%			30%			10%			0	
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.134	.076	.024	.128	.073	.023	.115	.066	.021	.104	.060	.019	.093	.054	.017		
2.0	.124	.068	.021	.119	.065	.020	.108	.060	.019	.099	.056	.017	.090	.051	.016		
3.0	.115	.061	.018	.111	.059	.018	.102	.055	.017	.095	.052	.016	.087	.048	.015		
4.0	.108	.056	.017	.104	.055	.016	.097	.052	.015	.091	.049	.015	.084	.046	.014		
5.0	.102	.052	.015	.099	.051	.015	.093	.048	.014	.087	.046	.014	.082	.044	.013		
6.0	.096	.048	.014	.094	.047	.014	.088	.045	.013	.084	.043	.013	.079	.042	.012		
7.0	.092	.045	.013	.089	.045	.013	.085	.043	.012	.081	.041	.012	.077	.040	.012		
8.0	.088	.043	.012	.085	.042	.012	.081	.041	.012	.078	.039	.011	.074	.038	.011		
9.0	.084	.041	.011	.082	.040	.011	.078	.039	.011	.075	.038	.011	.072	.037	.011		
10.0	.080	.039	.011	.079	.038	.011	.076	.037	.010	.073	.036	.010	.070	.035	.010		

ρ _{CC}	80%			70%			50%			30%			10%			0
ρ _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ _{FC}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.168	.158	.148	.144	.135	.128	.098	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.150	.133	.118	.128	.114	.102	.088	.079	.071	.051	.046	.042	.016	.015	.014	
3.0	.135	.113	.096	.115	.098	.083	.079	.068	.058	.046	.040	.034	.015	.013	.011	
4.0	.122	.098	.079	.105	.085	.069	.072	.059	.049	.042	.035	.029	.013	.011	.009	
5.0	.111	.085	.066	.096	.074	.058	.066	.052	.041	.038	.030	.024	.012	.010	.008	
6.0	.103	.075	.056	.088	.065	.049	.061	.046	.035	.035	.027	.021	.011	.009	.007	
7.0	.095	.067	.048	.082	.058	.042	.056	.041	.030	.033	.024	.018	.011	.008	.006	
8.0	.088	.060	.041	.076	.052	.036	.053	.037	.025	.031	.022	.015	.010	.007	.005	
9.0	.083	.055	.036	.071	.048	.031	.049	.033	.022	.029	.020	.013	.009	.006	.004	
10.0	.078	.050	.031	.067	.043	.027	.047	.031	.019	.027	.018	.012	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	-0.2	0.4	0.0	0.6	0.7	-0.1	0.5	0.1	0.7	0.8
3H	-0.3	0.3	-0.1	0.4	0.6	-0.3	0.3	-0.0	0.5	0.7
4H	-0.4	0.2	-0.2	0.4	0.6	-0.3	0.2	-0.1	0.4	0.6
6H	-0.5	0.0	-0.2	0.3	0.5	-0.4	0.1	-0.1	0.3	0.6
8H	-0.5	-0.0	-0.2	0.2	0.5	-0.5	0.0	-0.2	0.3	0.5
12H	-0.6	-0.1	-0.3	0.2	0.4	-0.5	-0.0	-0.2	0.2	0.5
4H 2H	-0.4	0.2	-0.2	0.4	0.6	-0.3	0.2	-0.1	0.4	0.6
3H	-0.6	-0.1	-0.3	0.2	0.4	-0.5	-0.0	-0.2	0.2	0.5
4H	-0.7	-0.2	-0.3	0.1	0.4	-0.6	-0.2	-0.3	0.1	0.4
6H	-0.8	-0.4	-0.4	-0.1	0.3	-0.7	-0.3	-0.3	0.0	0.4
8H	-0.8	-0.5	-0.5	-0.1	0.2	-0.8	-0.4	-0.4	-0.0	0.3
12H	-0.9	-0.5	-0.5	-0.2	0.2	-0.8	-0.5	-0.4	-0.1	0.3
8H 4H	-0.8	-0.5	-0.5	-0.1	0.2	-0.8	-0.4	-0.4	-0.0	0.3
6H	-1.0	-0.6	-0.5	-0.2	0.2	-0.9	-0.6	-0.5	-0.2	0.2
8H	-1.0	-0.7	-0.6	-0.3	0.1	-0.9	-0.7	-0.5	-0.2	0.2
12H	-1.1	-0.8	-0.6	-0.4	0.1	-1.0	-0.8	-0.5	-0.3	0.1
12H 4H	-0.9	-0.5	-0.5	-0.2	0.2	-0.8	-0.5	-0.4	-0.1	0.3
6H	-1.0	-0.7	-0.6	-0.3	0.1	-0.9	-0.7	-0.5	-0.2	0.2
8H	-1.1	-0.8	-0.6	-0.4	0.1	-1.0	-0.8	-0.5	-0.3	0.1
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.7 / -24.8					+ 4.3 / -24.4				
1.5H	+ 7.5 / -23.0					+ 7.1 / -22.5				
2.0H	+ 8.4 / -11.0					+ 8.6 / - 9.0				

CIE Pub.117, 1602 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 1.6$)
Area: 0.008 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	92	86	83	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	90	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	105	100	98	103	99	97	93
1.50	108	104	101	107	103	100	105	102	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	105	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

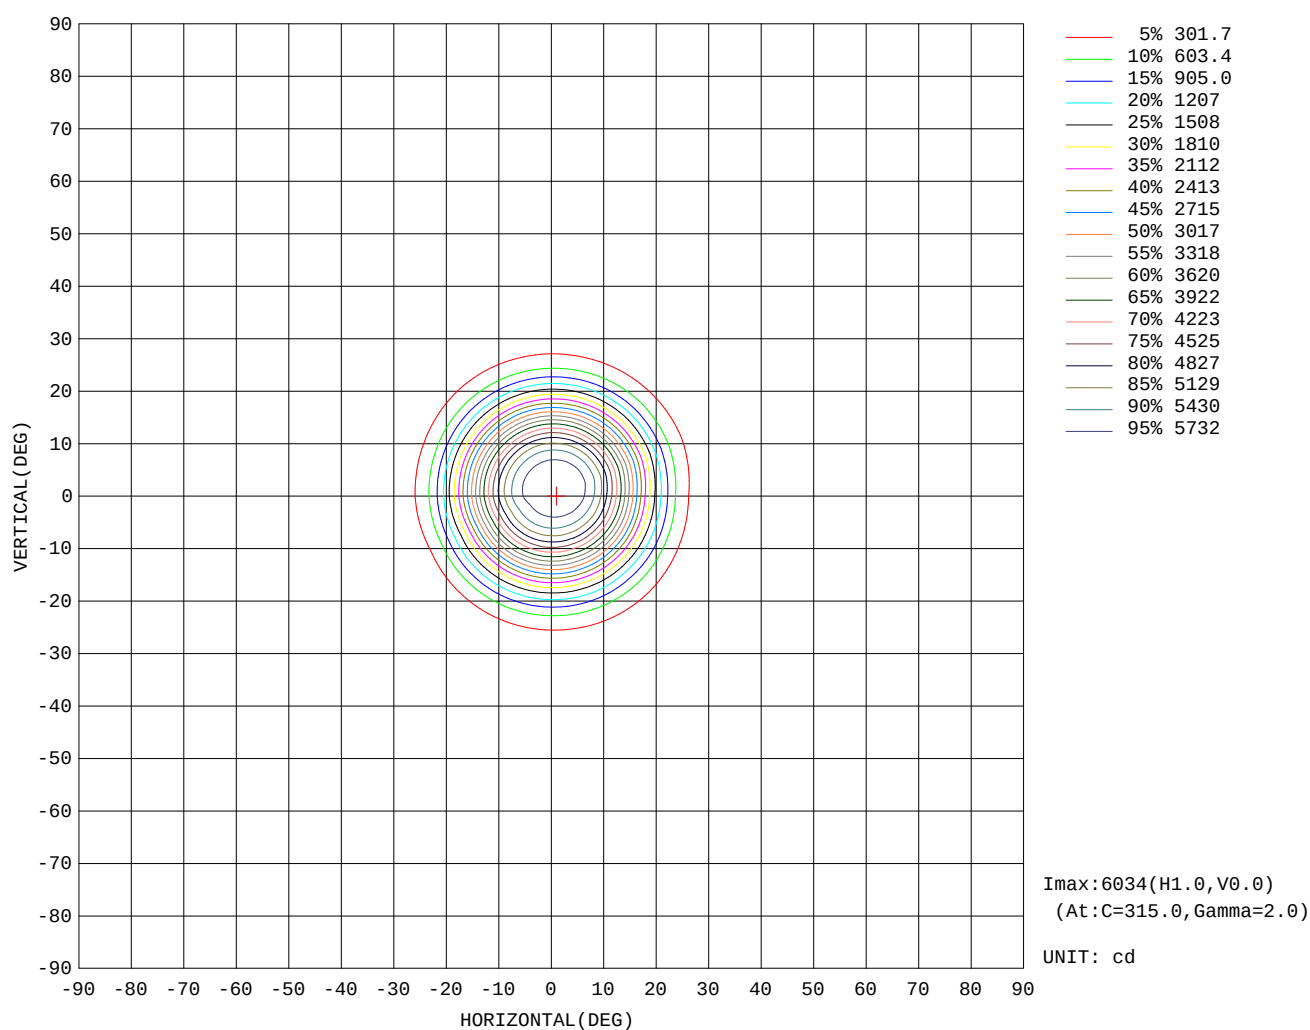

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

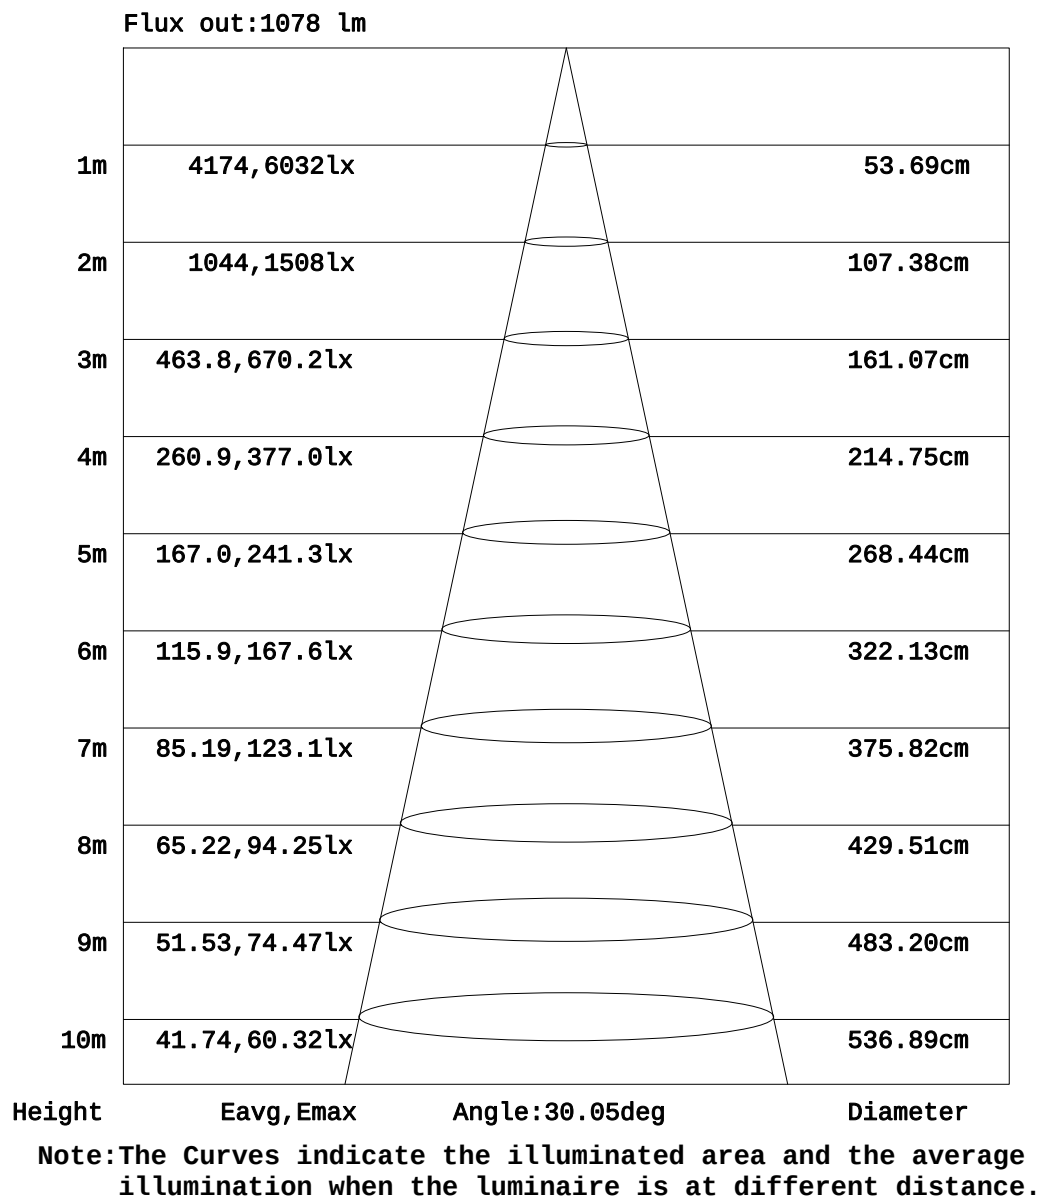

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

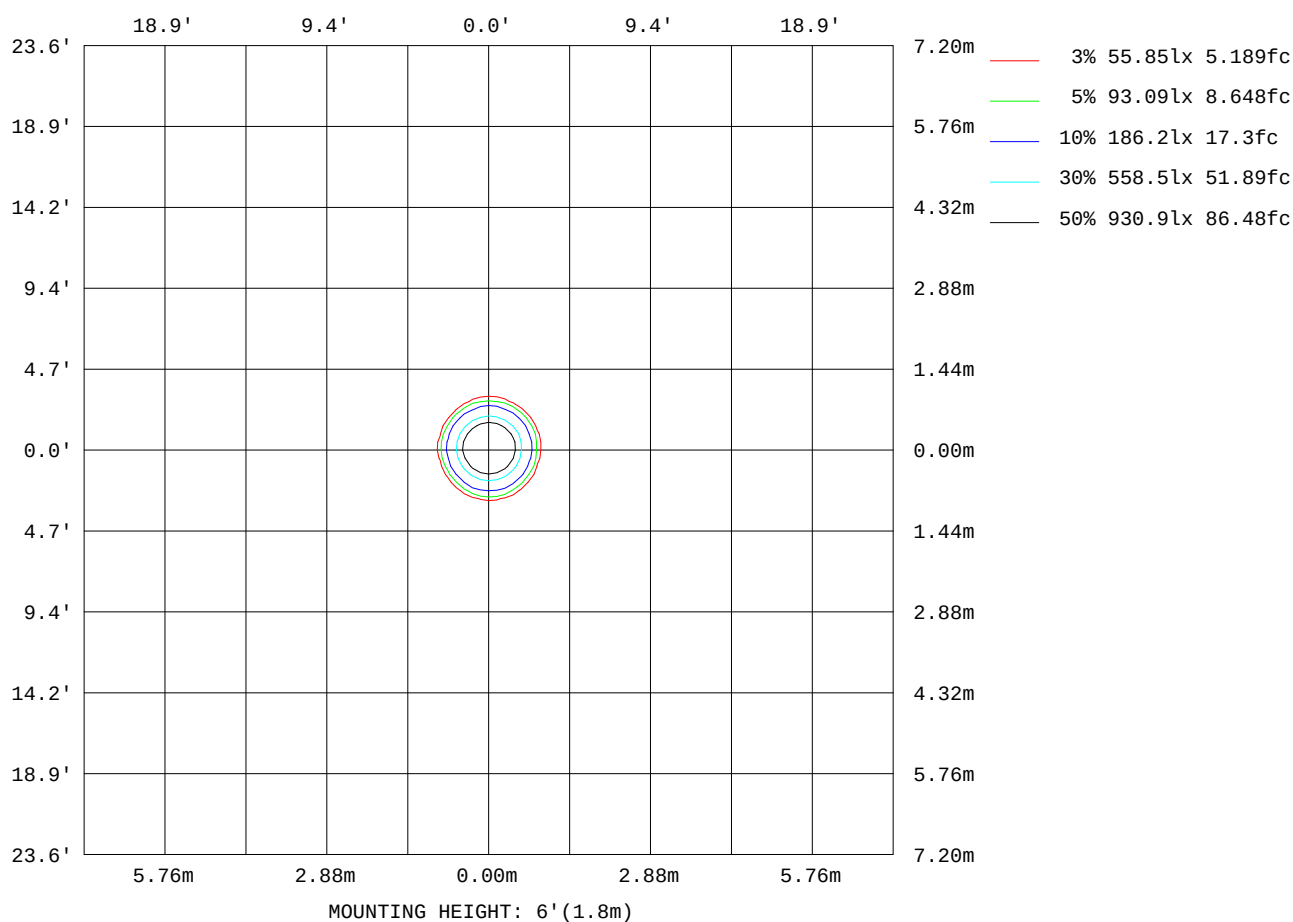

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.08V I:0.0929A P:19.115W PF:0.9346 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:1601.99x1 Lm		
NAME: DDW41-LM18E-330SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	29
L_0~180(75)av	51
L_0~180(85)av	20
L_90~270(65)av	30
L_90~270(75)av	51
L_90~270(85)av	21
L_45(65)av	33
L_45(75)av	51
L_45(85)av	21

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

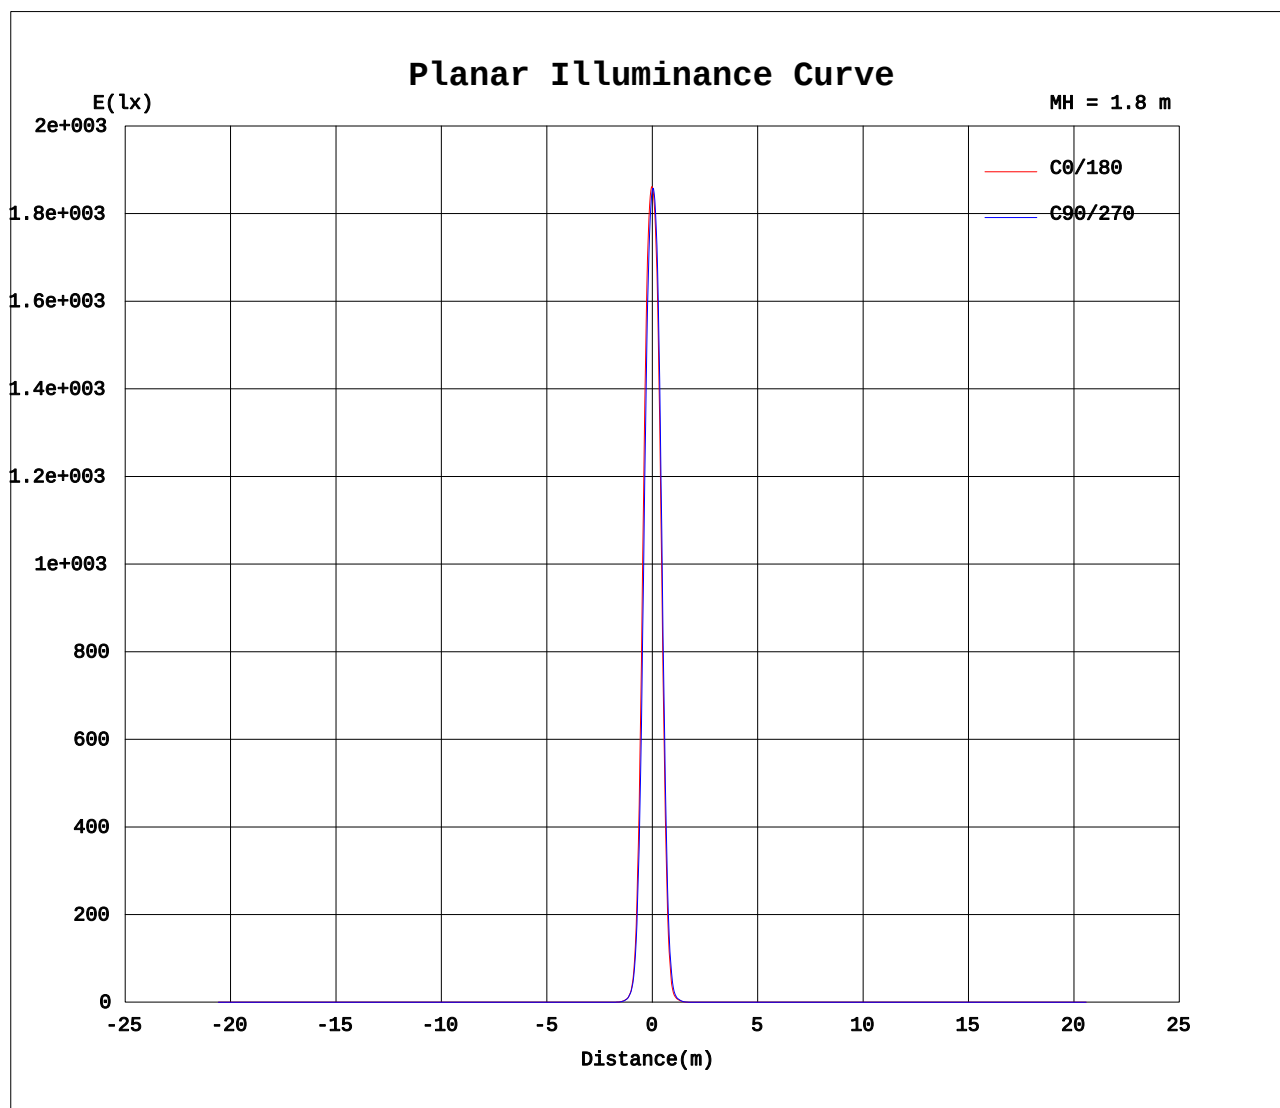

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010	6010			
5	5847	5769	5697	5644	5615	5615	5642	5681	5755	5802	5842	5886	5916	5940	5948	5929			
10	4972	4810	4641	4513	4463	4473	4542	4640	4829	4928	5012	5092	5153	5200	5217	5179			
15	3220	3035	2850	2709	2652	2657	2722	2820	3066	3183	3277	3363	3435	3490	3515	3482			
20	1416	1317	1226	1192	1153	1144	1160	1195	1335	1414	1490	1561	1618	1657	1671	1634			
25	418	394	375	361	346	329	313	311	393	425	433	472	504	521	518	497			
30	111	107	107	109	104	93.3	83.8	81.9	84.3	90.6	99.8	114	124	128	128	123			
35	35.9	32.8	31.6	34.2	32.5	27.8	26.2	27.5	31.8	32.7	34.6	36.8	38.8	39.2	40.9	41.8			
40	9.82	9.38	8.85	8.80	8.50	6.89	6.85	6.82	7.86	8.69	9.07	9.72	10.1	10.4	11.4	11.5			
45	1.84	1.85	1.54	1.37	1.37	1.22	1.25	1.25	1.22	1.61	1.59	1.68	1.86	1.66	2.03	2.09			
50	0.32	0.31	0.29	0.28	0.27	0.27	0.26	0.26	0.28	0.29	0.30	0.31	0.32	0.37	0.37	0.36			
55	0.10	0.10	0.10	0.09	0.09	0.08	0.08	0.08	0.09	0.09	0.10	0.10	0.11	0.11	0.12	0.12			
60	0.03	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.17	0.17	0.18	0.18	0.18	0.18	0.18	0.18			
65	0.02	0.02	0.06	0.02	0.02	0.02	0.02	0.02	0.18	0.18	0.18	0.18	0.18	0.19	0.18	0.18			
70	0.01	0.01	0.01	0.02	0.02	0.01	0.01	0.01	0.17	0.18	0.17	0.18	0.18	0.17	0.18	0.17			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.20	0.19	0.19	0.20	0.20	0.20	0.20	0.20			
80	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.23	0.23	0.23	0.24	0.24	0.23	0.24	0.23			
85	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: