


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.07V I:0.0939A P:19.385W PF:0.9384 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:1555.49x1 lm


NAME: DDW41-LM18E-530SWT	TYPE: recessed luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 80.24 lm/W
MODEL		Imax(cd)	3046	S/MH(C0/180)	0.69	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.69	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	1555.5	η UP, DN(C0-180)	0.0, 48.4	
NOMINAL FLUX(lm)	1555.49	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.0, 51.6	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	220	η down(%)	100.0	CIBSE SHR MAX	0.70	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

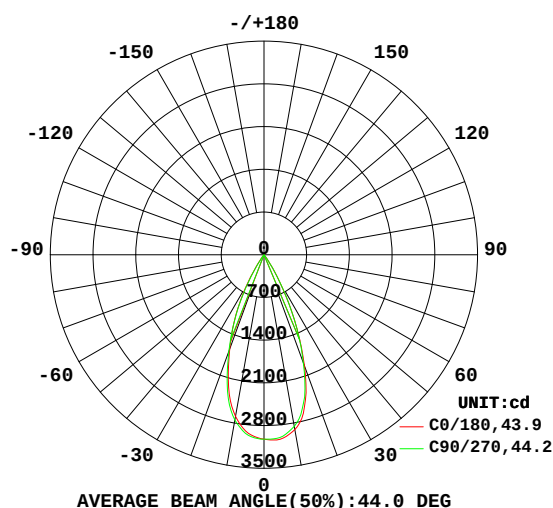

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

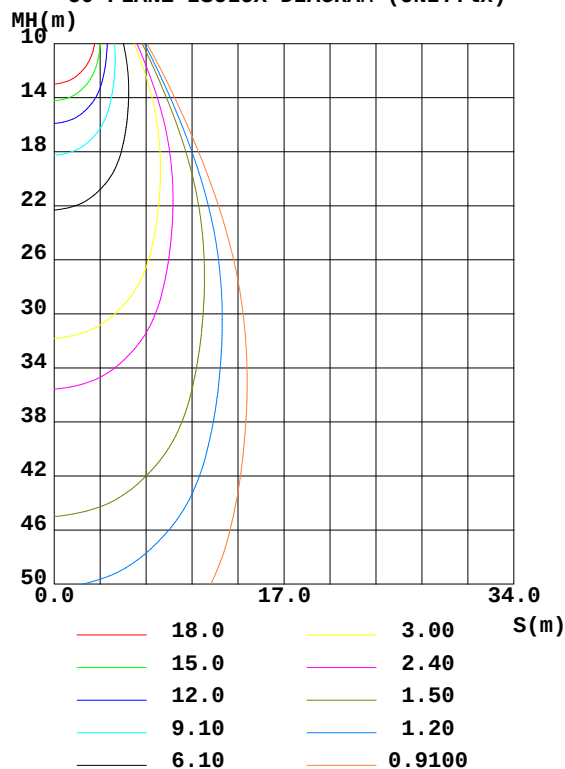

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	2688	2681	2749	2808	2910	2922	2856	2752	0- 10	278.8	278.8	17.9
20	1643	1627	1689	1779	1944	1950	1892	1770	10- 20	655.3	934.1	60.1
30	531.8	514.9	496.5	488.9	521.4	524.3	527.1	537.3	20- 30	509.5	1444	92.8
40	20.00	20.38	19.19	17.69	16.73	16.17	22.87	23.26	30- 40	107.3	1551	99.7
50	0.4220	0.3742	0.3514	0.3345	0.3208	0.3149	0.3467	0.4024	40- 50	4.240	1555	100
60	0.0279	0.0241	0.0216	0.0187	0.1672	0.1694	0.1724	0.1778	50- 60	0.1348	1555	100
70	0.0143	0.0139	0.0148	0.0148	0.1787	0.1812	0.1821	0.1838	60- 70	0.0905	1555	100
80	0.0093	0.0105	0.0110	0.0102	0.2399	0.2394	0.2401	0.2411	70- 80	0.1053	1555	100
90	0	0	0	0	0	0	0	0	80- 90	0.0313	1555	100
100	0	0	0	0	0	0	0	0	90-100	0	1555	100
110	0	0	0	0	0	0	0	0	100-110	0	1555	100
120	0	0	0	0	0	0	0	0	110-120	0	1555	100
130	0	0	0	0	0	0	0	0	120-130	0	1555	100
140	0	0	0	0	0	0	0	0	130-140	0	1555	100
150	0	0	0	0	0	0	0	0	140-150	0	1555	100
160	0	0	0	0	0	0	0	0	150-160	0	1555	100
170	0	0	0	0	0	0	0	0	160-170	0	1555	100
180	0	0	0	0	0	0	0	0	170-180	0	1555	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1554.6 lm

%lum = 99.9%

%lamp = 99.9%

Conical surface Flux(120deg): 1555.3 lm


%lum = 100.0%

%lamp = 100.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

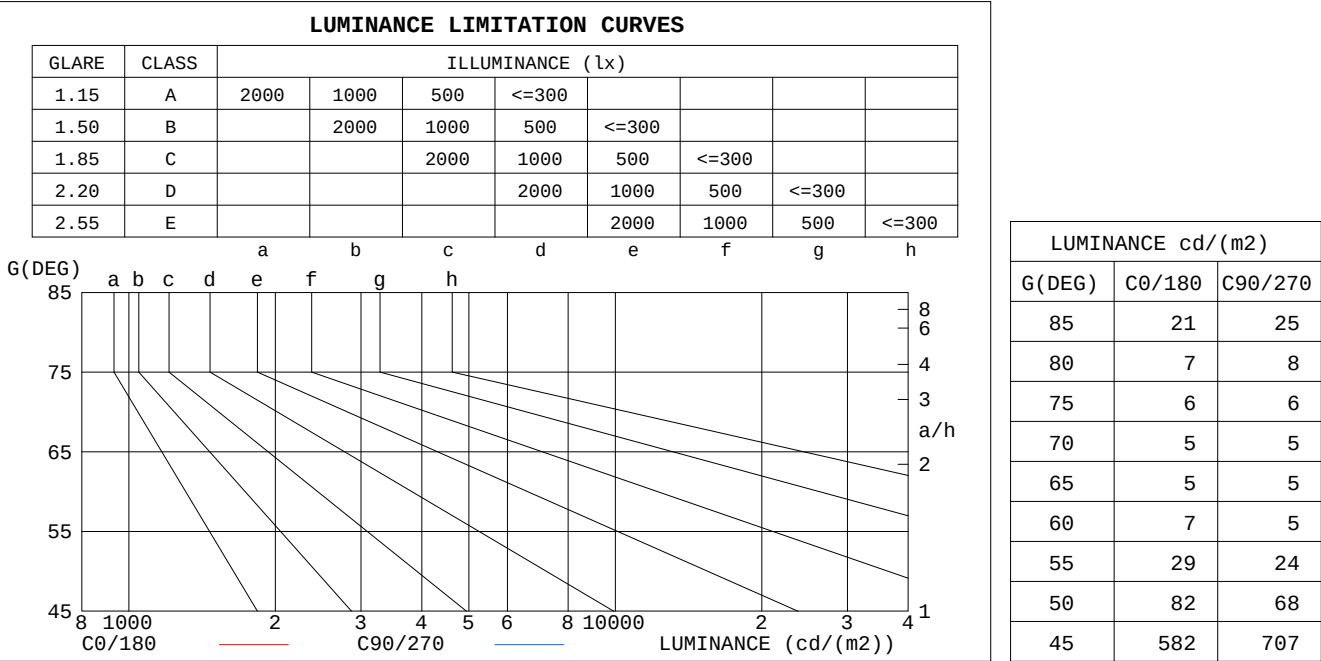

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97	.95
2.0	1.06	1.02	.00	1.04	1.01	.99	1.01	.99	.96	.98	.96	.94	.95	.94	.92	.91
3.0	1.00	.96	.93	.99	.95	.92	.96	.93	.91	.94	.92	.89	.92	.90	.88	.87
4.0	.95	.91	.87	.94	.90	.87	.92	.89	.86	.90	.87	.85	.89	.86	.84	.83
5.0	.91	.86	.82	.90	.85	.82	.88	.84	.81	.87	.83	.81	.85	.82	.80	.79
6.0	.87	.82	.78	.86	.81	.78	.84	.80	.77	.83	.80	.77	.82	.79	.76	.75
7.0	.83	.78	.74	.82	.77	.74	.81	.77	.74	.80	.76	.73	.79	.76	.73	.72
8.0	.79	.74	.71	.79	.74	.71	.78	.73	.70	.77	.73	.70	.76	.72	.70	.69
9.0	.76	.71	.68	.75	.71	.68	.75	.70	.67	.74	.70	.67	.73	.70	.67	.66
10.0	.73	.68	.65	.72	.68	.65	.72	.68	.65	.71	.67	.64	.70	.67	.64	.63

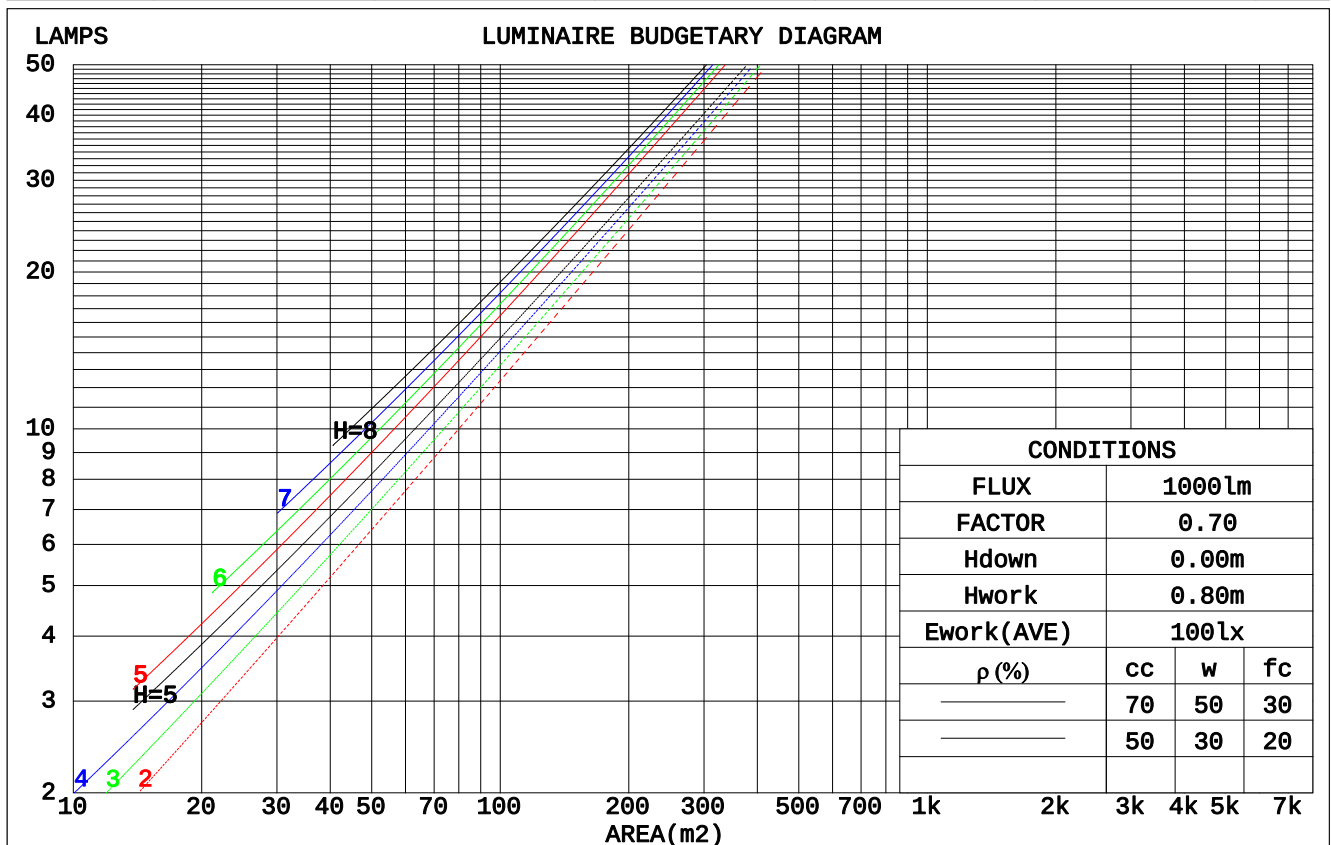

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0	
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.153	.087	.028	.146	.083	.027	.134	.077	.025	.122	.071	.023	.112	.065	.021		
2.0	.144	.079	.024	.138	.076	.023	.128	.071	.022	.118	.066	.021	.110	.062	.020		
3.0	.136	.072	.022	.131	.070	.021	.122	.066	.020	.114	.063	.019	.107	.059	.018		
4.0	.128	.067	.020	.125	.065	.019	.117	.062	.019	.110	.059	.018	.104	.056	.017		
5.0	.122	.062	.018	.119	.061	.018	.112	.059	.017	.106	.056	.017	.101	.054	.016		
6.0	.117	.058	.017	.114	.057	.017	.108	.055	.016	.103	.053	.016	.098	.052	.015		
7.0	.111	.055	.016	.109	.054	.015	.104	.053	.015	.099	.051	.015	.095	.049	.015		
8.0	.107	.052	.015	.105	.052	.015	.100	.050	.014	.096	.049	.014	.092	.047	.014		
9.0	.103	.050	.014	.101	.049	.014	.097	.048	.014	.093	.047	.013	.090	.046	.013		
10.0	.099	.047	.013	.097	.047	.013	.094	.046	.013	.090	.045	.013	.087	.044	.013		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.147	.145	.135	.126	.099	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.153	.133	.116	.131	.114	.100	.090	.079	.070	.052	.046	.041	.017	.015	.013	
3.0	.139	.113	.093	.119	.098	.081	.082	.068	.057	.047	.040	.033	.015	.013	.011	
4.0	.127	.098	.076	.109	.085	.066	.075	.059	.047	.043	.035	.028	.014	.011	.009	
5.0	.117	.086	.063	.101	.075	.055	.070	.052	.039	.040	.031	.023	.013	.010	.008	
6.0	.109	.077	.053	.094	.066	.046	.065	.046	.033	.038	.027	.019	.012	.009	.006	
7.0	.102	.069	.045	.088	.060	.039	.061	.042	.028	.035	.025	.017	.011	.008	.005	
8.0	.096	.062	.039	.083	.054	.034	.057	.038	.024	.033	.022	.014	.011	.007	.005	
9.0	.091	.057	.034	.079	.049	.029	.054	.035	.021	.032	.020	.012	.010	.007	.004	
10.0	.087	.052	.029	.075	.045	.026	.052	.032	.018	.030	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	11.0	11.8	11.2	11.9	12.1	10.5	11.3	10.8	11.5	11.6
3H	10.8	11.6	11.1	11.8	11.9	10.4	11.1	10.6	11.3	11.5
4H	10.8	11.4	11.0	11.7	11.9	10.3	11.0	10.6	11.2	11.4
6H	10.7	11.3	11.0	11.6	11.8	10.2	10.9	10.5	11.1	11.3
8H	10.6	11.2	10.9	11.5	11.8	10.2	10.8	10.5	11.0	11.3
12H	10.6	11.2	10.9	11.4	11.7	10.1	10.7	10.4	11.0	11.2
4H 2H	10.8	11.4	11.0	11.7	11.9	10.3	11.0	10.6	11.2	11.4
3H	10.6	11.2	10.9	11.4	11.7	10.1	10.7	10.4	11.0	11.2
4H	10.5	11.0	10.8	11.3	11.6	10.0	10.6	10.4	10.9	11.2
6H	10.4	10.9	10.8	11.2	11.5	9.9	10.4	10.3	10.7	11.1
8H	10.3	10.8	10.7	11.1	11.5	9.9	10.3	10.3	10.7	11.0
12H	10.3	10.7	10.7	11.1	11.4	9.8	10.2	10.2	10.6	11.0
8H 4H	10.3	10.8	10.7	11.1	11.5	9.9	10.3	10.3	10.7	11.0
6H	10.2	10.6	10.7	11.0	11.4	9.8	10.1	10.2	10.5	10.9
8H	10.2	10.5	10.6	10.9	11.3	9.7	10.0	10.2	10.4	10.9
12H	10.1	10.4	10.6	10.8	11.3	9.6	9.9	10.1	10.4	10.8
12H 4H	10.3	10.7	10.7	11.1	11.4	9.8	10.2	10.2	10.6	11.0
6H	10.2	10.5	10.6	10.9	11.3	9.7	10.0	10.2	10.4	10.9
8H	10.1	10.4	10.6	10.8	11.3	9.6	9.9	10.1	10.4	10.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 5.5 / -32.4					+ 4.7 / -31.9				
1.5H	+ 8.3 / -29.4					+ 7.5 / -28.9				
2.0H	+ 8.4 / -16.0					+ 9.3 / -16.6				

CIE Pub.117, 1555 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 1.5$)
Area: 0.008 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.467m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	86	82	90	85	82	79
0.80	98	93	90	98	93	90	97	92	89	86
1.00	102	97	94	101	97	94	100	96	93	90
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	105	102	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	108	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

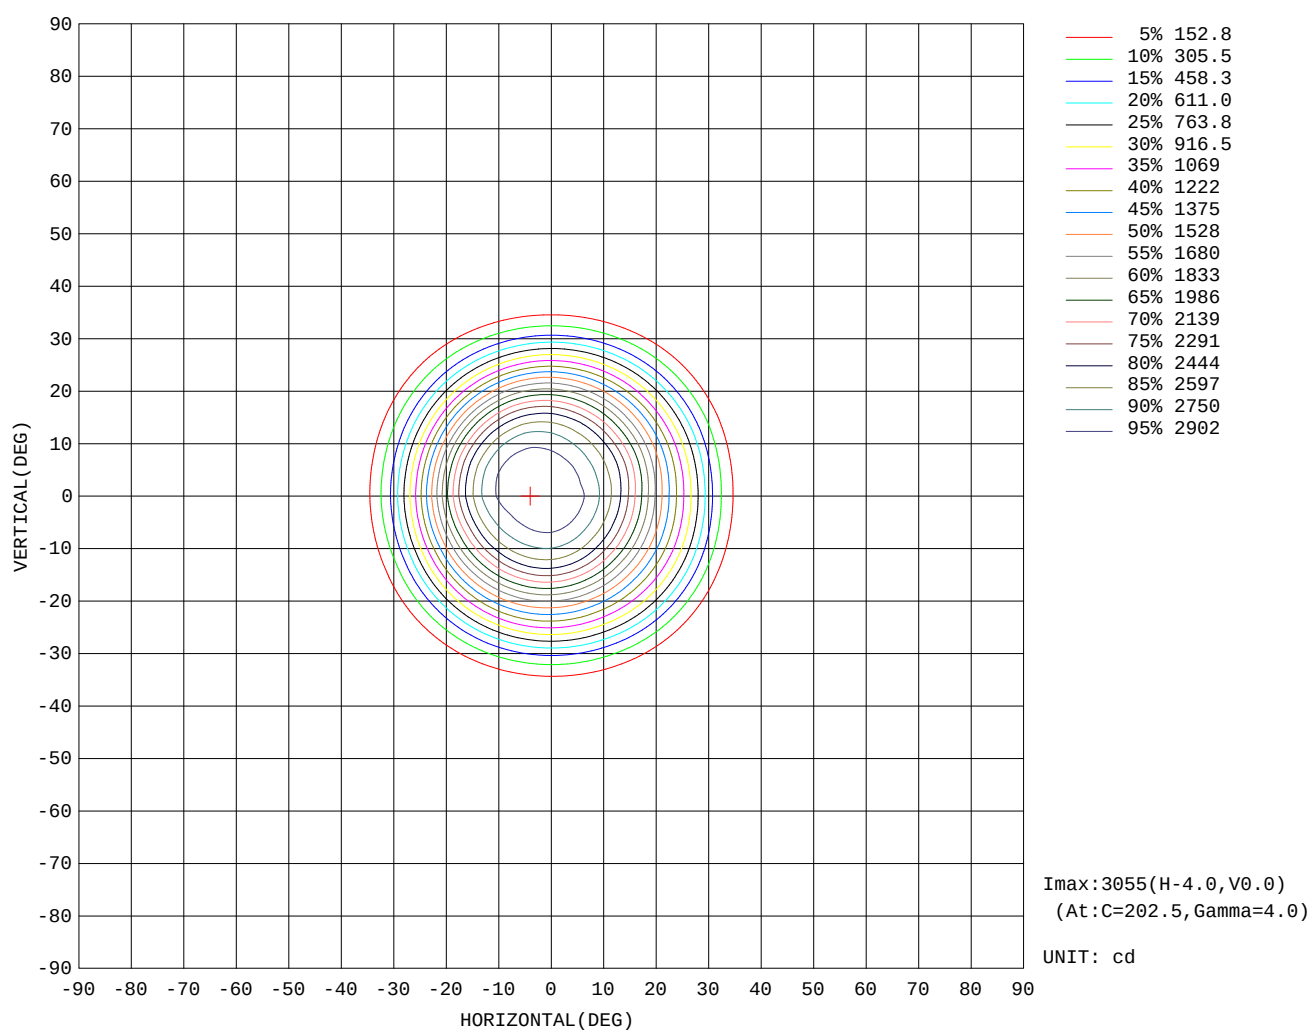

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:


AAI Figure

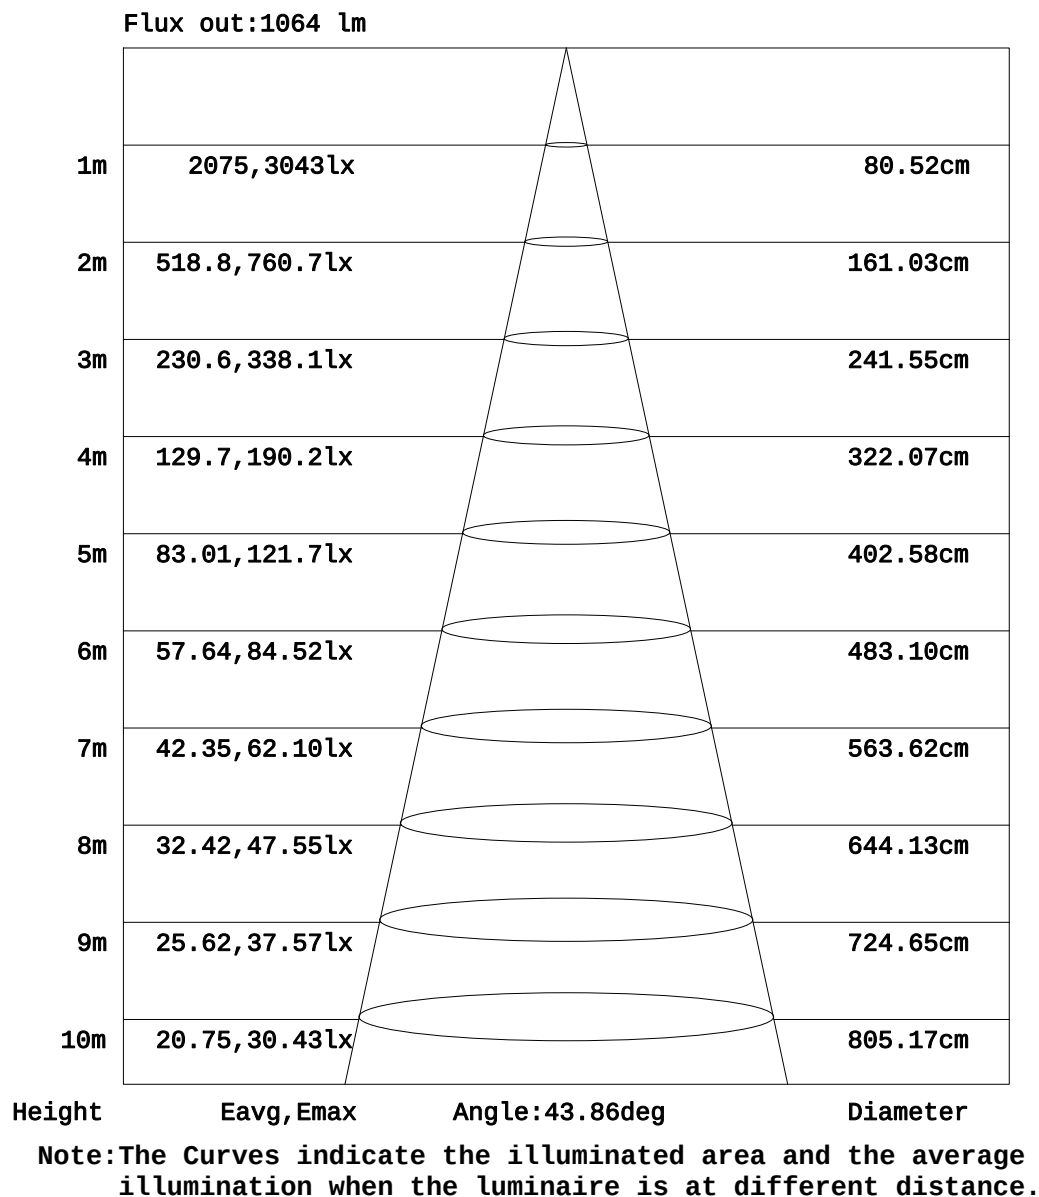

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

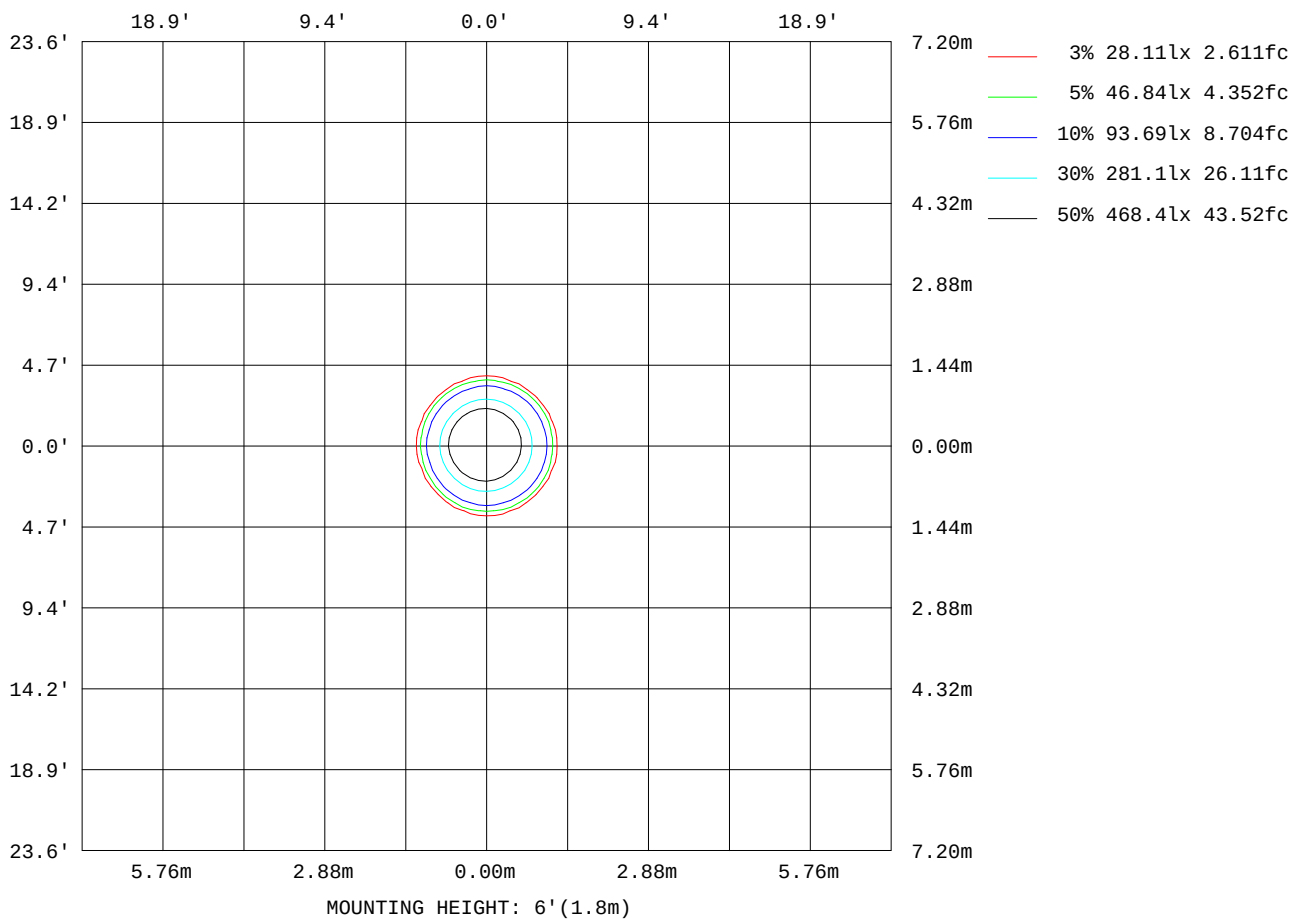

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.07V I:0.0939A P:19.385W PF:0.9384 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:1555.49x1 Lm		
NAME: DDW41-LM18E-530SWT	TYPE: 嵌入式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	28
L_0~180(75)av	51
L_0~180(85)av	17
L_90~270(65)av	28
L_90~270(75)av	52
L_90~270(85)av	19
L_45(65)av	28
L_45(75)av	51
L_45(85)av	16

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.467m [K=1.0000]
 Remarks:

Planar Illuminance Curve

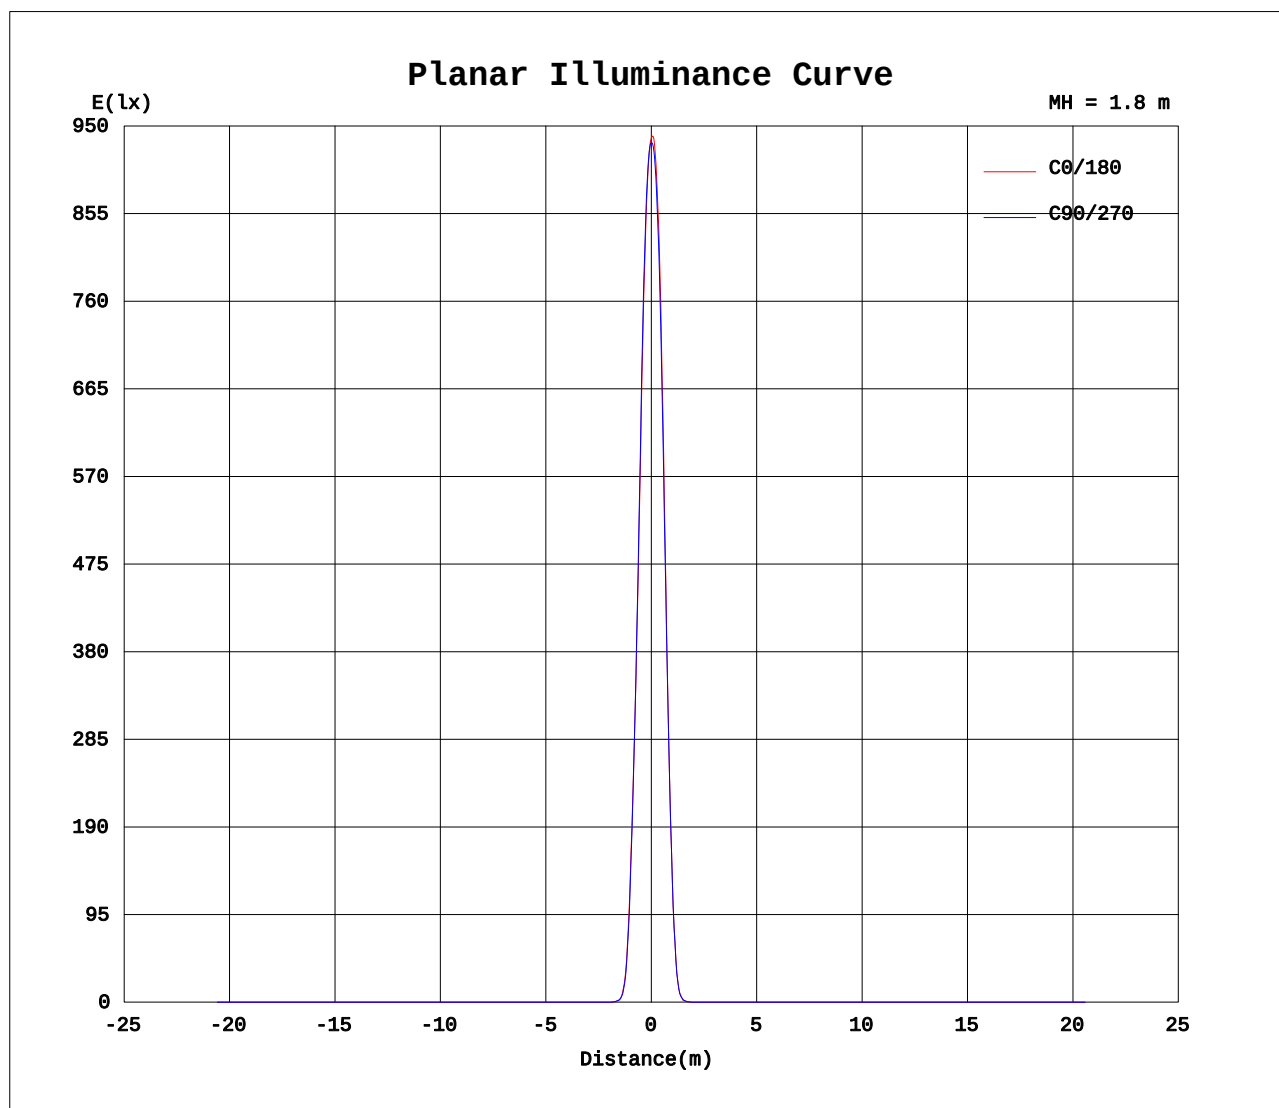

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.467m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022	3022			
5	2937	2935	2939	2954	2969	2986	3000	3018	3035	3043	3036	3025	3006	2982	2960	2946			
10	2688	2674	2681	2715	2749	2776	2808	2860	2910	2933	2922	2901	2856	2799	2752	2726			
15	2246	2218	2223	2266	2313	2358	2411	2490	2572	2603	2594	2564	2511	2453	2381	2339			
20	1643	1634	1627	1651	1689	1730	1779	1849	1944	1960	1950	1934	1892	1829	1770	1727			
25	1092	1094	1076	1066	1084	1099	1113	1145	1185	1186	1186	1187	1186	1164	1144	1131			
30	532	533	515	498	496	494	489	493	521	525	524	523	527	529	537	547			
35	131	126	123	121	119	116	115	114	129	136	137	131	126	129	137	143			
40	20.0	21.1	20.4	19.5	19.2	17.1	17.7	16.7	16.7	17.0	16.2	22.9	22.9	23.2	23.3	24.3			
45	3.28	3.95	3.99	4.15	4.00	2.43	3.64	3.35	3.41	3.37	2.67	3.05	3.47	3.70	3.67	4.14			
50	0.42	0.39	0.37	0.36	0.35	0.34	0.33	0.32	0.32	0.31	0.31	0.33	0.35	0.38	0.40	0.43			
55	0.13	0.13	0.12	0.12	0.11	0.11	0.10	0.10	0.10	0.09	0.10	0.10	0.11	0.12	0.13	0.13			
60	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.17	0.17	0.17	0.17	0.17	0.18	0.18	0.18			
65	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.17	0.18	0.18	0.18	0.18	0.18	0.18	0.17			
70	0.01	0.01	0.01	0.02	0.01	0.02	0.01	0.01	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18			
75	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20			
80	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24			
85	0.01	0.02	0.01	0.01	0.02	0.02	0.01	0.03	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
140	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
145	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
150	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
155	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
160	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
165	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
170	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
175	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2024-09-20

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.467m [K=1.0000]
 Remarks: