


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.04V I:0.2599A P:56.100W PF:0.9808 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:2694.72x1 lm


NAME: AEP6MI-60ML-F65BK-MAX	TYPE: Fixed Luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 48.03 lm/W
MODEL		Imax(cd)	6512	S/MH(C0/180)		0.59
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)		0.56
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	2694.7	η UP, DN(C0-180)		0.0, 52.8
NOMINAL FLUX(lm)	2694.72	CIE CLASS	DIRECT	η UP, DN(C180-360)		0.1, 47.1
LAMPS INSIDE	1	η up(%)	0.1	CIBSE SHR NOM		0.00
TEST VOLTAGE(V)	220	η down(%)	99.9	CIBSE SHR MAX		1.00

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

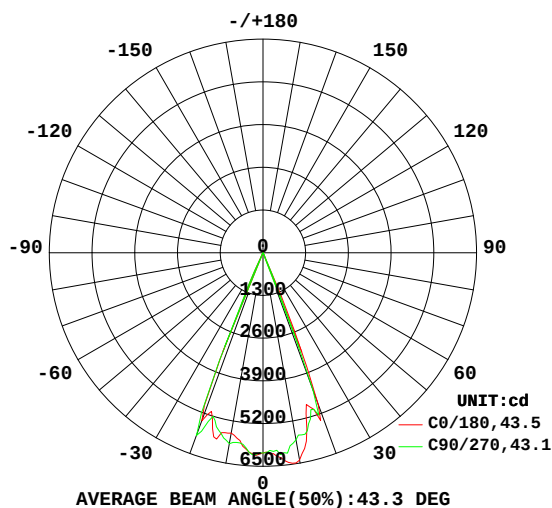

PLANAR ISOLUX DIAGRAM(UNIT: lx)

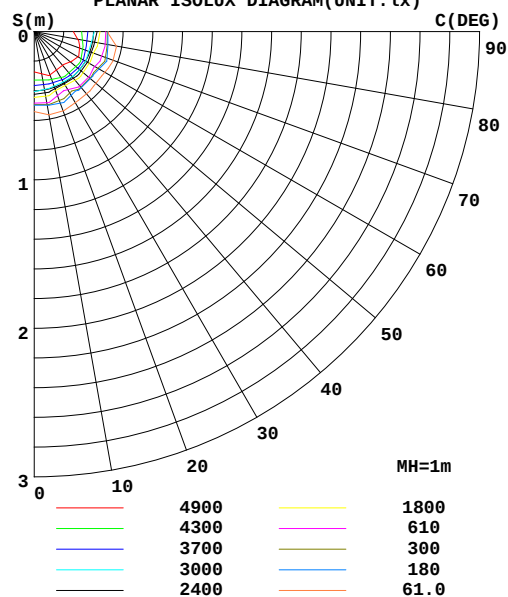

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	5576	6088	5899	6129	6411	5567	5782	5544	0- 10	576.2	576.2	21.4
20	5441	5518	5915	5455	4919	3864	4465	5466	10- 20	1560	2136	79.3
30	74.42	77.00	63.31	48.77	63.10	73.73	72.97	70.97	20- 30	494.8	2631	97.6
40	27.99	28.97	25.03	21.46	25.16	28.65	27.42	27.10	30- 40	26.60	2658	98.6
50	13.76	14.24	12.60	11.12	12.39	13.72	12.99	12.81	40- 50	14.36	2672	99.2
60	7.849	8.001	7.134	6.480	7.258	7.919	7.518	7.398	50- 60	8.766	2681	99.5
70	4.876	4.940	4.419	4.039	4.509	4.892	4.698	4.646	60- 70	5.872	2687	99.7
80	2.639	2.741	2.441	2.153	2.421	2.499	2.461	2.564	70- 80	3.777	2690	99.8
90	0.1245	0.2762	0.2367	0.0363	0.0115	0.0107	0.0112	0.0150	80- 90	1.309	2692	99.9
100	0.0323	0.0222	0.0343	0.0275	0.0124	0.0124	0.0116	0.0121	90-100	0.0227	2692	99.9
110	0.0417	0.0321	0.0588	0.0460	0.0115	0.0115	0.0112	0.0103	100-110	0.0234	2692	99.9
120	0.0473	0.0398	0.0520	0.0473	0.1943	0.2019	0.2115	0.2205	110-120	0.0616	2692	99.9
130	0.1155	0.1016	0.1080	0.1315	0.2510	0.2792	0.2571	0.2076	120-130	0.0641	2692	99.9
140	0.4790	0.4377	0.4426	0.4683	1.138	1.201	1.173	1.085	130-140	0.3634	2692	99.9
150	0.9953	0.9678	0.9662	0.9837	2.307	2.354	2.348	2.261	140-150	0.7568	2693	99.9
160	1.386	1.365	1.358	1.383	2.972	2.991	2.961	2.896	150-160	0.8822	2694	100
170	1.827	1.783	1.738	1.713	2.963	2.925	2.851	2.841	160-170	0.6496	2695	100
180	2.044	1.970	1.920	1.970	2.032	2.001	1.925	1.911	170-180	0.2003	2695	100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 2665.7 lm

%lum = 98.9%

%lamp = 98.9%

Conical surface Flux(120deg): 2680.7 lm


%lum = 99.5%

%lamp = 99.5%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

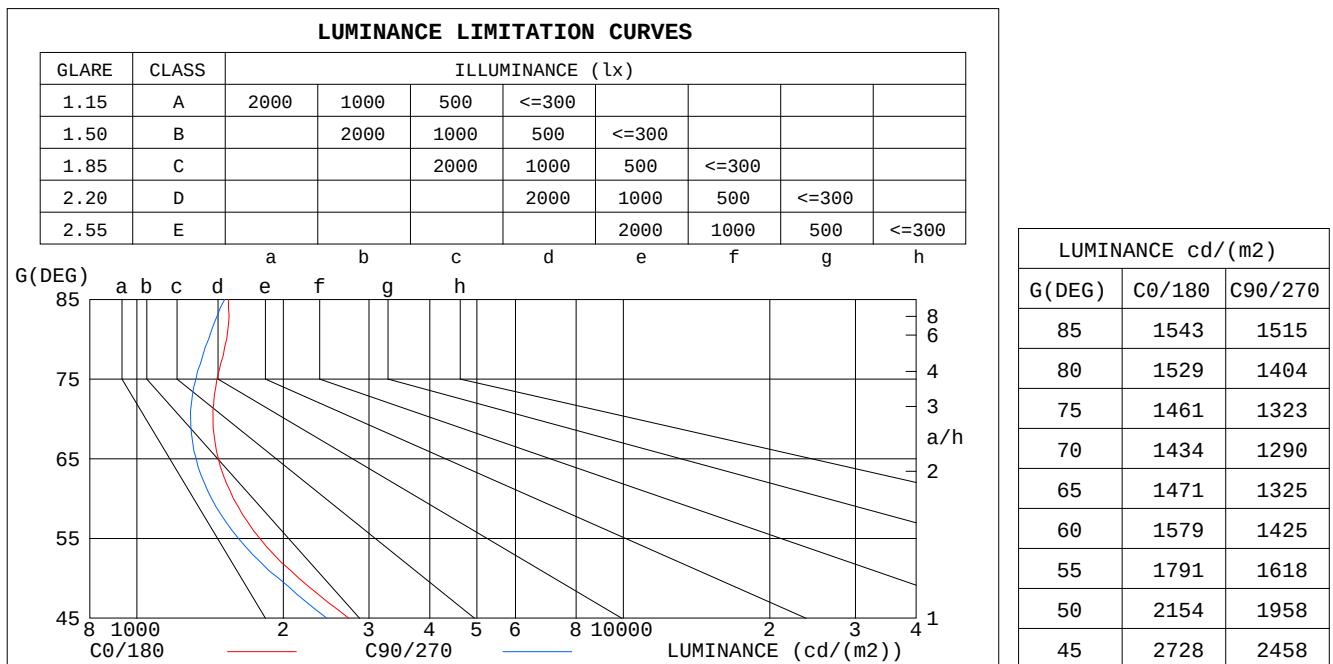


C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.10	1.09	1.10	1.09	1.07	1.06	1.05	1.04	1.03	1.02	1.01	.99	.98	.98	.96
2.0	1.07	1.04	1.01	1.05	1.02	.00	1.02	.00	.98	.99	.97	.96	.96	.95	.94	.92
3.0	1.02	.98	.95	1.01	.97	.94	.98	.95	.93	.96	.93	.91	.94	.92	.90	.89
4.0	.98	.93	.90	.96	.93	.90	.94	.91	.89	.93	.90	.88	.91	.89	.87	.85
5.0	.94	.89	.86	.93	.89	.86	.91	.88	.85	.90	.87	.84	.88	.86	.83	.82
6.0	.90	.86	.82	.89	.85	.82	.88	.84	.82	.87	.83	.81	.85	.83	.80	.79
7.0	.87	.82	.79	.86	.82	.79	.85	.81	.78	.84	.81	.78	.83	.80	.78	.77
8.0	.84	.79	.76	.83	.79	.76	.82	.78	.76	.81	.78	.75	.80	.77	.75	.74
9.0	.81	.76	.73	.80	.76	.73	.79	.76	.73	.79	.75	.73	.78	.75	.73	.72
10.0	.78	.74	.71	.78	.74	.71	.77	.73	.71	.76	.73	.70	.76	.72	.70	.69

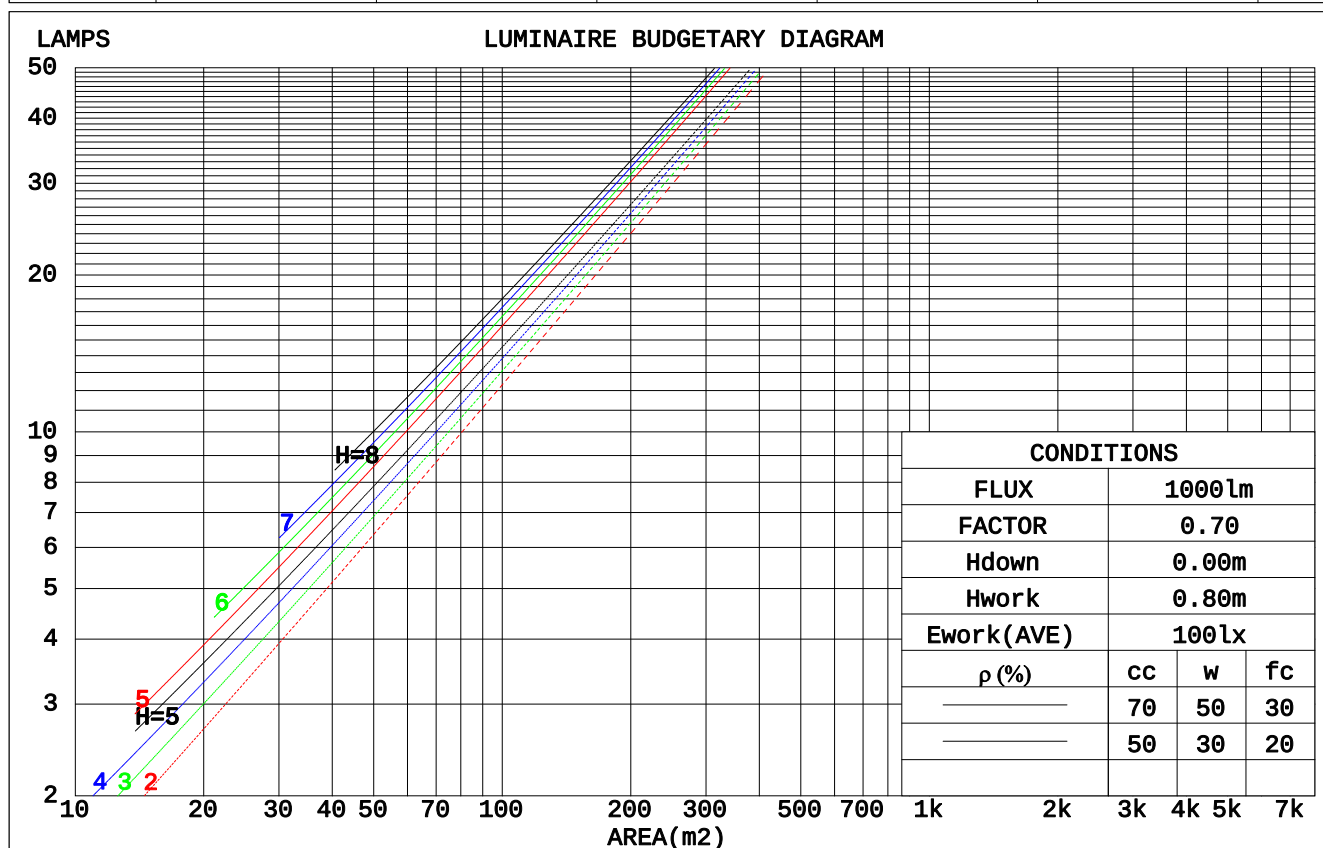

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

WEC AND CCEC

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.144	.082	.026	.138	.079	.025	.125	.072	.023	.114	.066	.021	.103	.060	.019	
2.0	.134	.073	.023	.129	.071	.022	.118	.066	.020	.109	.061	.019	.100	.057	.018	
3.0	.125	.067	.020	.121	.065	.019	.112	.061	.018	.104	.057	.017	.097	.053	.017	
4.0	.118	.061	.018	.114	.060	.018	.107	.057	.017	.100	.054	.016	.093	.051	.015	
5.0	.111	.057	.016	.108	.055	.016	.102	.053	.016	.096	.051	.015	.090	.048	.015	
6.0	.106	.053	.015	.103	.052	.015	.097	.050	.015	.092	.048	.014	.088	.046	.014	
7.0	.101	.050	.014	.098	.049	.014	.094	.047	.014	.089	.046	.013	.085	.044	.013	
8.0	.096	.047	.013	.094	.046	.013	.090	.045	.013	.086	.044	.013	.082	.042	.012	
9.0	.092	.045	.012	.090	.044	.012	.087	.043	.012	.083	.042	.012	.080	.041	.012	
10.0	.089	.043	.012	.087	.042	.012	.084	.041	.012	.081	.040	.011	.078	.039	.011	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.191	.191	.191	.164	.164	.164	.112	.112	.112	.064	.064	.064	.020	.020	.020	
1.0	.170	.158	.148	.145	.136	.128	.099	.094	.088	.057	.054	.051	.018	.017	.017	
2.0	.152	.134	.118	.130	.115	.102	.089	.080	.071	.051	.046	.042	.017	.015	.014	
3.0	.137	.114	.096	.118	.099	.083	.081	.068	.058	.047	.040	.034	.015	.013	.011	
4.0	.125	.099	.079	.108	.085	.068	.074	.060	.048	.043	.035	.029	.014	.011	.009	
5.0	.115	.087	.066	.099	.075	.057	.068	.052	.040	.039	.031	.024	.013	.010	.008	
6.0	.107	.077	.056	.092	.067	.048	.063	.047	.034	.037	.027	.020	.012	.009	.007	
7.0	.099	.069	.047	.085	.060	.041	.059	.042	.029	.034	.025	.017	.011	.008	.006	
8.0	.093	.062	.041	.080	.054	.036	.055	.038	.025	.032	.022	.015	.010	.007	.005	
9.0	.088	.057	.036	.075	.049	.031	.052	.035	.022	.030	.020	.013	.010	.007	.004	
10.0	.083	.052	.031	.071	.045	.027	.050	.032	.019	.029	.019	.012	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	3.1	3.8	3.3	3.9	4.1	2.9	3.6	3.1	3.7	3.9
3H	4.0	4.6	4.2	4.8	5.0	3.7	4.3	3.9	4.5	4.7
4H	4.4	5.1	4.7	5.3	5.5	4.1	4.8	4.4	5.0	5.2
6H	4.9	5.5	5.2	5.7	6.0	4.6	5.2	4.9	5.4	5.6
8H	5.1	5.7	5.4	5.9	6.2	4.8	5.3	5.1	5.6	5.8
12H	5.3	5.8	5.6	6.1	6.3	4.9	5.5	5.2	5.7	6.0
4H 2H	3.4	4.0	3.7	4.2	4.4	3.2	3.8	3.5	4.0	4.2
3H	4.5	5.0	4.8	5.3	5.6	4.3	4.8	4.6	5.1	5.4
4H	5.1	5.6	5.5	5.9	6.2	4.9	5.4	5.2	5.7	6.0
6H	5.8	6.2	6.2	6.6	6.9	5.5	5.9	5.9	6.3	6.6
8H	6.1	6.5	6.4	6.8	7.2	5.8	6.2	6.2	6.5	6.9
12H	6.3	6.6	6.7	7.0	7.4	6.0	6.4	6.4	6.7	7.1
8H 4H	5.4	5.8	5.8	6.1	6.5	5.2	5.6	5.6	5.9	6.3
6H	6.2	6.5	6.6	6.9	7.3	6.0	6.3	6.4	6.7	7.1
8H	6.6	6.9	7.0	7.3	7.7	6.3	6.6	6.8	7.1	7.5
12H	6.9	7.1	7.4	7.6	8.1	6.7	6.9	7.1	7.4	7.8
12H 4H	5.4	5.8	5.8	6.1	6.5	5.2	5.6	5.6	5.9	6.3
6H	6.3	6.6	6.7	7.0	7.4	6.0	6.3	6.5	6.8	7.2
8H	6.7	7.0	7.2	7.4	7.9	6.5	6.7	6.9	7.2	7.6
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.4 / - 0.5					+ 0.5 / - 0.6				
1.5H	+ 0.6 / - 0.4					+ 0.6 / - 0.5				
2.0H	+ 0.7 / - 0.4					+ 0.6 / - 0.6				

CIE Pub.117, 2695 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 3.4$)
Area: 0.01 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.487m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	85	82	90	85	81	90	84	81	78
0.80	98	92	89	97	92	89	96	92	89	85
1.00	101	96	93	101	96	93	99	96	92	89
1.25	105	100	97	104	100	97	102	99	96	92
1.50	107	103	100	106	102	100	104	101	99	94
2.00	110	106	103	108	105	102	106	103	101	96
2.50	111	108	105	110	106	104	107	104	102	96
3.00	113	109	107	111	108	106	107	105	104	97
4.00	114	112	110	112	110	109	109	107	106	99
5.00	116	114	112	113	112	110	110	108	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

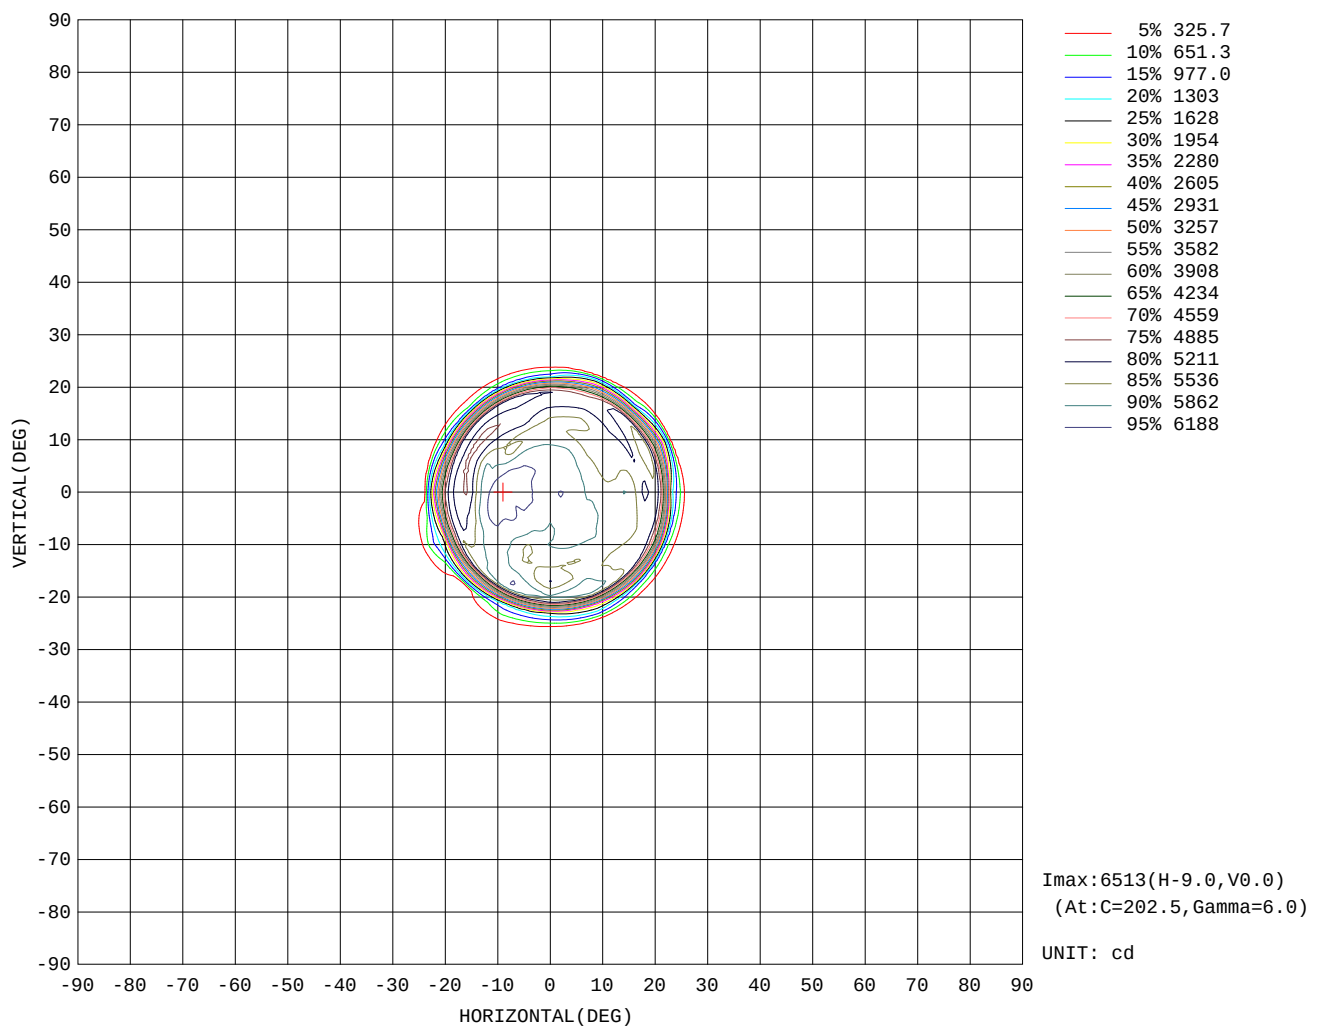

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.487m [K=1.0000]
Remarks:

AAI Figure

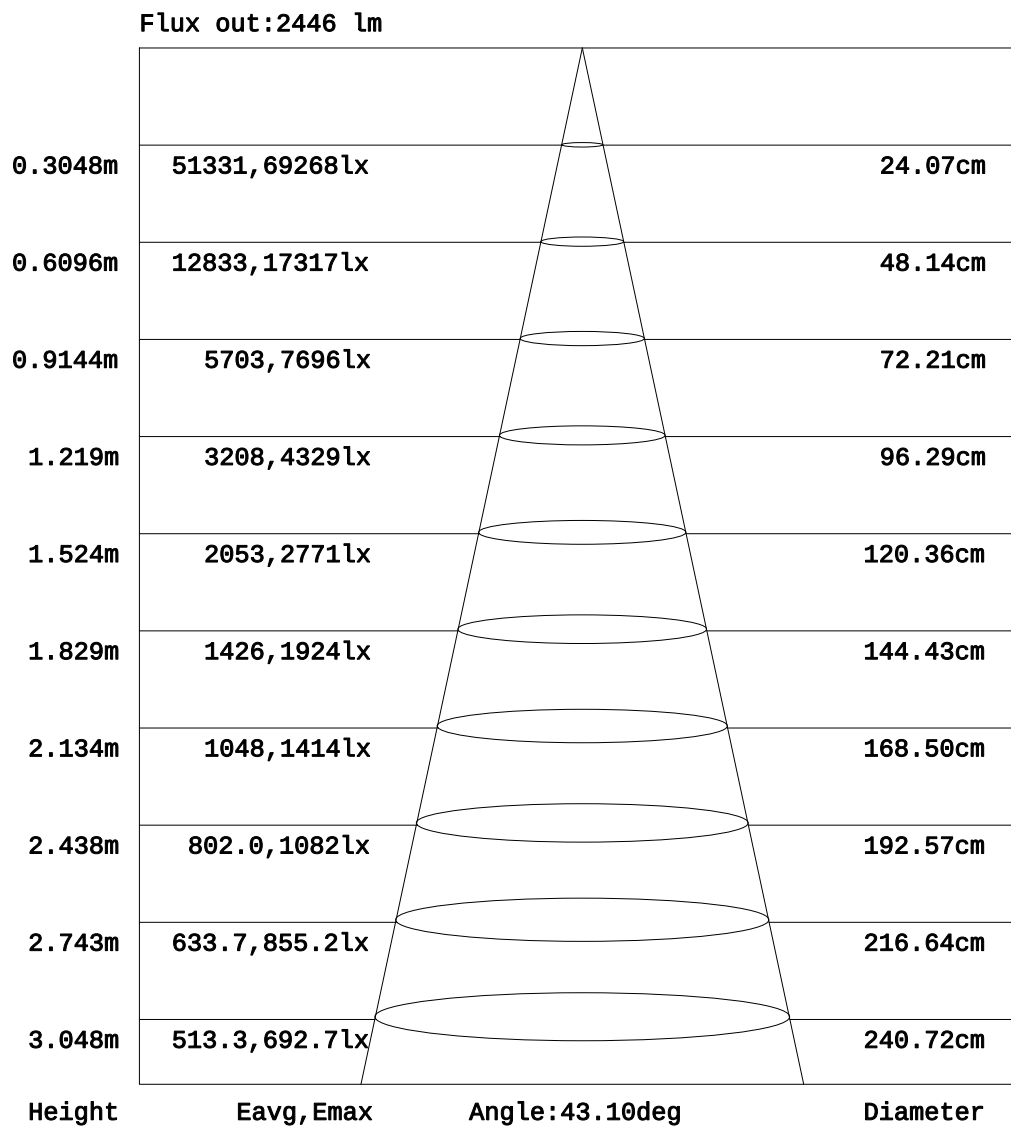


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

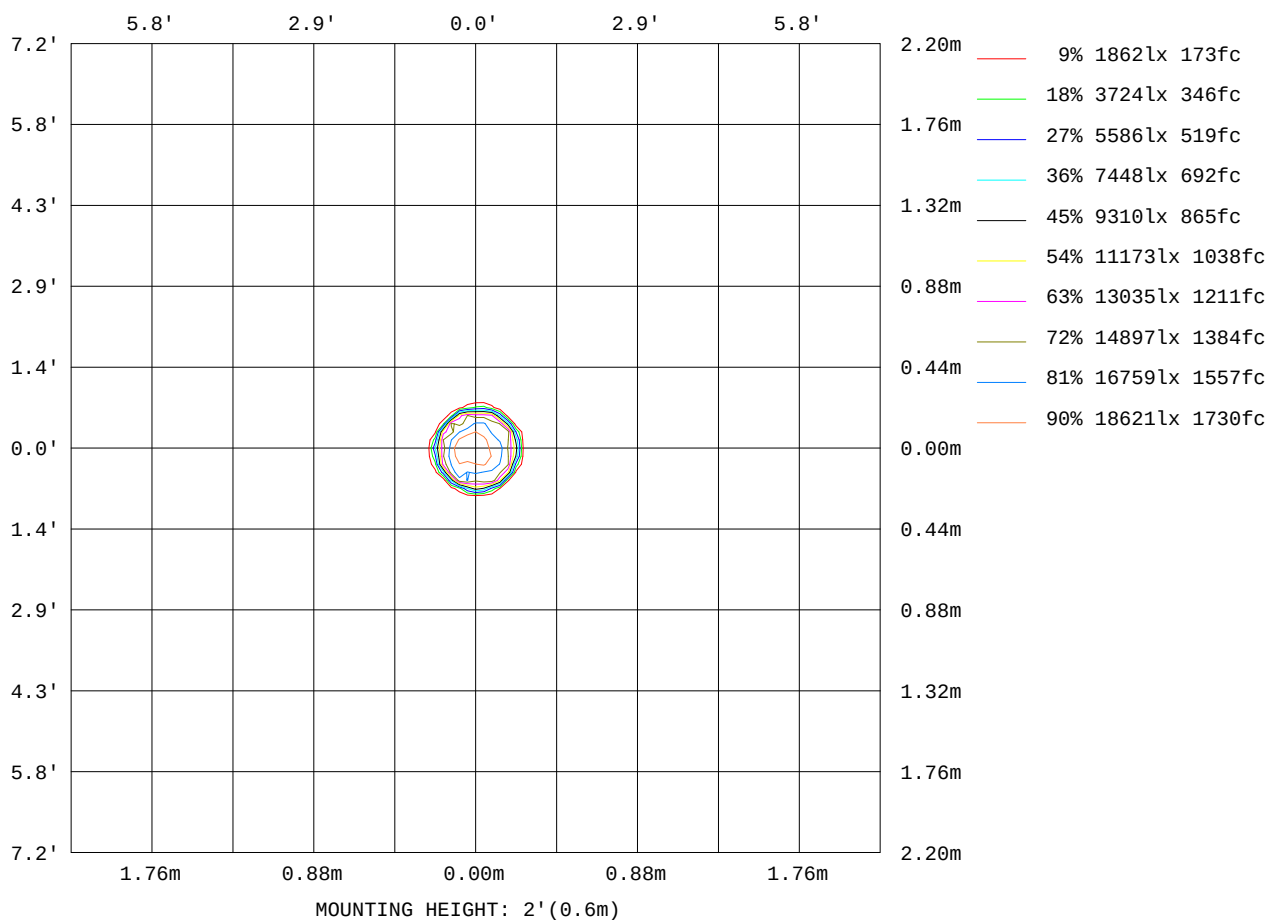

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2026-06-01

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.487m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.04V I:0.2599A P:56.100W PF:0.9808 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:2694.72x1 Lm		
NAME: EP6MI-60ML-F65BK-MAX	TYPE: Fixed Luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	1410
L_0~180(75)av	1400
L_0~180(85)av	1339
L_90~270(65)av	1368
L_90~270(75)av	1363
L_90~270(85)av	1298
L_45(65)av	1390
L_45(75)av	1382
L_45(85)av	1326

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:

Planar Illuminance Curve

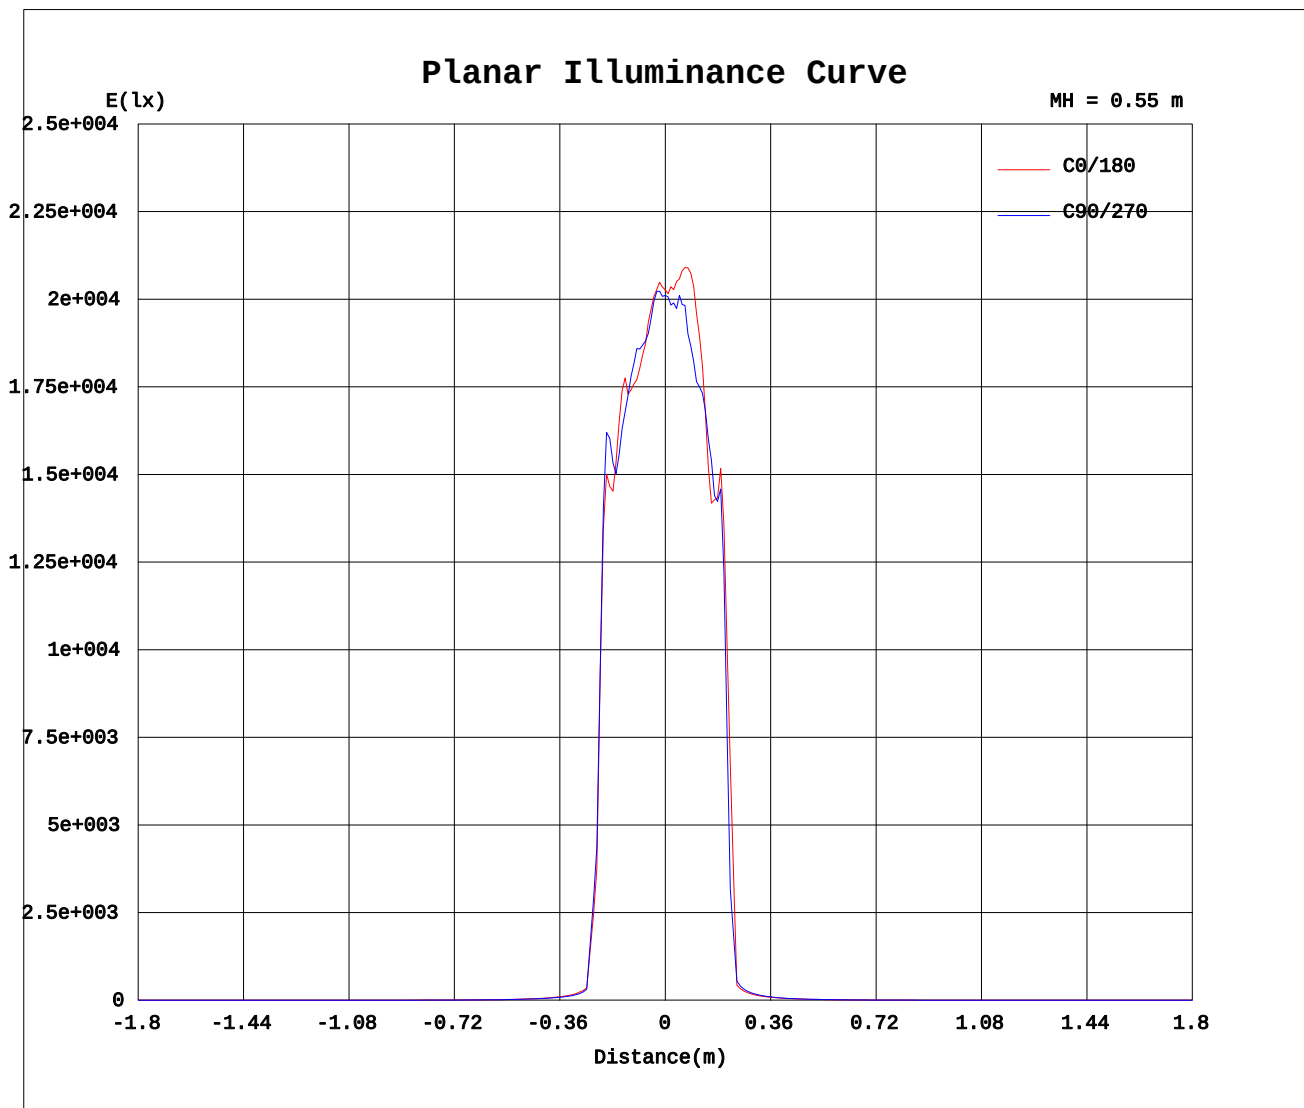

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.487m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093	6093			
5	5994	6082	6125	6075	5960	6090	6088	6322	6259	6322	6308	6025	6164	6167	6036	6043			
10	5576	5810	6088	5988	5899	5672	6129	6258	6411	6065	5567	5620	5782	5675	5544	5567			
15	5802	5684	5676	5646	5482	5617	6238	5628	5070	5229	5025	5035	5380	5581	5372	5433			
20	5441	5528	5518	6164	5915	6015	5455	4718	4919	4043	3864	4020	4465	4707	5466	5911			
25	564	493	547	836	643	655	104	714	133	131	146	170	166	154	143	147			
30	74.4	78.2	77.0	78.7	63.3	49.6	48.8	56.3	63.1	67.0	73.7	80.1	73.0	70.5	71.0	73.1			
35	43.8	45.1	44.8	46.0	38.2	31.8	31.8	35.4	38.4	41.1	44.5	46.5	42.7	41.7	42.4	43.2			
40	28.0	28.8	29.0	29.4	25.0	21.5	21.5	23.4	25.2	27.1	28.7	29.5	27.4	26.6	27.1	28.1			
45	19.2	19.7	19.9	20.0	17.4	15.2	15.2	16.3	17.3	18.4	19.3	19.8	18.3	17.8	18.1	18.9			
50	13.8	14.1	14.2	14.3	12.6	11.2	11.1	11.8	12.4	13.2	13.7	13.9	13.0	12.6	12.8	13.6			
55	10.2	10.4	10.5	10.4	9.29	8.40	8.36	8.72	9.20	9.75	10.1	10.2	9.59	9.23	9.42	10.04			
60	7.85	7.95	8.00	7.94	7.13	6.52	6.48	6.73	7.26	7.66	7.92	7.98	7.52	7.26	7.40	7.88			
65	6.18	6.25	6.26	6.19	5.61	5.16	5.12	5.30	5.74	6.04	6.24	6.29	5.96	5.77	5.87	6.25			
70	4.88	4.93	4.94	4.86	4.42	4.09	4.04	4.15	4.51	4.74	4.89	4.94	4.70	4.56	4.65	4.95			
75	3.76	3.83	3.84	3.77	3.43	3.16	3.10	3.16	3.49	3.64	3.74	3.78	3.63	3.54	3.63	3.88			
80	2.64	2.72	2.74	2.69	2.44	2.24	2.15	2.14	2.42	2.47	2.50	2.52	2.46	2.46	2.56	2.79			
85	1.34	1.44	1.48	1.46	1.32	1.19	1.09	1.00	1.00	0.95	0.92	0.93	0.94	1.01	1.13	1.30			
90	0.12	0.21	0.28	0.28	0.24	0.15	0.04	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.11			
95	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
100	0.03	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
105	0.04	0.03	0.03	0.03	0.05	0.03	0.04	0.03	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
110	0.04	0.03	0.03	0.03	0.06	0.03	0.05	0.03	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
115	0.05	0.03	0.04	0.04	0.06	0.04	0.05	0.04	0.13	0.12	0.10	0.06	0.07	0.06	0.08	0.13			
120	0.05	0.04	0.04	0.04	0.05	0.05	0.05	0.05	0.19	0.20	0.20	0.21	0.21	0.22	0.22	0.22			
125	0.05	0.04	0.04	0.04	0.05	0.05	0.05	0.05	0.03	0.04	0.04	0.04	0.03	0.03	0.02	0.02			
130	0.12	0.11	0.10	0.10	0.11	0.12	0.13	0.15	0.25	0.27	0.28	0.28	0.26	0.23	0.21	0.18			
135	0.28	0.27	0.27	0.27	0.28	0.29	0.30	0.32	0.67	0.69	0.71	0.71	0.68	0.65	0.62	0.57			
140	0.48	0.45	0.44	0.44	0.44	0.46	0.47	0.48	1.14	1.18	1.20	1.20	1.17	1.13	1.08	1.04			
145	0.73	0.72	0.70	0.70	0.70	0.71	0.72	0.74	1.72	1.76	1.78	1.78	1.76	1.72	1.66	1.60			
150	1.00	0.99	0.97	0.96	0.97	0.97	0.98	1.00	2.31	2.33	2.35	2.36	2.35	2.31	2.26	2.20			
155	1.18	1.16	1.15	1.14	1.15	1.16	1.17	1.18	2.70	2.72	2.74	2.74	2.72	2.69	2.64	2.60			
160	1.39	1.37	1.36	1.36	1.36	1.37	1.38	1.39	2.97	2.98	2.99	2.98	2.96	2.93	2.90	2.87			
165	1.63	1.60	1.57	1.56	1.56	1.57	1.59	1.60	3.13	3.12	3.11	3.08	3.06	3.04	3.01	2.99			
170	1.83	1.81	1.78	1.75	1.74	1.73	1.71	1.71	2.96	2.97	2.93	2.89	2.85	2.83	2.84	2.87			
175	1.58	1.57	1.53	1.49	1.47	1.46	1.48	1.48	2.42	2.42	2.37	2.34	2.30	2.27	2.28	2.31			
180	2.04	2.01	1.97	1.93	1.92	1.93	1.97	2.04	2.03	2.04	2.00	1.97	1.92	1.91	1.91	1.93			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks: