


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.04V I:0.1466A P:30.243W PF:0.9376 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:291.626x1 lm


NAME: AEP6MI-60ML-FF6BK(W)-MAX	TYPE: Fixed Luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 9.64 lm/W
MODEL		Imax(cd)	840.6	S/MH(C0/180)	0.59	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.60	
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	291.63	η UP, DN(C0-180)	0.1, 51.6	
NOMINAL FLUX(lm)	291.626	CIE CLASS	DIRECT	η UP, DN(C180-360)	0.1, 48.2	
LAMPS INSIDE	1	η up(%)	0.2	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	220	η down(%)	99.8	CIBSE SHR MAX	1.00	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

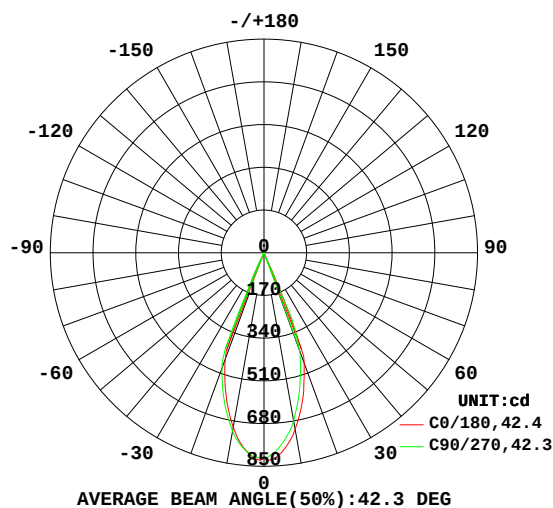

PLANAR ISOLUX DIAGRAM(UNIT:lx)

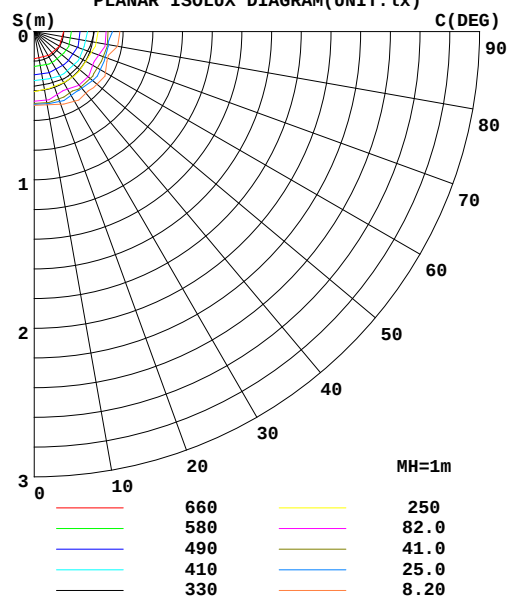

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	705.3	725.7	721.7	664.1	713.4	697.8	678.7	693.9	0- 10	72.56	72.56	24.9
20	452.2	472.1	489.6	461.3	467.8	447.9	418.8	446.1	10- 20	161.8	234.4	80.4
30	1.054	1.259	1.238	1.223	1.328	1.334	1.253	1.204	20- 30	54.64	289.0	99.1
40	0.6118	0.6376	0.6422	0.6759	0.7309	0.7324	0.7240	0.6802	30- 40	0.5720	289.6	99.3
50	0.3930	0.3930	0.3993	0.4132	0.4403	0.4431	0.4384	0.4199	40- 50	0.4132	290.0	99.5
60	0.2701	0.2653	0.2702	0.2836	0.4556	0.4549	0.4518	0.4437	50- 60	0.3175	290.3	99.6
70	0.1772	0.1764	0.1823	0.1895	0.3359	0.3318	0.3291	0.3256	60- 70	0.3056	290.7	99.7
80	0.0947	0.0966	0.1006	0.1035	0.2916	0.2802	0.2781	0.2752	70- 80	0.2423	290.9	99.7
90	0.0097	0.0131	0.0186	0.0224	0.0351	0.0013	0.0084	0.0088	80- 90	0.0883	291.0	99.8
100	0.0150	0.0129	0.0132	0.0572	0.0646	0	0	0	90-100	0.0140	291.0	99.8
110	0.0270	0.0203	0.0251	0.1559	0.0792	0	0	0	100-110	0.0290	291.0	99.8
120	0.0278	0.0267	0.0485	0.3178	0.2880	0.1983	0.2054	0.2118	110-120	0.0841	291.1	99.8
130	0.0274	0.0250	0.0818	0.4344	0.1409	0.0285	0.0231	0.0223	120-130	0.0806	291.2	99.9
140	0.0607	0.0569	0.1252	0.4117	0.2112	0.1325	0.1181	0.1117	130-140	0.0934	291.3	99.9
150	0.1189	0.1203	0.1640	0.3275	0.3265	0.3004	0.2530	0.2450	140-150	0.1180	291.4	99.9
160	0.1583	0.1656	0.1895	0.2471	0.4048	0.4041	0.3352	0.3224	150-160	0.1179	291.5	100
170	0.1917	0.2040	0.2164	0.2398	0.3905	0.3843	0.3378	0.3057	160-170	0.0811	291.6	100
180	0.2151	0.2051	0.2020	0.2294	0.2178	0.2126	0.1981	0.2005	170-180	0.0241	291.6	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 289.84 lm

%lum = 99.4%

%lamp = 99.4%

Conical surface Flux(120deg): 290.35 lm


%lum = 99.6%

%lamp = 99.6%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:


LUMINANCE LIMITATION CURVES

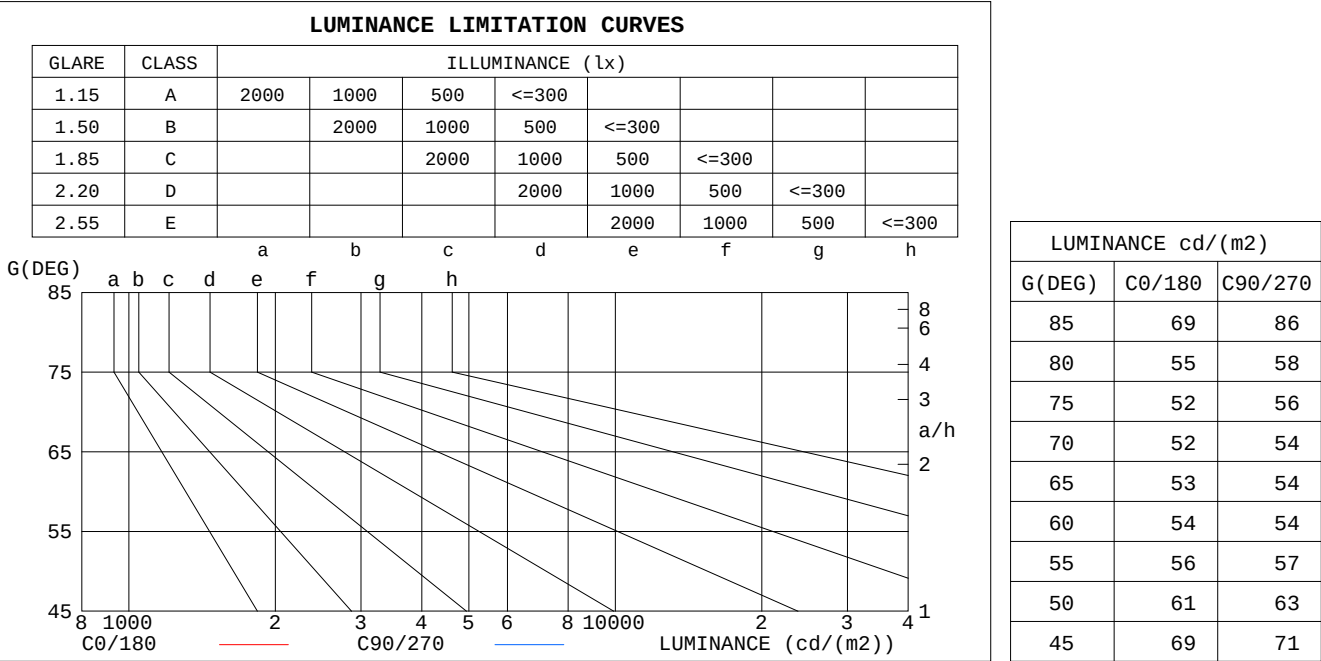

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Temperature:25.3DEG	Humidity:65.0%
Operators:Oliver	Test Distance:2.487m [K=1.0000]
Test Date:2026-06-01	Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.11	1.09	1.11	1.09	1.07	1.06	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.02	1.06	1.03	1.00	1.02	1.00	.98	.99	.98	.96	.97	.95	.94	.93
3.0	1.02	.99	.96	1.01	.98	.95	.99	.96	.94	.96	.94	.92	.94	.92	.91	.89
4.0	.98	.94	.91	.97	.93	.91	.95	.92	.90	.93	.91	.89	.92	.89	.88	.86
5.0	.94	.90	.87	.94	.90	.87	.92	.89	.86	.90	.88	.85	.89	.87	.85	.83
6.0	.91	.87	.84	.90	.86	.83	.89	.85	.83	.88	.85	.82	.86	.84	.82	.81
7.0	.88	.84	.80	.87	.83	.80	.86	.82	.80	.85	.82	.79	.84	.81	.79	.78
8.0	.85	.81	.78	.84	.80	.77	.83	.80	.77	.83	.79	.77	.82	.79	.77	.76
9.0	.82	.78	.75	.82	.78	.75	.81	.77	.75	.80	.77	.74	.79	.76	.74	.73
10.0	.80	.75	.73	.79	.75	.72	.78	.75	.72	.78	.74	.72	.77	.74	.72	.71

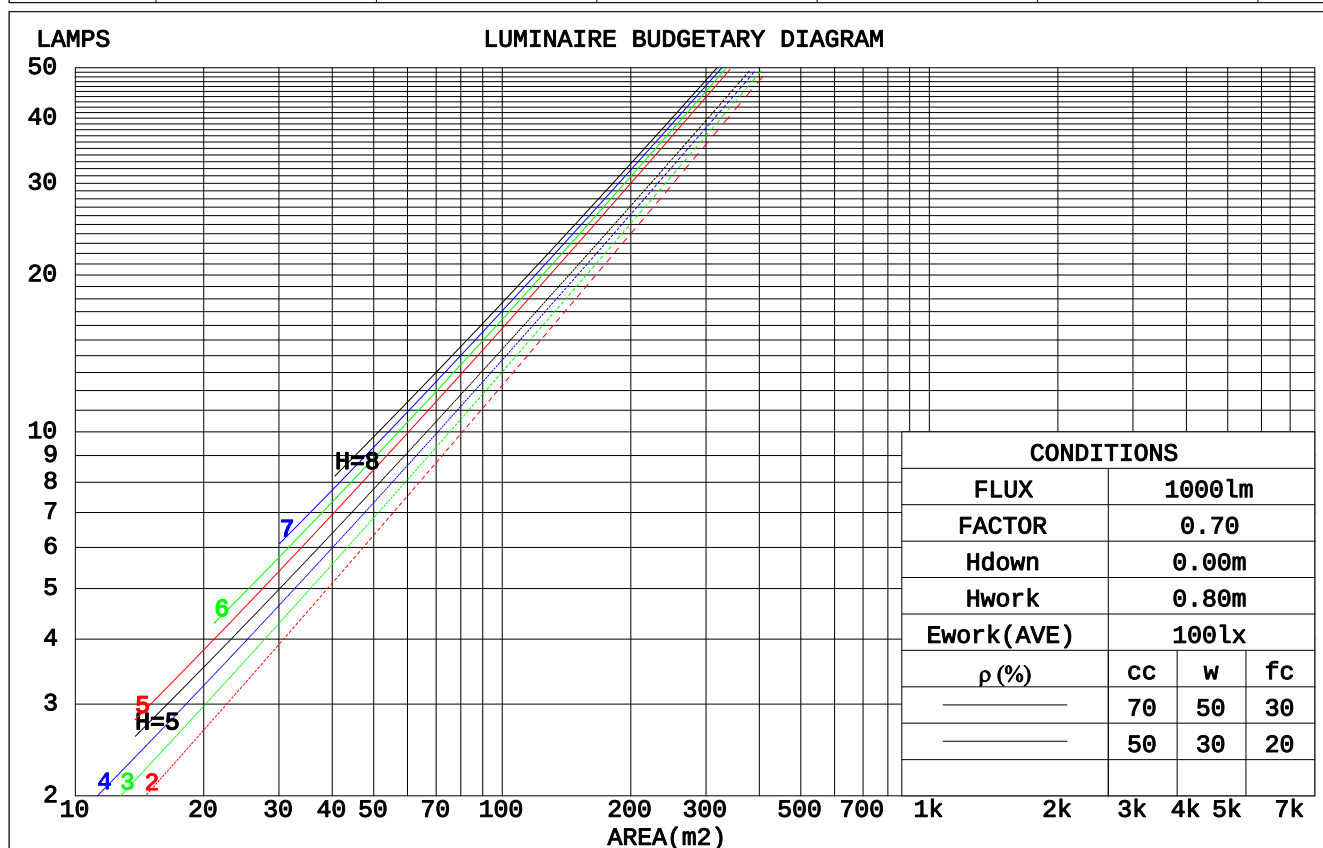

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.141	.080	.025	.134	.076	.024	.121	.070	.022	.110	.063	.020	.099	.058	.019	
2.0	.130	.071	.022	.125	.069	.021	.114	.064	.020	.105	.059	.018	.096	.054	.017	
3.0	.121	.065	.019	.117	.063	.019	.108	.059	.018	.100	.055	.017	.093	.051	.016	
4.0	.114	.059	.017	.110	.058	.017	.103	.055	.016	.096	.052	.016	.090	.049	.015	
5.0	.108	.055	.016	.104	.054	.016	.098	.051	.015	.092	.049	.014	.087	.046	.014	
6.0	.102	.051	.015	.099	.050	.014	.094	.048	.014	.089	.046	.014	.084	.044	.013	
7.0	.097	.048	.014	.095	.047	.013	.090	.046	.013	.086	.044	.013	.082	.042	.012	
8.0	.093	.045	.013	.091	.045	.013	.087	.043	.012	.083	.042	.012	.079	.041	.012	
9.0	.089	.043	.012	.087	.043	.012	.084	.041	.012	.080	.040	.012	.077	.039	.011	
10.0	.086	.041	.011	.084	.041	.011	.081	.040	.011	.078	.039	.011	.075	.038	.011	

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.170	.159	.149	.146	.137	.129	.100	.094	.089	.057	.054	.052	.018	.018	.017	
2.0	.152	.134	.119	.131	.116	.103	.089	.080	.072	.052	.047	.042	.017	.015	.014	
3.0	.138	.115	.097	.118	.099	.084	.081	.069	.059	.047	.040	.035	.015	.013	.011	
4.0	.125	.100	.080	.107	.086	.070	.074	.060	.049	.043	.035	.029	.014	.011	.010	
5.0	.115	.087	.067	.099	.076	.058	.068	.053	.041	.039	.031	.024	.013	.010	.008	
6.0	.106	.078	.057	.091	.067	.050	.063	.047	.035	.037	.028	.021	.012	.009	.007	
7.0	.099	.069	.049	.085	.060	.043	.059	.042	.030	.034	.025	.018	.011	.008	.006	
8.0	.093	.063	.042	.080	.054	.037	.055	.038	.026	.032	.023	.016	.010	.007	.005	
9.0	.087	.057	.037	.075	.050	.032	.052	.035	.023	.030	.021	.014	.010	.007	.005	
10.0	.082	.052	.033	.071	.046	.028	.049	.032	.020	.029	.019	.012	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	-14.3	-13.6	-14.1	-13.5	-13.3	-14.2	-13.5	-14.0	-13.3	-13.2
3H	-12.8	-12.2	-12.6	-12.0	-11.8	-12.7	-12.1	-12.4	-11.9	-11.7
4H	-12.1	-11.5	-11.8	-11.3	-11.1	-11.9	-11.3	-11.7	-11.1	-10.9
6H	-11.4	-10.9	-11.1	-10.6	-10.4	-11.2	-10.7	-11.0	-10.5	-10.2
8H	-11.2	-10.6	-10.9	-10.4	-10.1	-10.9	-10.4	-10.6	-10.1	-9.9
12H	-10.9	-10.4	-10.6	-10.1	-9.8	-10.5	-10.0	-10.2	-9.8	-9.5
4H 2H	-13.7	-13.1	-13.4	-12.9	-12.7	-13.6	-13.0	-13.3	-12.8	-12.6
3H	-12.0	-11.5	-11.7	-11.2	-10.9	-11.9	-11.4	-11.6	-11.1	-10.8
4H	-11.1	-10.7	-10.8	-10.4	-10.1	-11.0	-10.6	-10.7	-10.3	-10.0
6H	-10.3	-9.9	-10.0	-9.6	-9.2	-10.2	-9.8	-9.8	-9.4	-9.1
8H	-10.0	-9.6	-9.6	-9.2	-8.9	-9.8	-9.4	-9.4	-9.0	-8.7
12H	-9.6	-9.3	-9.2	-8.9	-8.5	-9.3	-9.0	-8.9	-8.6	-8.2
8H 4H	-10.8	-10.4	-10.4	-10.1	-9.7	-10.7	-10.3	-10.3	-10.0	-9.6
6H	-9.8	-9.5	-9.4	-9.1	-8.7	-9.7	-9.4	-9.3	-9.0	-8.6
8H	-9.4	-9.1	-8.9	-8.7	-8.2	-9.2	-8.9	-8.7	-8.5	-8.0
12H	-8.9	-8.6	-8.4	-8.2	-7.7	-8.6	-8.3	-8.1	-7.9	-7.4
12H 4H	-10.8	-10.4	-10.4	-10.0	-9.6	-10.7	-10.3	-10.3	-10.0	-9.6
6H	-9.7	-9.4	-9.3	-9.0	-8.6	-9.6	-9.3	-9.2	-8.9	-8.5
8H	-9.2	-9.0	-8.7	-8.5	-8.0	-9.0	-8.8	-8.6	-8.4	-7.9
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.2 / - 0.2					+ 0.2 / - 0.2				
1.5H	+ 0.0 / - 0.1					+ 0.1 / - 0.1				
2.0H	+ 0.1 / - 0.2					+ 0.2 / - 0.2				

CIE Pub.117, 291.6 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -4.3$)
Area: 0.01 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.487m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	97	93	90	96	92	89	86
1.00	102	97	94	101	96	93	99	96	93	89
1.25	105	101	98	104	100	97	102	99	96	92
1.50	108	103	100	106	103	100	104	101	99	95
2.00	110	106	103	108	105	102	106	103	101	96
2.50	111	108	105	110	107	104	107	104	102	97
3.00	113	110	107	111	108	106	108	105	104	97
4.00	114	112	110	112	110	109	109	107	106	99
5.00	116	114	112	114	112	110	110	108	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

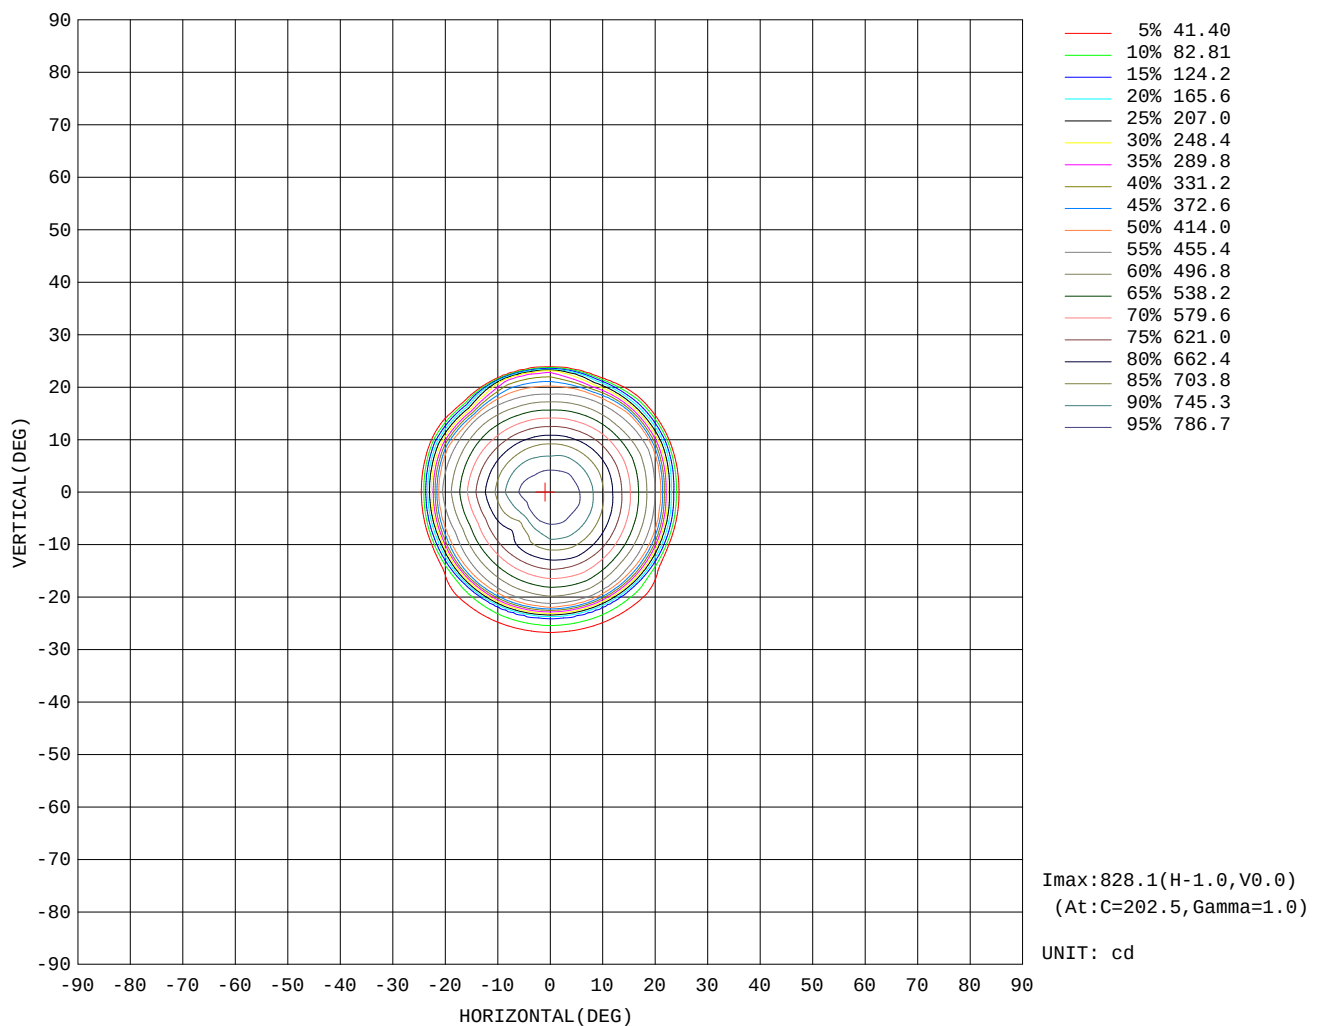

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.487m [K=1.0000]
Remarks:

AAI Figure

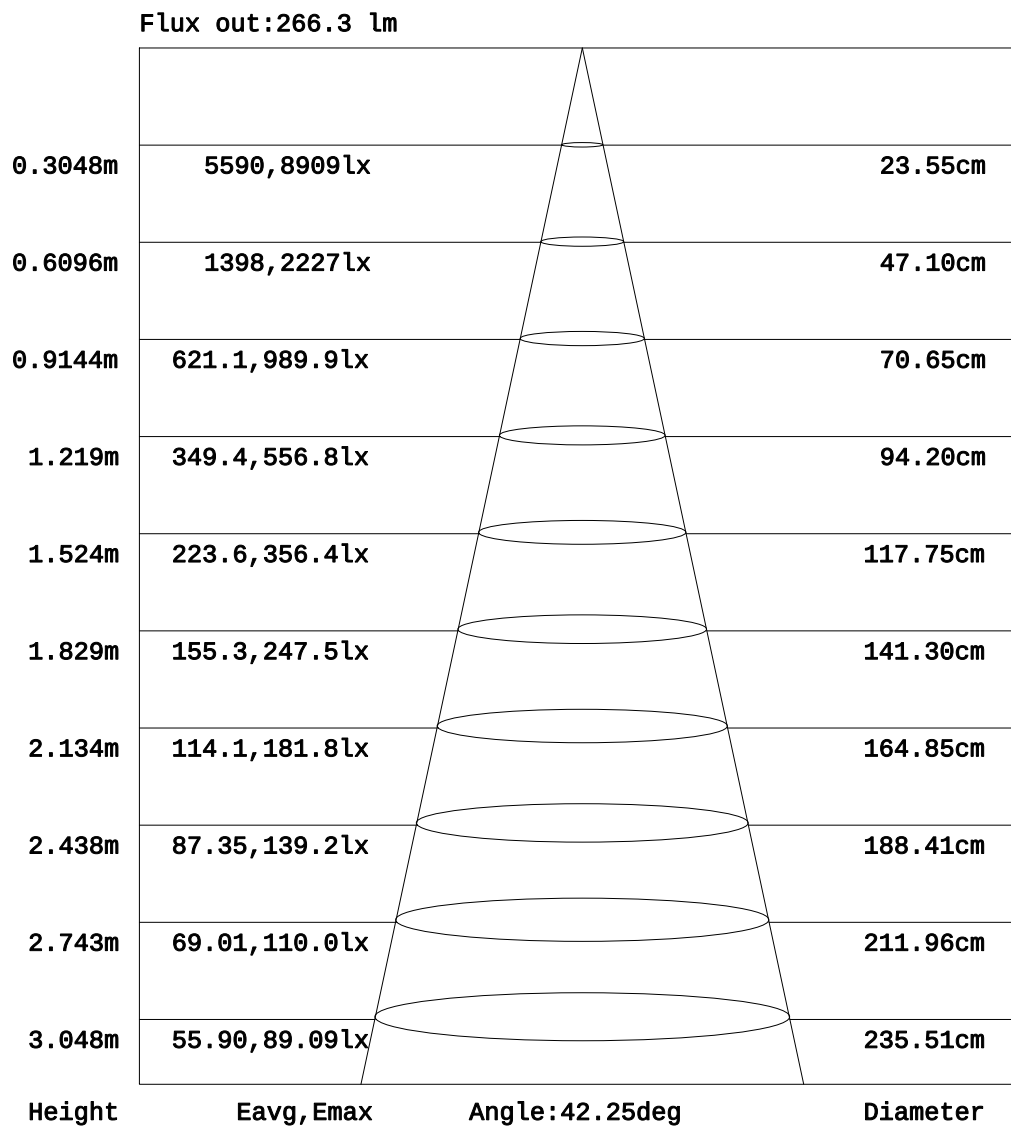


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

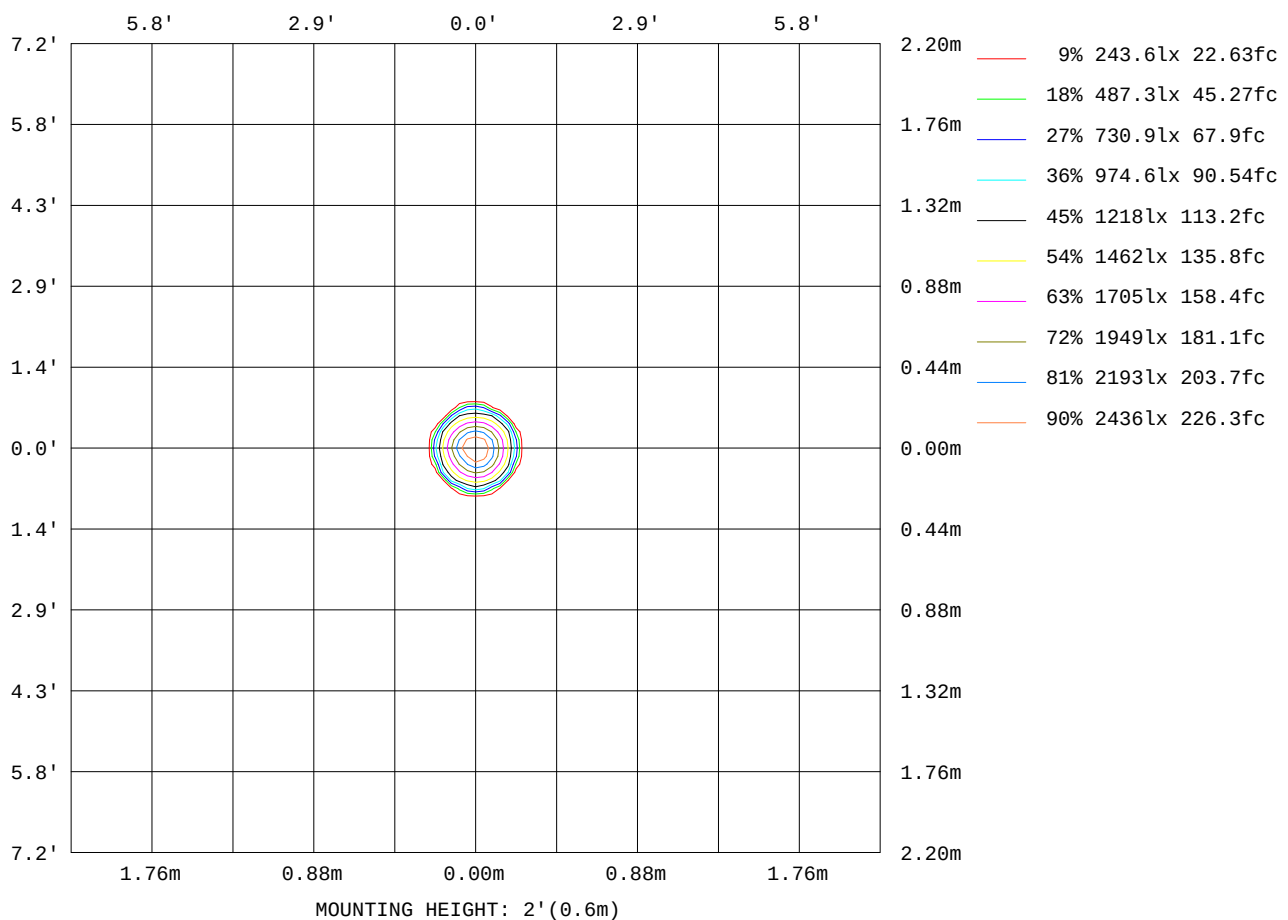

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.04V I:0.1466A P:30.243W PF:0.9376 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:291.626x1 Lm		
NAME: EP6MI-60ML-FF6BK(W)-MAX	TYPE: Fixed Luminaire	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	76
L_0~180(75)av	90
L_0~180(85)av	75
L_90~270(65)av	77
L_90~270(75)av	90
L_90~270(85)av	73
L_45(65)av	76
L_45(75)av	90
L_45(85)av	67

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.487m [K=1.0000]
 Remarks:

Planar Illuminance Curve

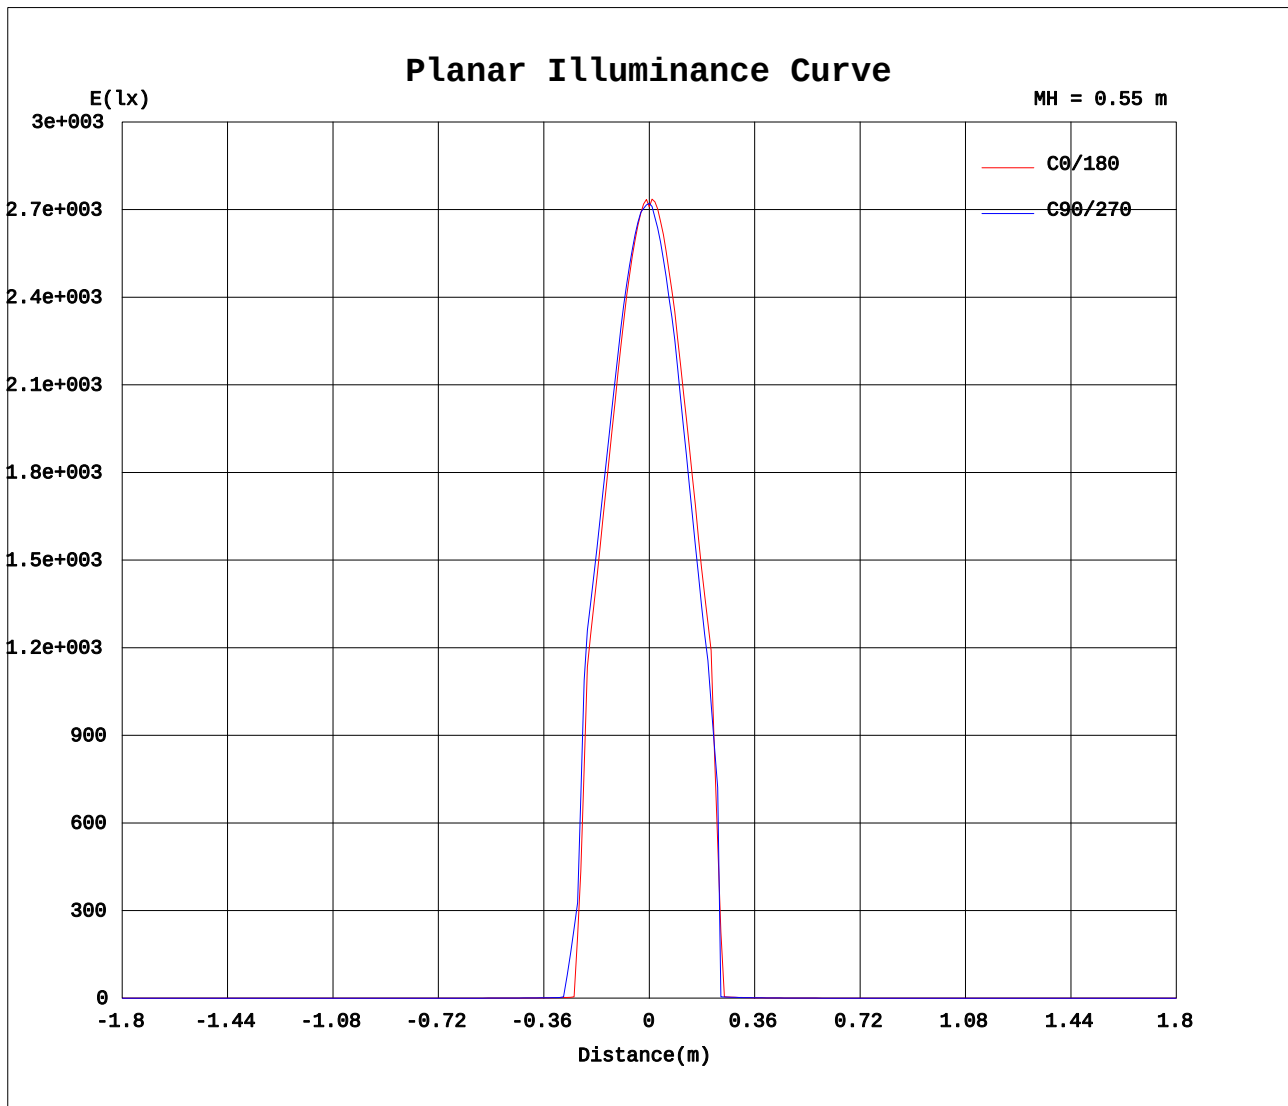

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.487m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	818	818	818	818	818	818	818	818	818	818	818	818	818	818	818	818			
5	793	814	805	796	795	793	787	783	798	804	785	770	769	775	784	787			
10	705	728	726	725	722	702	664	696	713	719	698	681	679	684	694	704			
15	585	605	611	607	611	600	588	578	598	598	575	557	551	560	575	585			
20	452	468	472	488	490	477	461	444	468	464	448	427	419	430	446	463			
25	2.03	1.85	80.8	92.1	96.6	88.1	70.5	2.00	2.17	2.23	2.33	2.02	1.88	1.82	1.93	1.73			
30	1.05	1.12	1.26	1.24	1.24	1.22	1.22	1.26	1.33	1.36	1.33	1.29	1.25	1.21	1.20	1.12			
35	0.80	0.81	0.88	0.87	0.88	0.86	0.90	0.94	0.98	1.01	0.98	0.97	0.97	0.93	0.90	0.86			
40	0.61	0.61	0.64	0.64	0.64	0.64	0.68	0.73	0.73	0.75	0.73	0.72	0.72	0.71	0.68	0.65			
45	0.49	0.48	0.49	0.49	0.50	0.50	0.52	0.59	0.56	0.58	0.57	0.56	0.56	0.55	0.53	0.50			
50	0.39	0.39	0.39	0.39	0.40	0.40	0.41	0.46	0.44	0.45	0.44	0.44	0.44	0.43	0.42	0.41			
55	0.32	0.32	0.32	0.32	0.32	0.33	0.34	0.37	0.35	0.35	0.35	0.34	0.34	0.35	0.34	0.33			
60	0.27	0.27	0.27	0.26	0.27	0.28	0.28	0.30	0.46	0.46	0.45	0.45	0.45	0.45	0.44	0.44			
65	0.22	0.22	0.22	0.22	0.23	0.24	0.24	0.24	0.42	0.43	0.42	0.42	0.42	0.42	0.41	0.41			
70	0.18	0.18	0.18	0.17	0.18	0.20	0.19	0.19	0.34	0.33	0.33	0.33	0.33	0.33	0.33	0.32			
75	0.13	0.14	0.14	0.13	0.14	0.16	0.15	0.15	0.33	0.33	0.33	0.32	0.32	0.32	0.32	0.32			
80	0.09	0.10	0.10	0.10	0.10	0.12	0.10	0.10	0.29	0.29	0.28	0.28	0.28	0.28	0.28	0.27			
85	0.06	0.06	0.06	0.06	0.07	0.07	0.07	0.07	0.07	0.06	0.05	0.05	0.05	0.06	0.05	0.05			
90	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.03	0.04	0.01	0.00	0.00	0.01	0.01	0.01	0.01			
95	0.01	0.01	0.01	0.01	0.01	0.02	0.03	0.05	0.05	0.01	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.01	0.01	0.01	0.01	0.01	0.02	0.06	0.09	0.06	0.01	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.02	0.01	0.01	0.01	0.02	0.03	0.09	0.13	0.07	0.01	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.03	0.02	0.02	0.02	0.03	0.05	0.16	0.19	0.08	0.01	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.03	0.02	0.03	0.03	0.04	0.08	0.24	0.27	0.19	0.14	0.12	0.03	0.01	0.00	0.02	0.01			
120	0.03	0.03	0.03	0.03	0.05	0.11	0.32	0.35	0.29	0.21	0.20	0.20	0.21	0.21	0.21	0.21			
125	0.02	0.02	0.02	0.03	0.06	0.13	0.38	0.40	0.11	0.02	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.03	0.03	0.03	0.04	0.08	0.15	0.43	0.42	0.14	0.04	0.03	0.02	0.02	0.02	0.02	0.02			
135	0.04	0.04	0.04	0.05	0.11	0.17	0.44	0.39	0.18	0.09	0.07	0.07	0.07	0.06	0.06	0.06			
140	0.06	0.05	0.06	0.07	0.13	0.20	0.41	0.34	0.21	0.15	0.13	0.12	0.12	0.12	0.11	0.11			
145	0.09	0.09	0.09	0.10	0.14	0.22	0.37	0.31	0.26	0.23	0.21	0.19	0.18	0.18	0.18	0.17			
150	0.12	0.12	0.12	0.14	0.16	0.24	0.33	0.28	0.33	0.32	0.30	0.26	0.25	0.25	0.24	0.24			
155	0.14	0.14	0.14	0.16	0.17	0.22	0.28	0.24	0.37	0.38	0.36	0.32	0.30	0.30	0.29	0.29			
160	0.16	0.16	0.17	0.17	0.19	0.22	0.25	0.24	0.40	0.41	0.40	0.36	0.34	0.33	0.32	0.32			
165	0.18	0.19	0.19	0.20	0.20	0.22	0.24	0.24	0.41	0.43	0.41	0.38	0.35	0.34	0.33	0.33			
170	0.19	0.20	0.20	0.21	0.22	0.22	0.24	0.25	0.39	0.40	0.38	0.36	0.34	0.31	0.31	0.31			
175	0.17	0.18	0.19	0.19	0.20	0.20	0.20	0.21	0.31	0.32	0.31	0.28	0.24	0.24	0.24	0.24			
180	0.22	0.22	0.21	0.19	0.20	0.22	0.23	0.23	0.22	0.22	0.21	0.20	0.20	0.20	0.20	0.20			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2026-06-01

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.487m [K=1.0000]
 Remarks: